


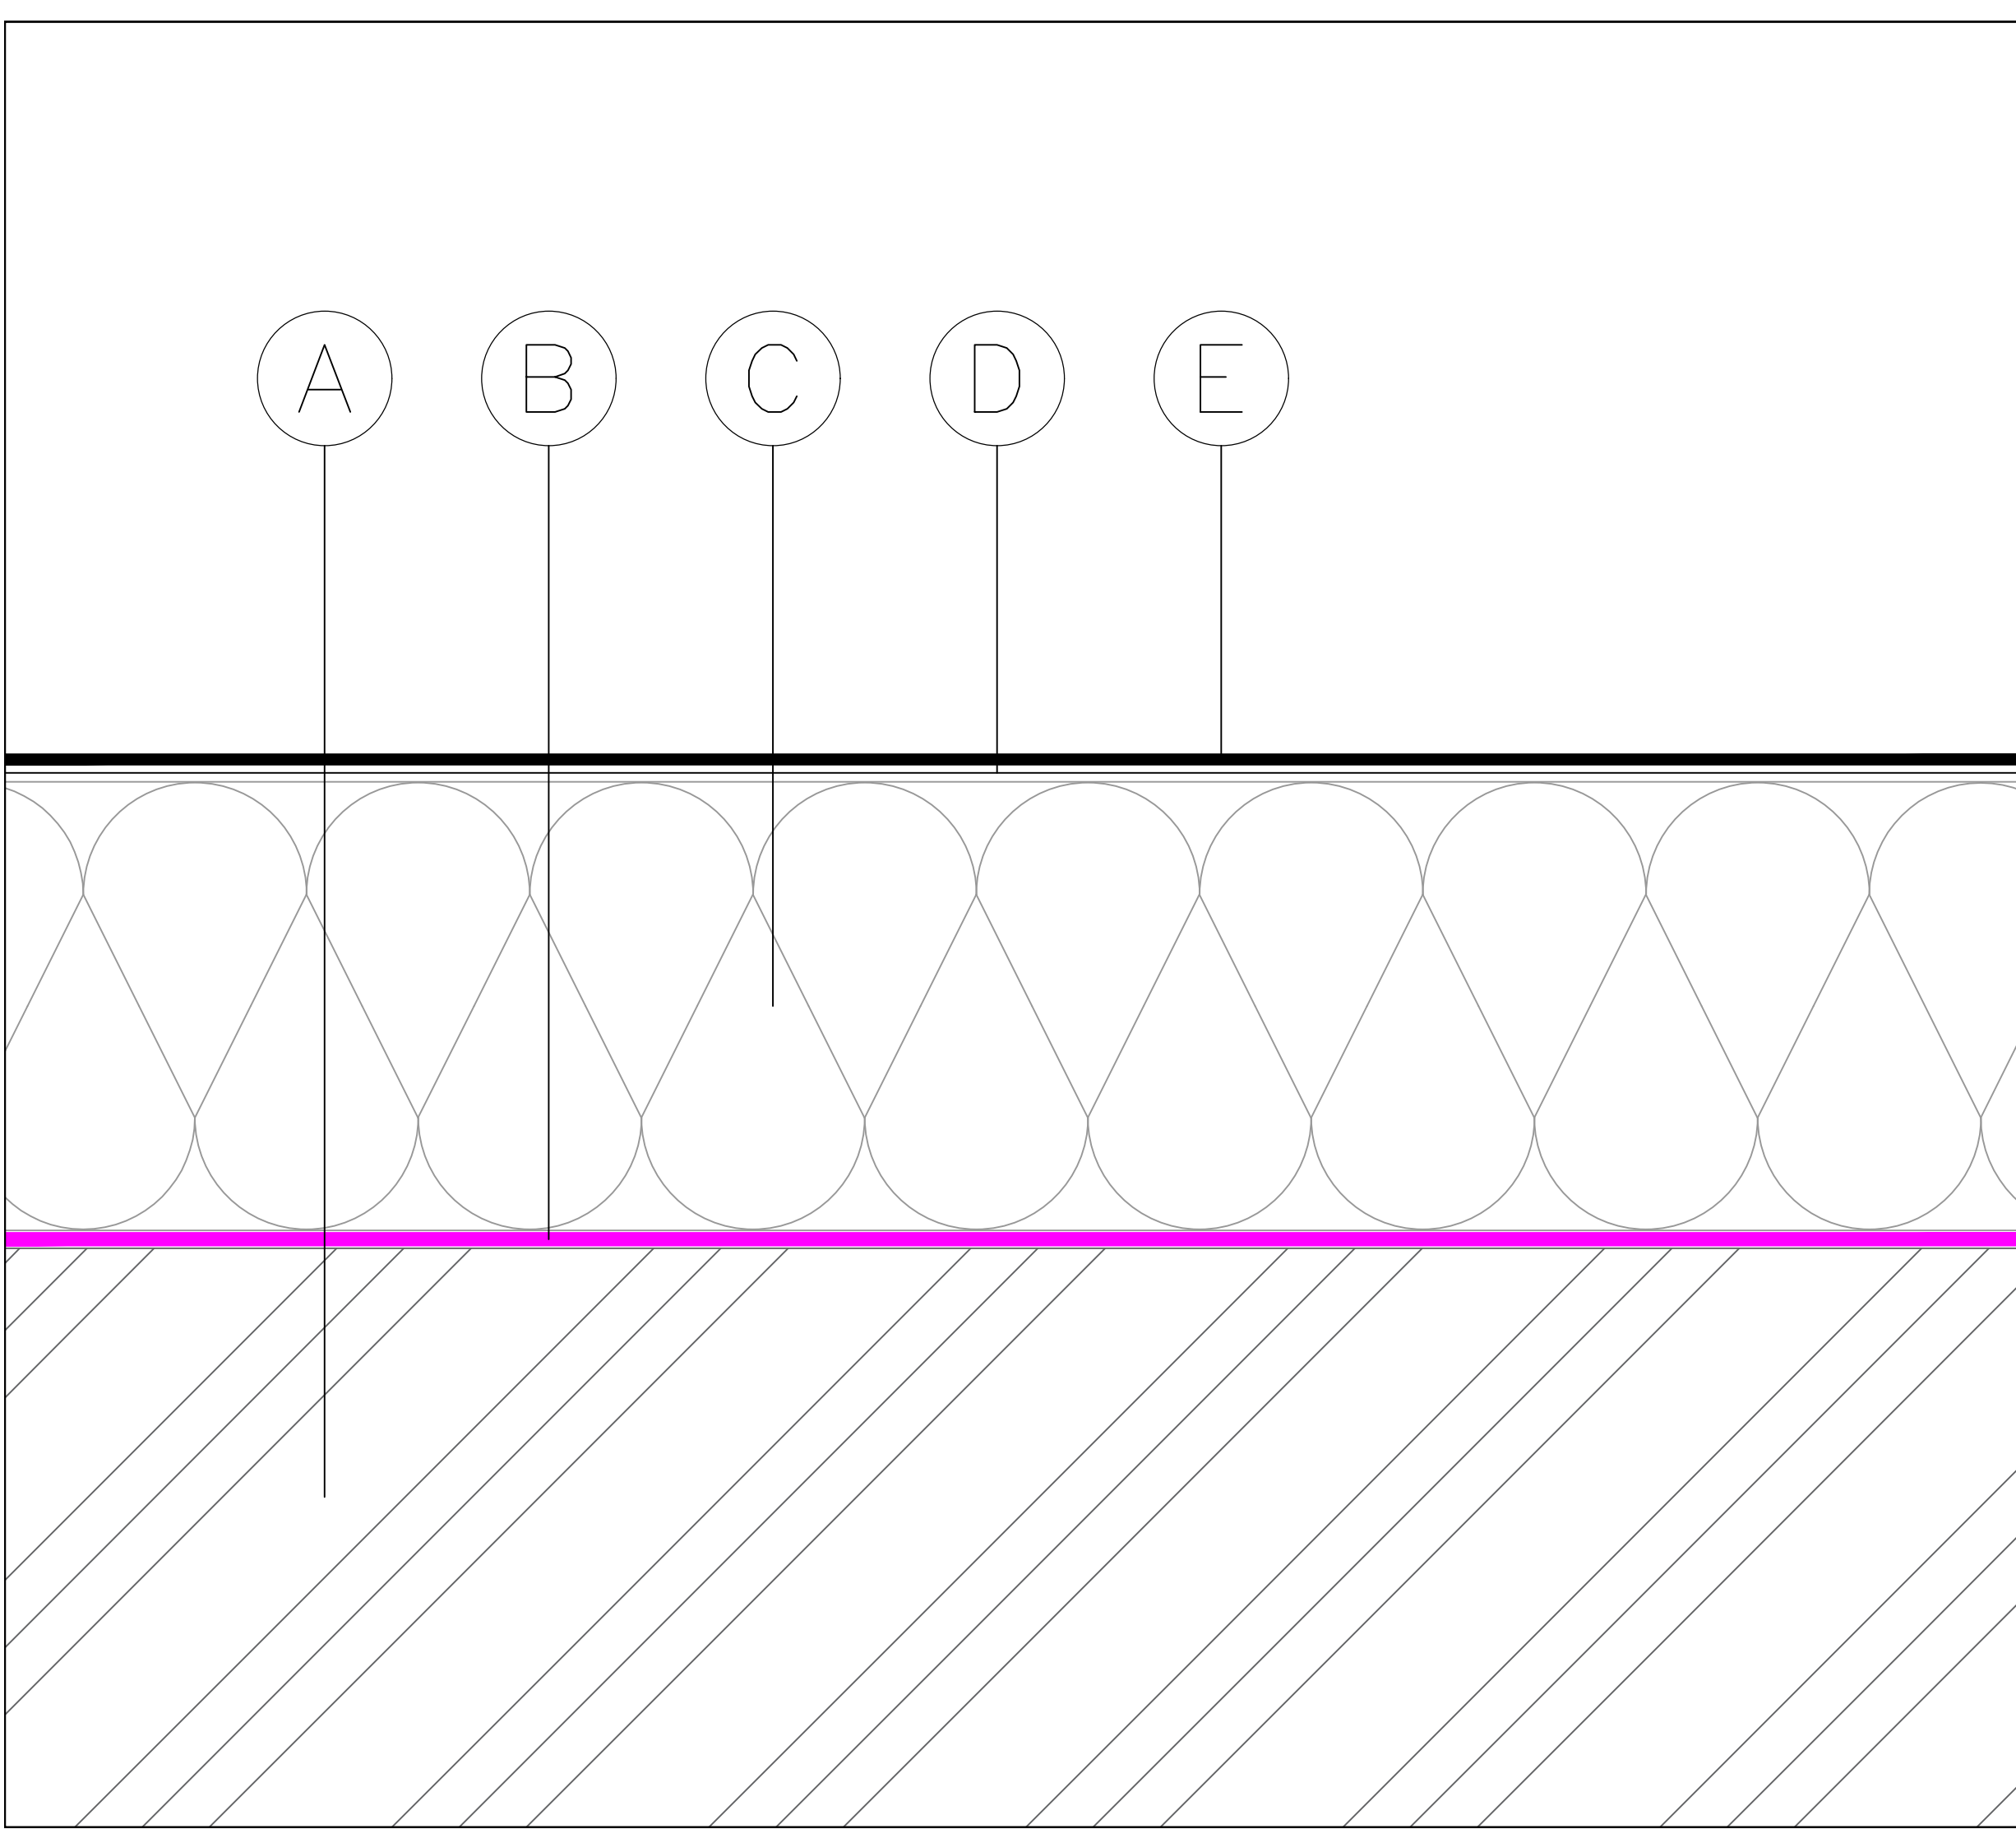

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.


FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE



T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Warm Main Roof Build Up
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018	SCALE: NTS	DRAWN: MDJ
DRAWING NO: FATRA F2F-01		REVISION: -

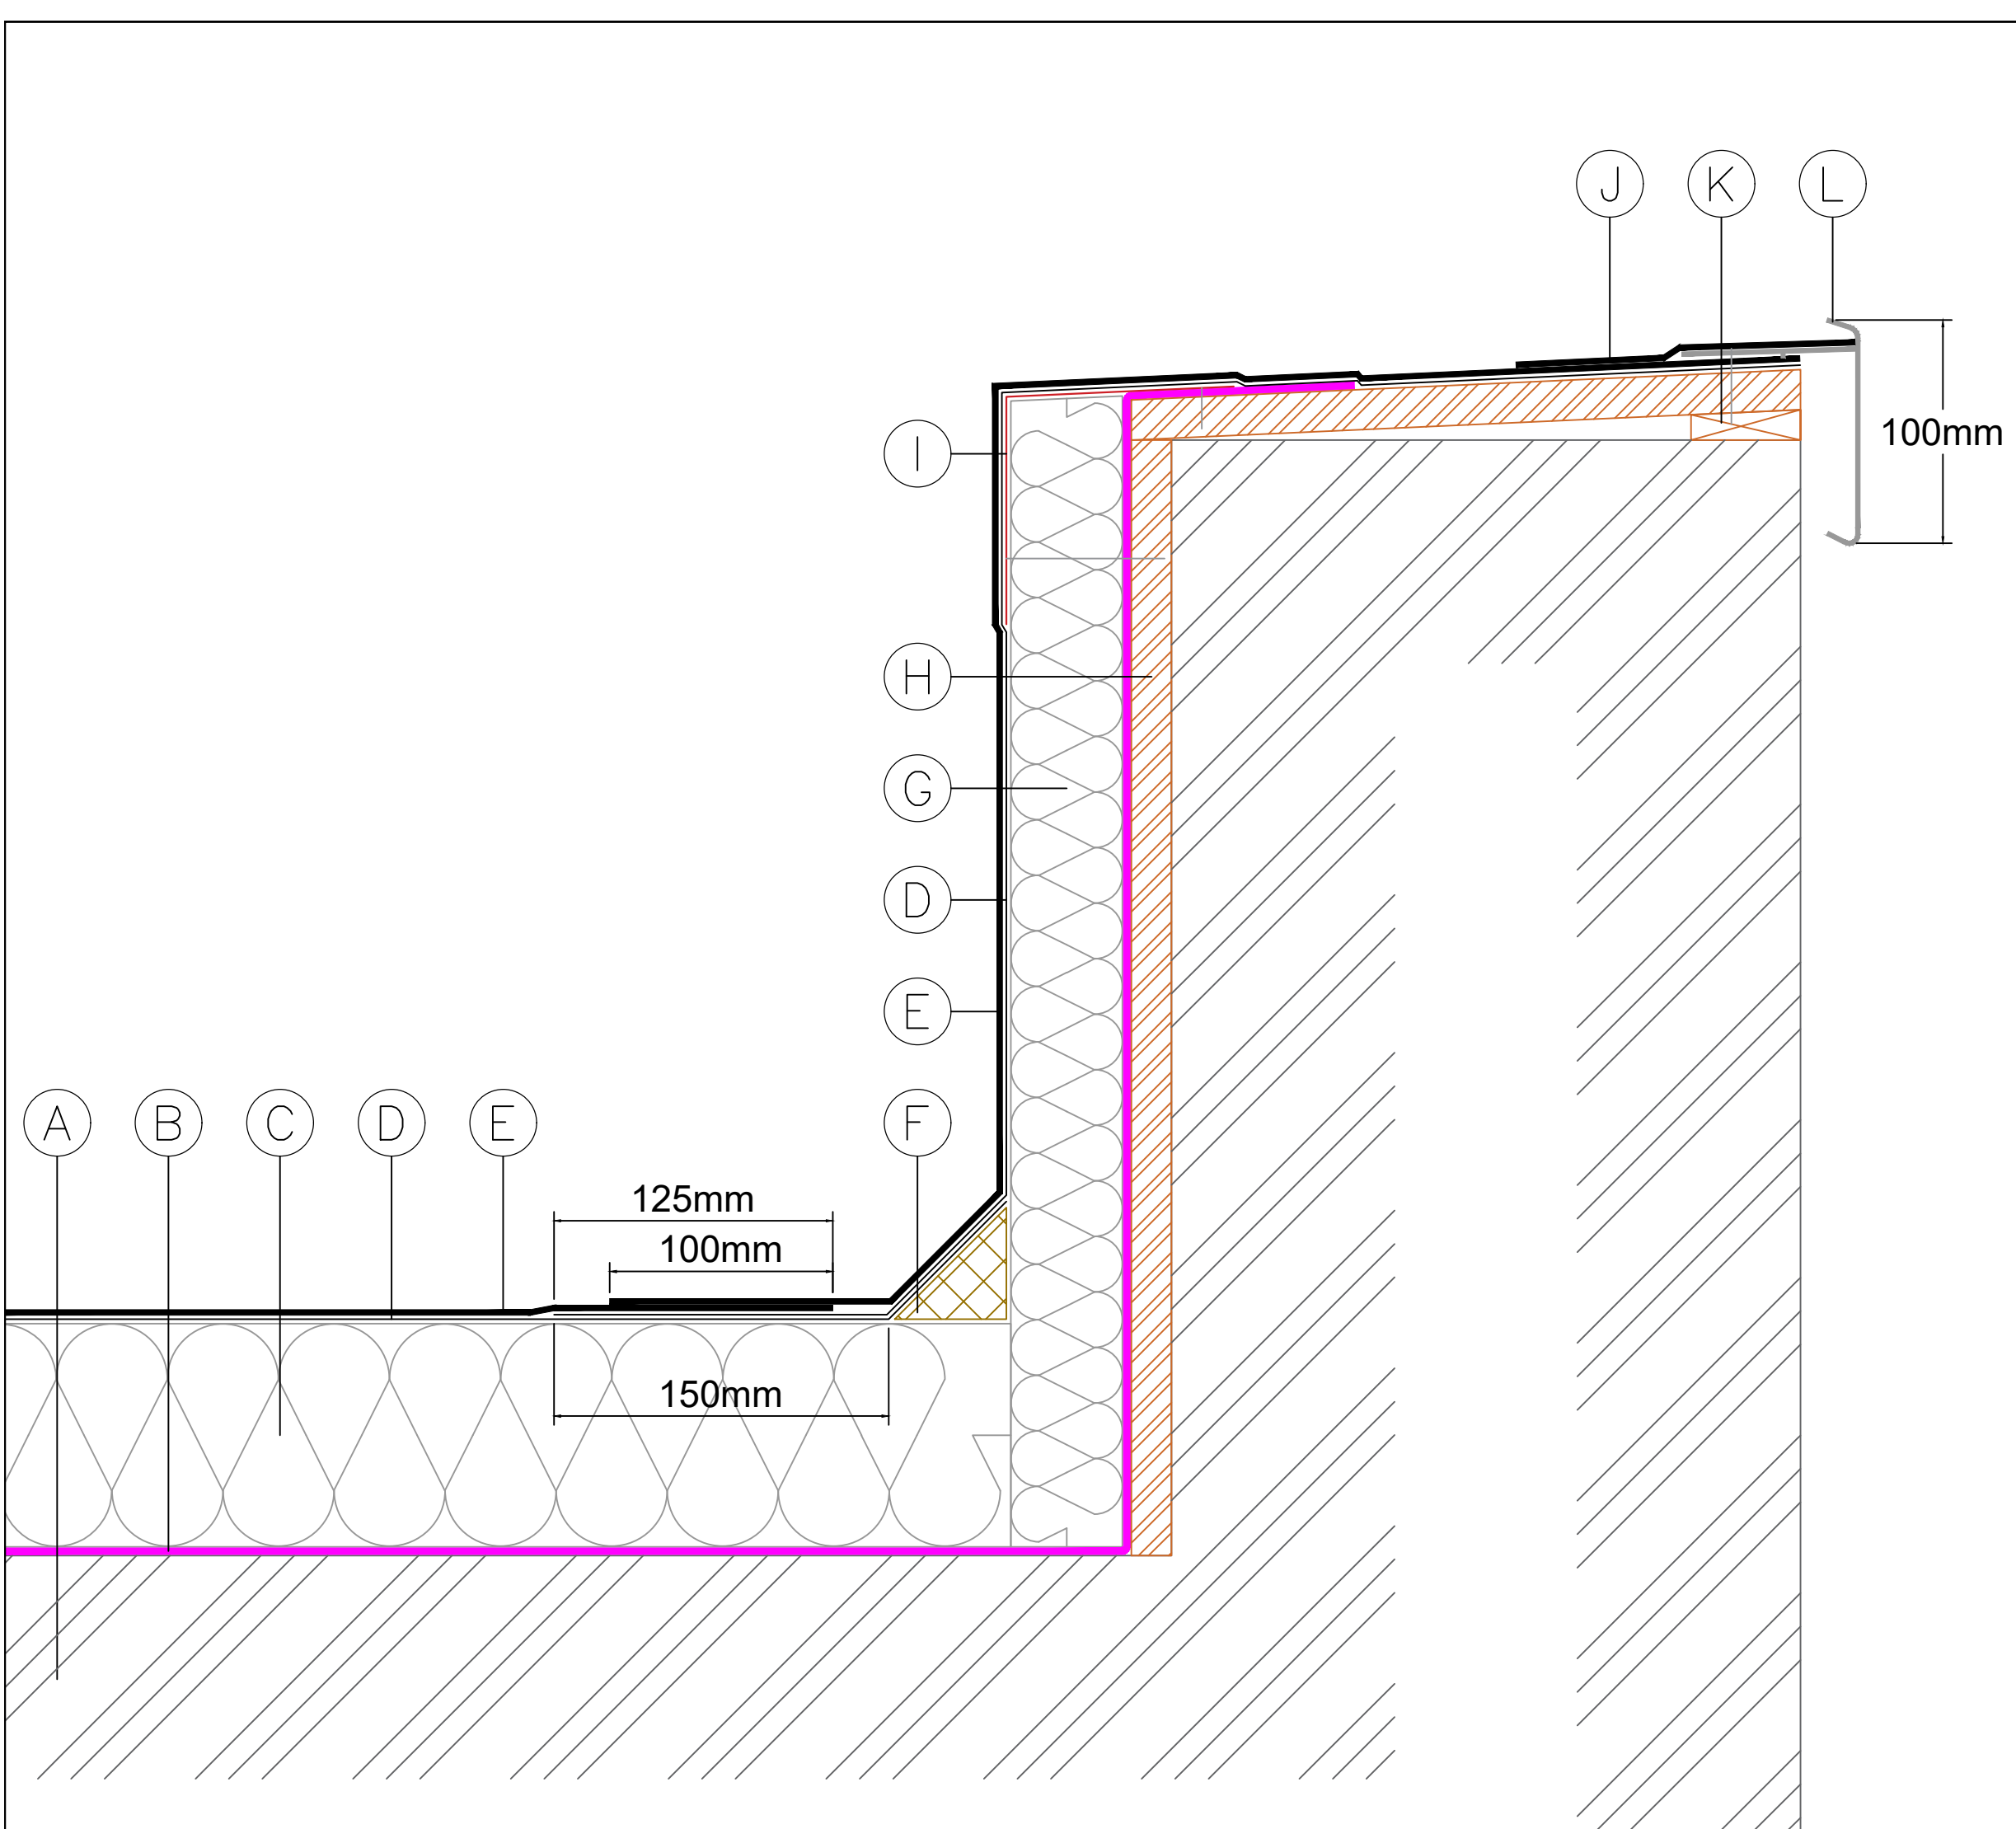

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) 50 x 50mm treated timber angle fillet
- G) Xtratherm FR/BGM rigid PIR insulation (or equal approved), bonded with Fatra FF867 Insulation Adhesive
- H) 18mm Class 3 plywood mech fixed to upstand
- I) 100 x 100mm galv metal hard edge mech fixed
- J) 150mm wide felt torch on cover strap in Fatra FF825
- K) Timber batten to create falls to parapet
- L) 100mm face GRP Paptrim mech fixed at 250mm centres

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE



T 029 2048 7954
F 029 2048 9226

E technical@fatra.co.uk
W www.fatra.co.uk

Insulated Parapet with GRP Trim
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018	SCALE: NTS	DRAWN: MDJ
DRAWING NO: FATRA F2F-02		REVISION: -



All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.


fatra

T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Parapet with GRP Trim
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018	SCALE: NTS	DRAWN: MDJ
----------------------	----------------------	----------------------

DRAWING NO: FATRA F2F-03	REVISION: -
------------------------------------	----------------

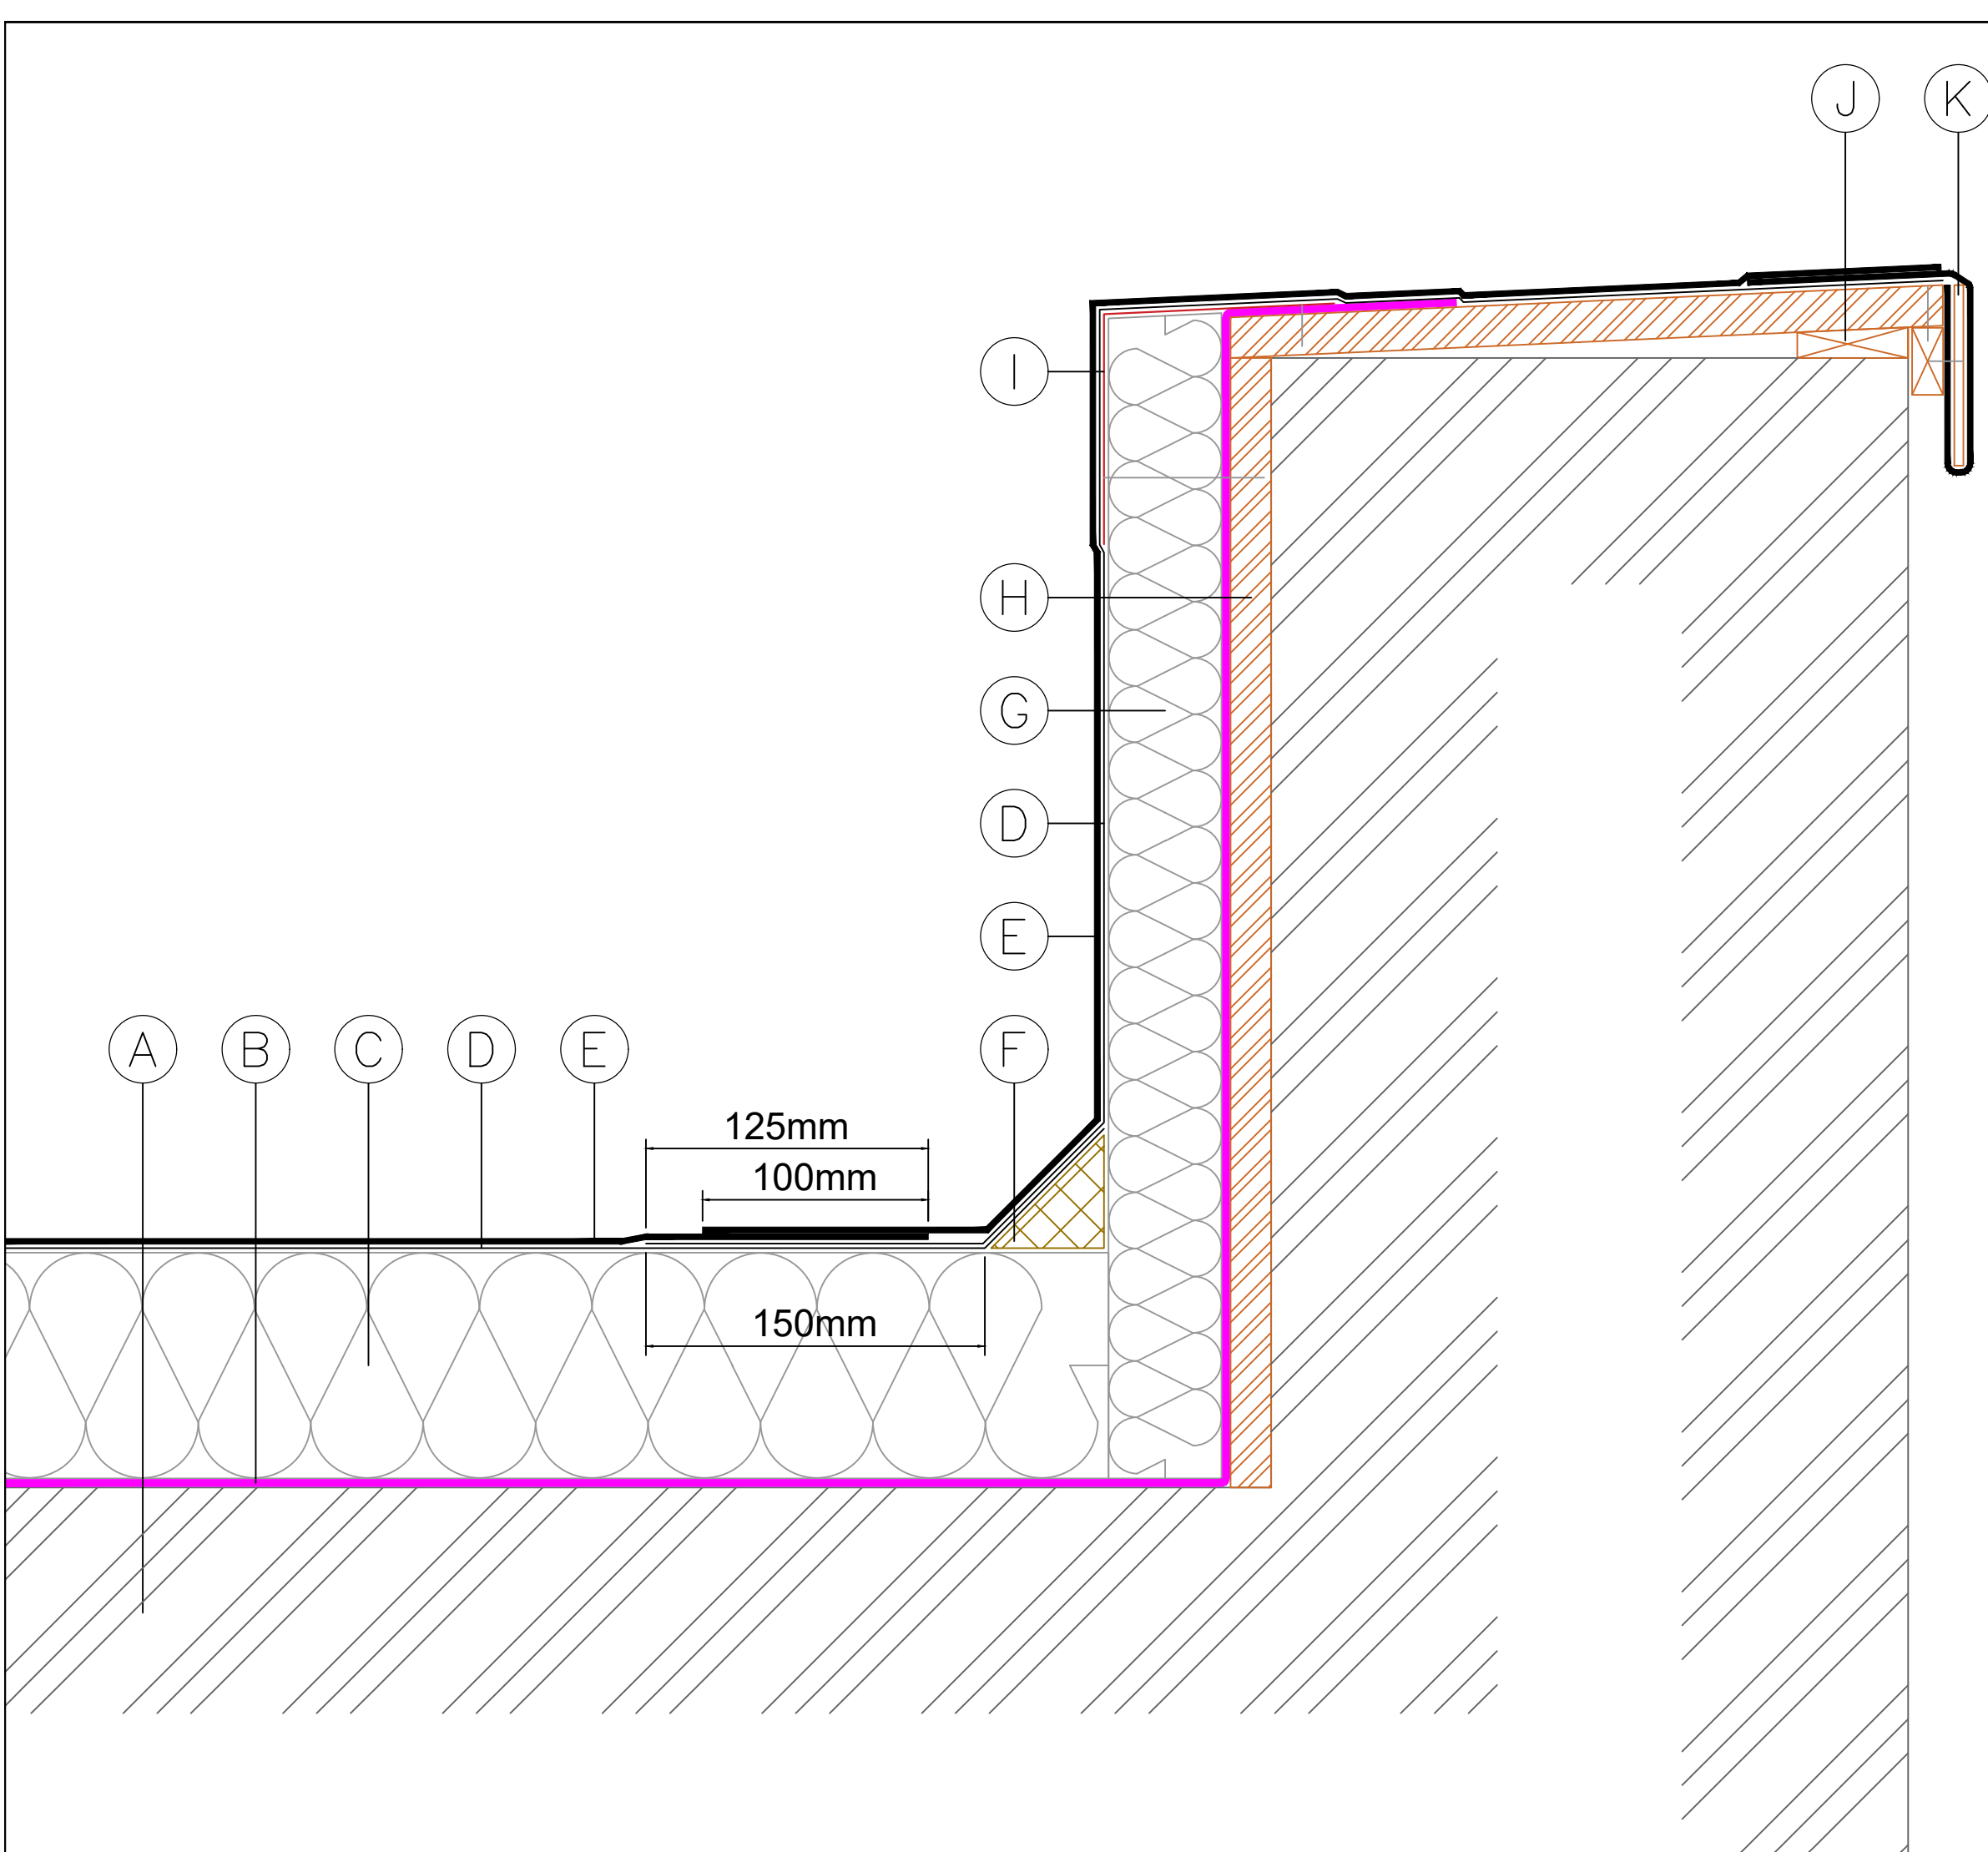

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) 50 x 50mm treated timber angle fillet
- G) Xtratherm FR/BGM rigid PIR insulation (or equal approved), bonded with Fatra FF867 Insulation Adhesive
- H) 18mm Class 3 plywood mech fixed to upstand
- I) 100 x 100mm galv metal hard edge mech fixed
- J) Timber batten to create falls to parapet
- K) Weltded drip in Fatra FF825 formed with 80 x 4mm plywood mech fixed to batten at 150mm centres

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE



T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Insulated Parapet with Weltded Drip
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd


DATE:
2018

SCALE:
NTS

DRAWN:
MDJ

DRAWING NO:
FATRA F2F-04

REVISION:
-

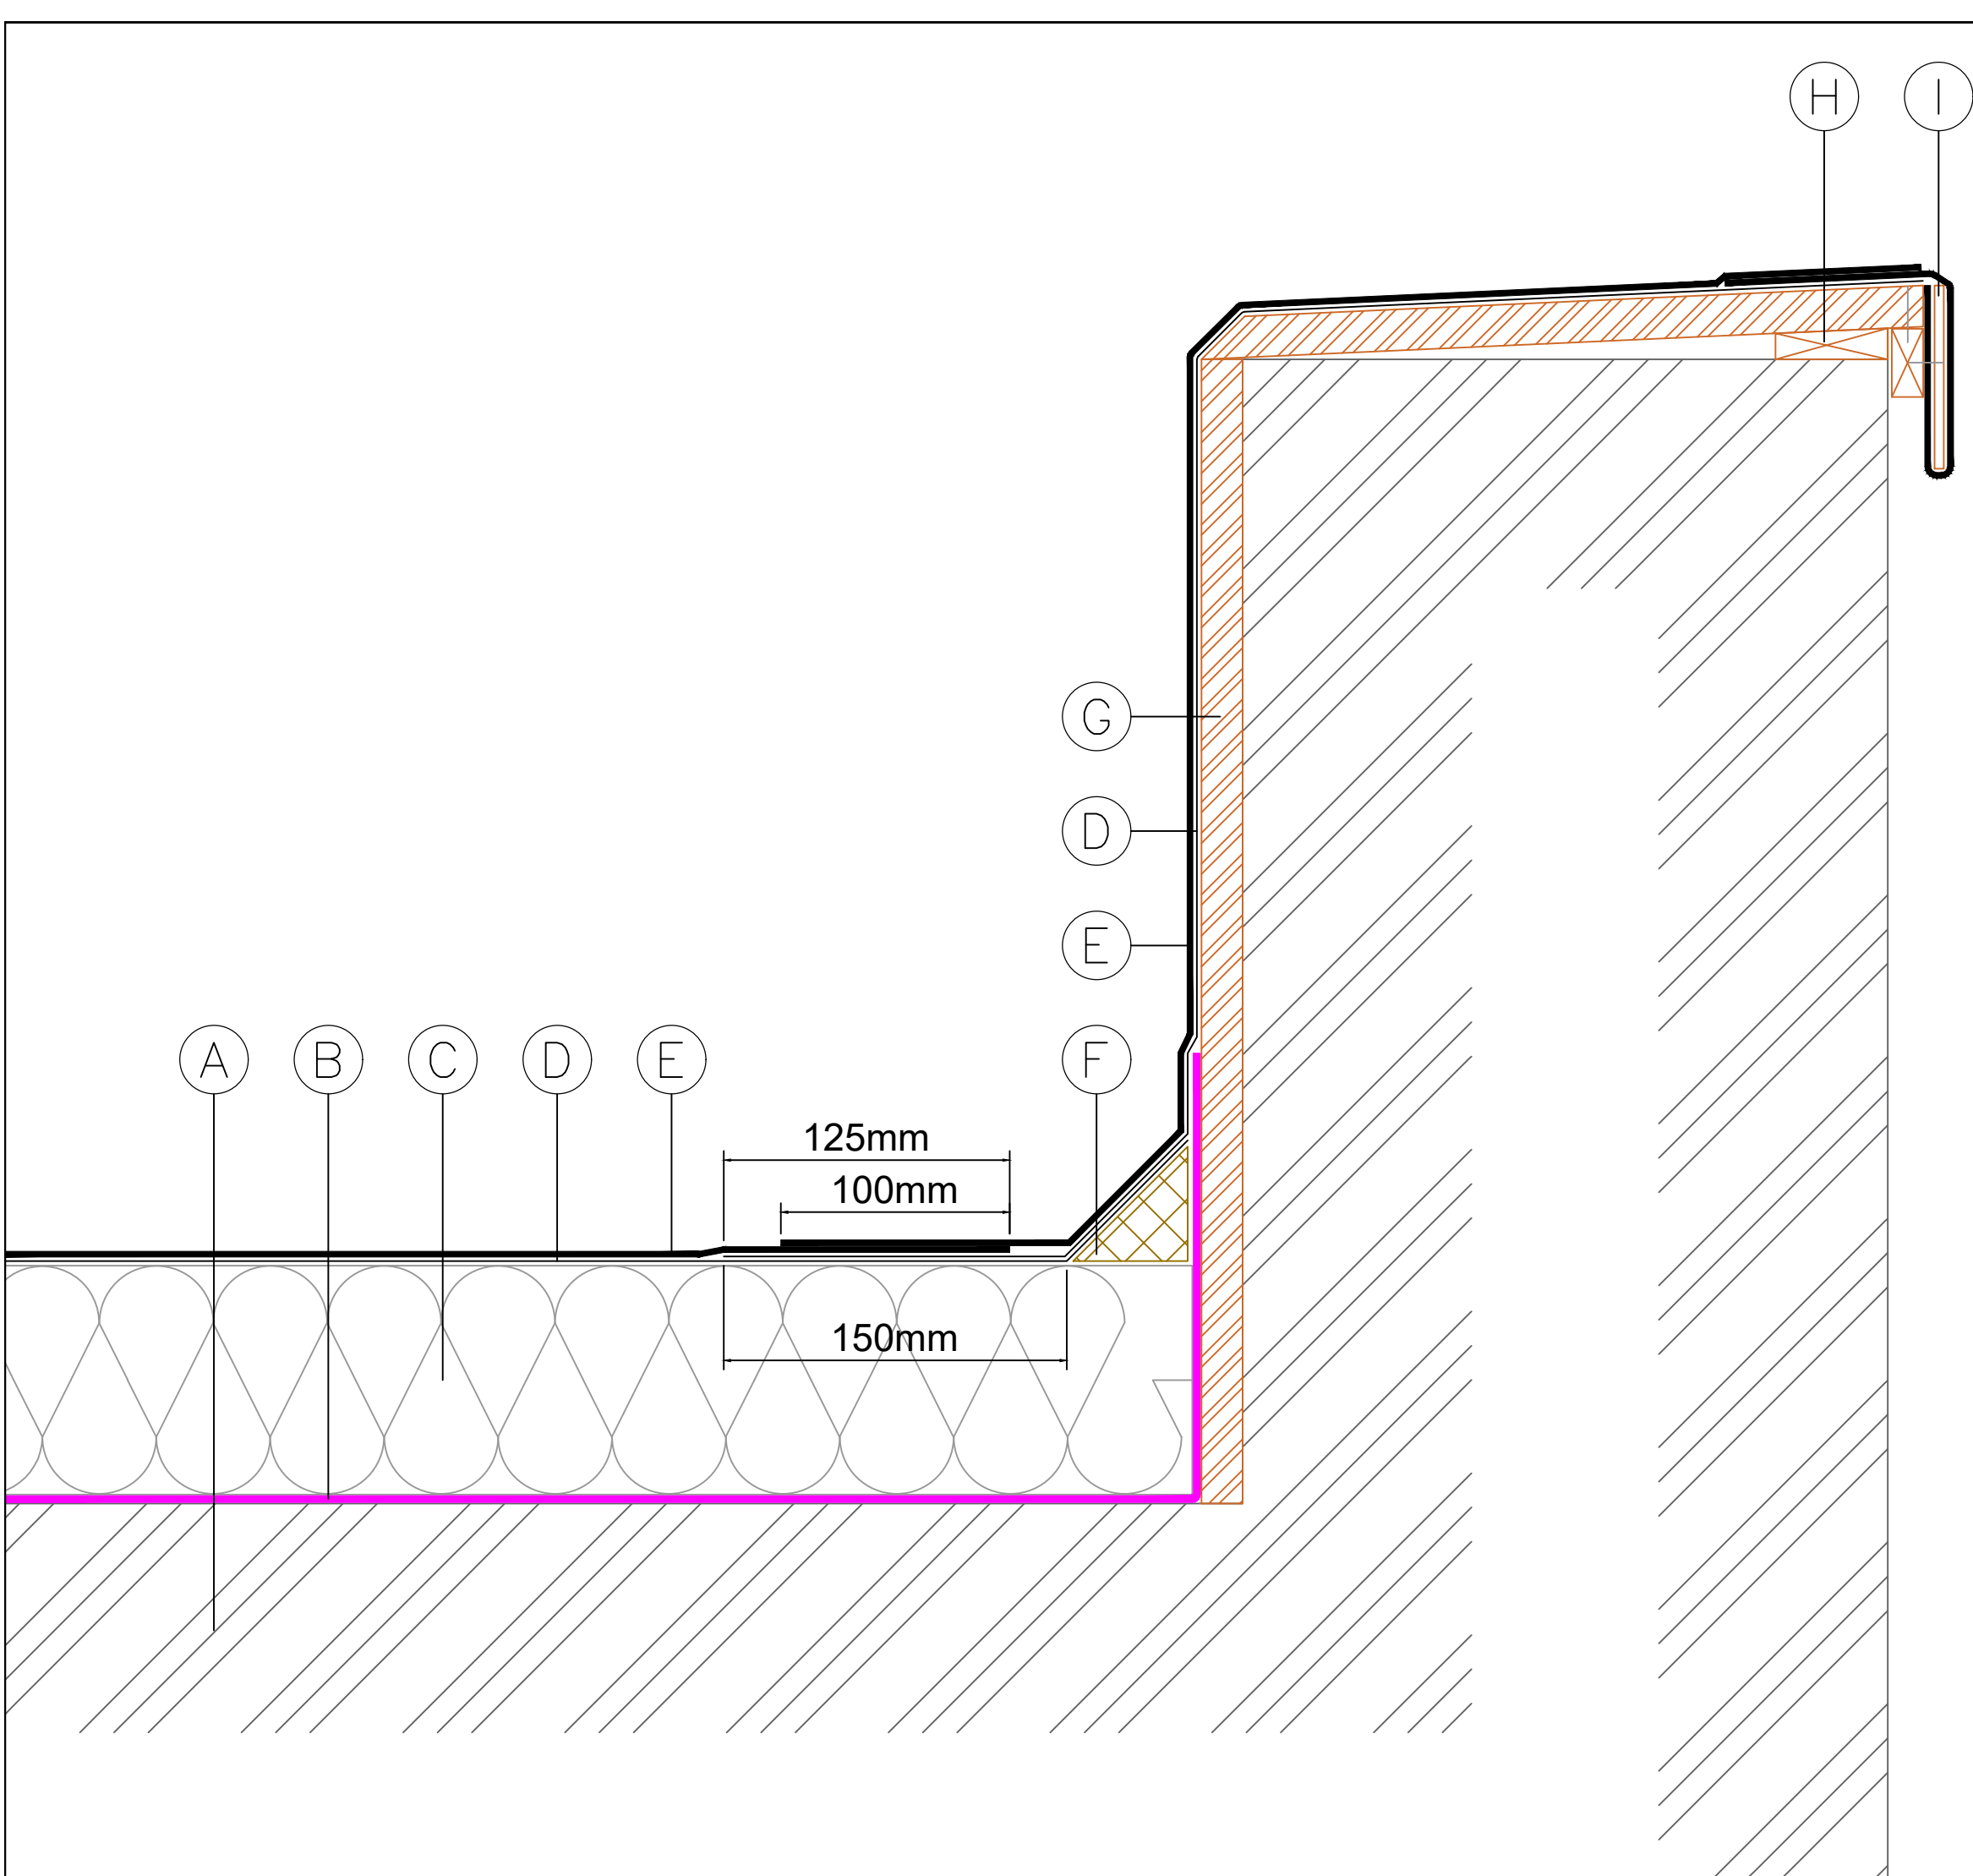

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) 50 x 50mm treated timber angle fillet
- G) 18mm Class 3 plywood mech fixed to upstand
- H) Timber batten to create falls to parapet
- I) Welted drip in Fatra FF825 formed with 80 x 4mm plywood mech fixed to batten at 150mm centres

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE



T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Parapet with Welted Drip
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd


DATE:
2018

SCALE:
NTS

DRAWN:
MDJ

DRAWING NO:
FATRA F2F-05

REVISION:
-

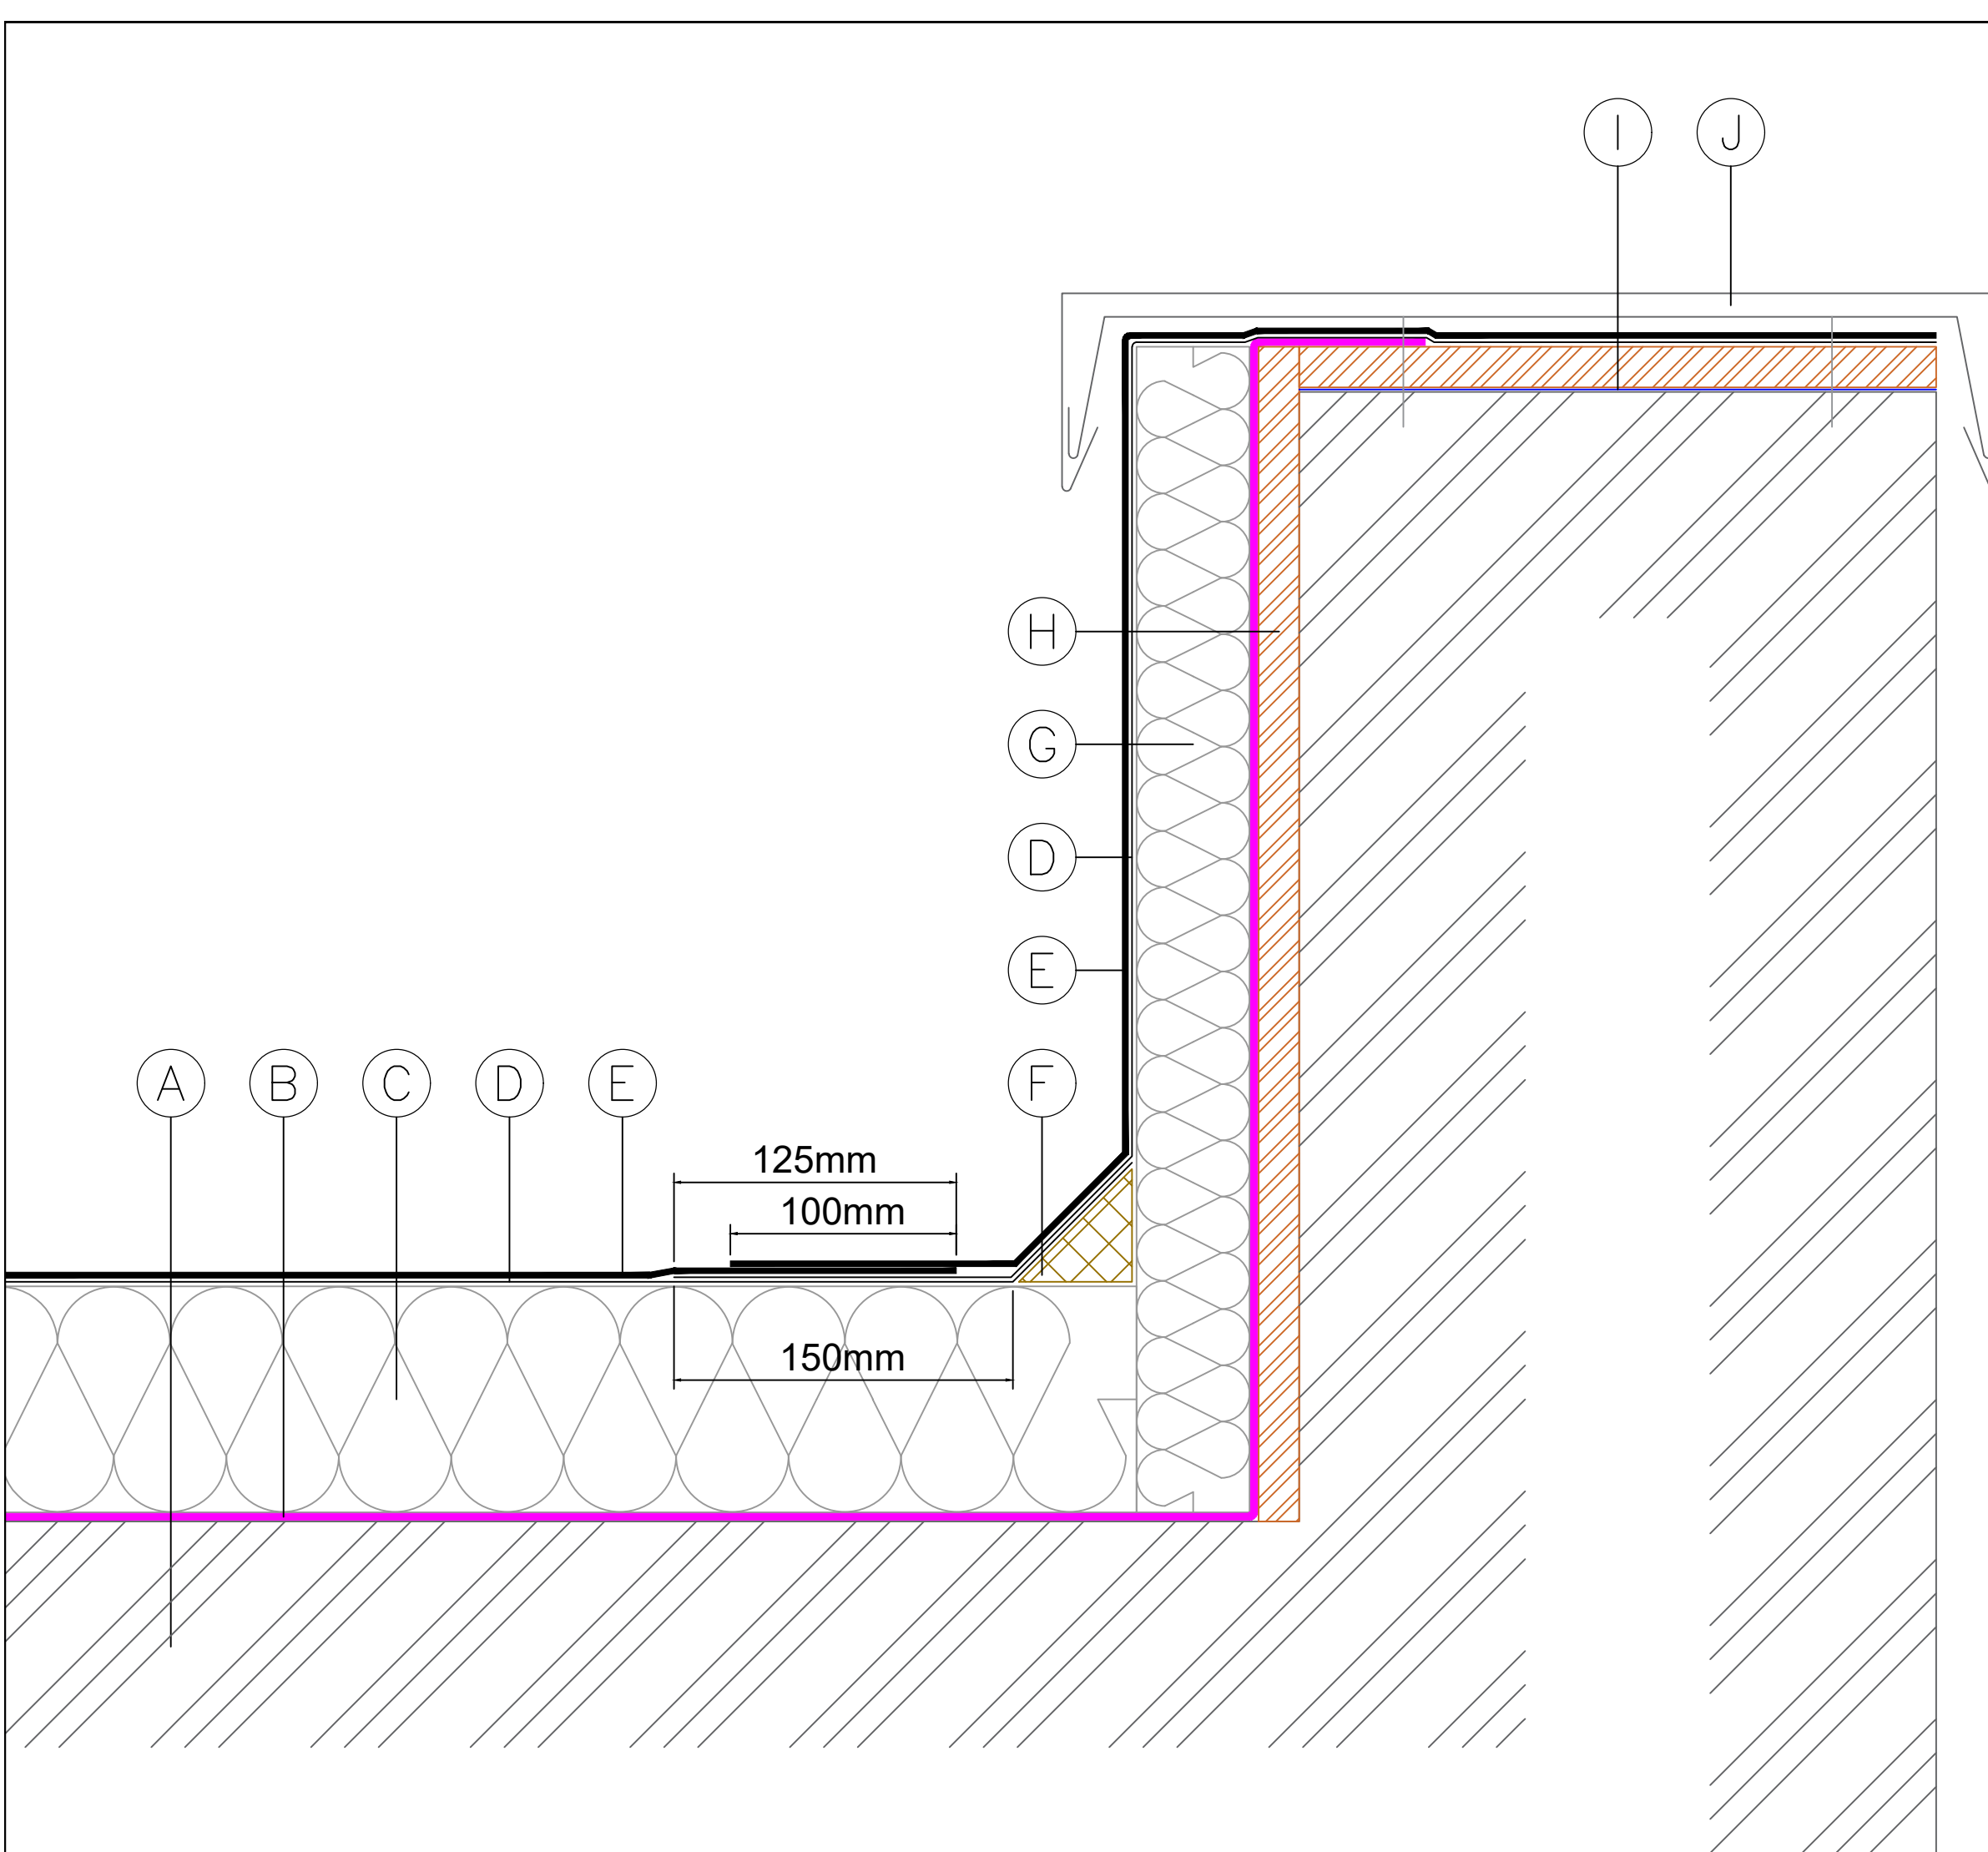

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) 50 x 50mm treated timber angle fillet
- G) Xtratherm FR/BGM rigid PIR insulation (or equal approved), bonded with Fatra FF867 Insulation Adhesive
- H) 18mm Class 3 plywood mech fixed to upstand
- I) Damp Proof Course loose laid under plywood
- J) Proprietary Capping System

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE



T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Insulated Parapet with Capping
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE:

2018

SCALE:

NTS

DRAWN:


MDJ

DRAWING NO:

FATRA F2F-06

REVISION:

-

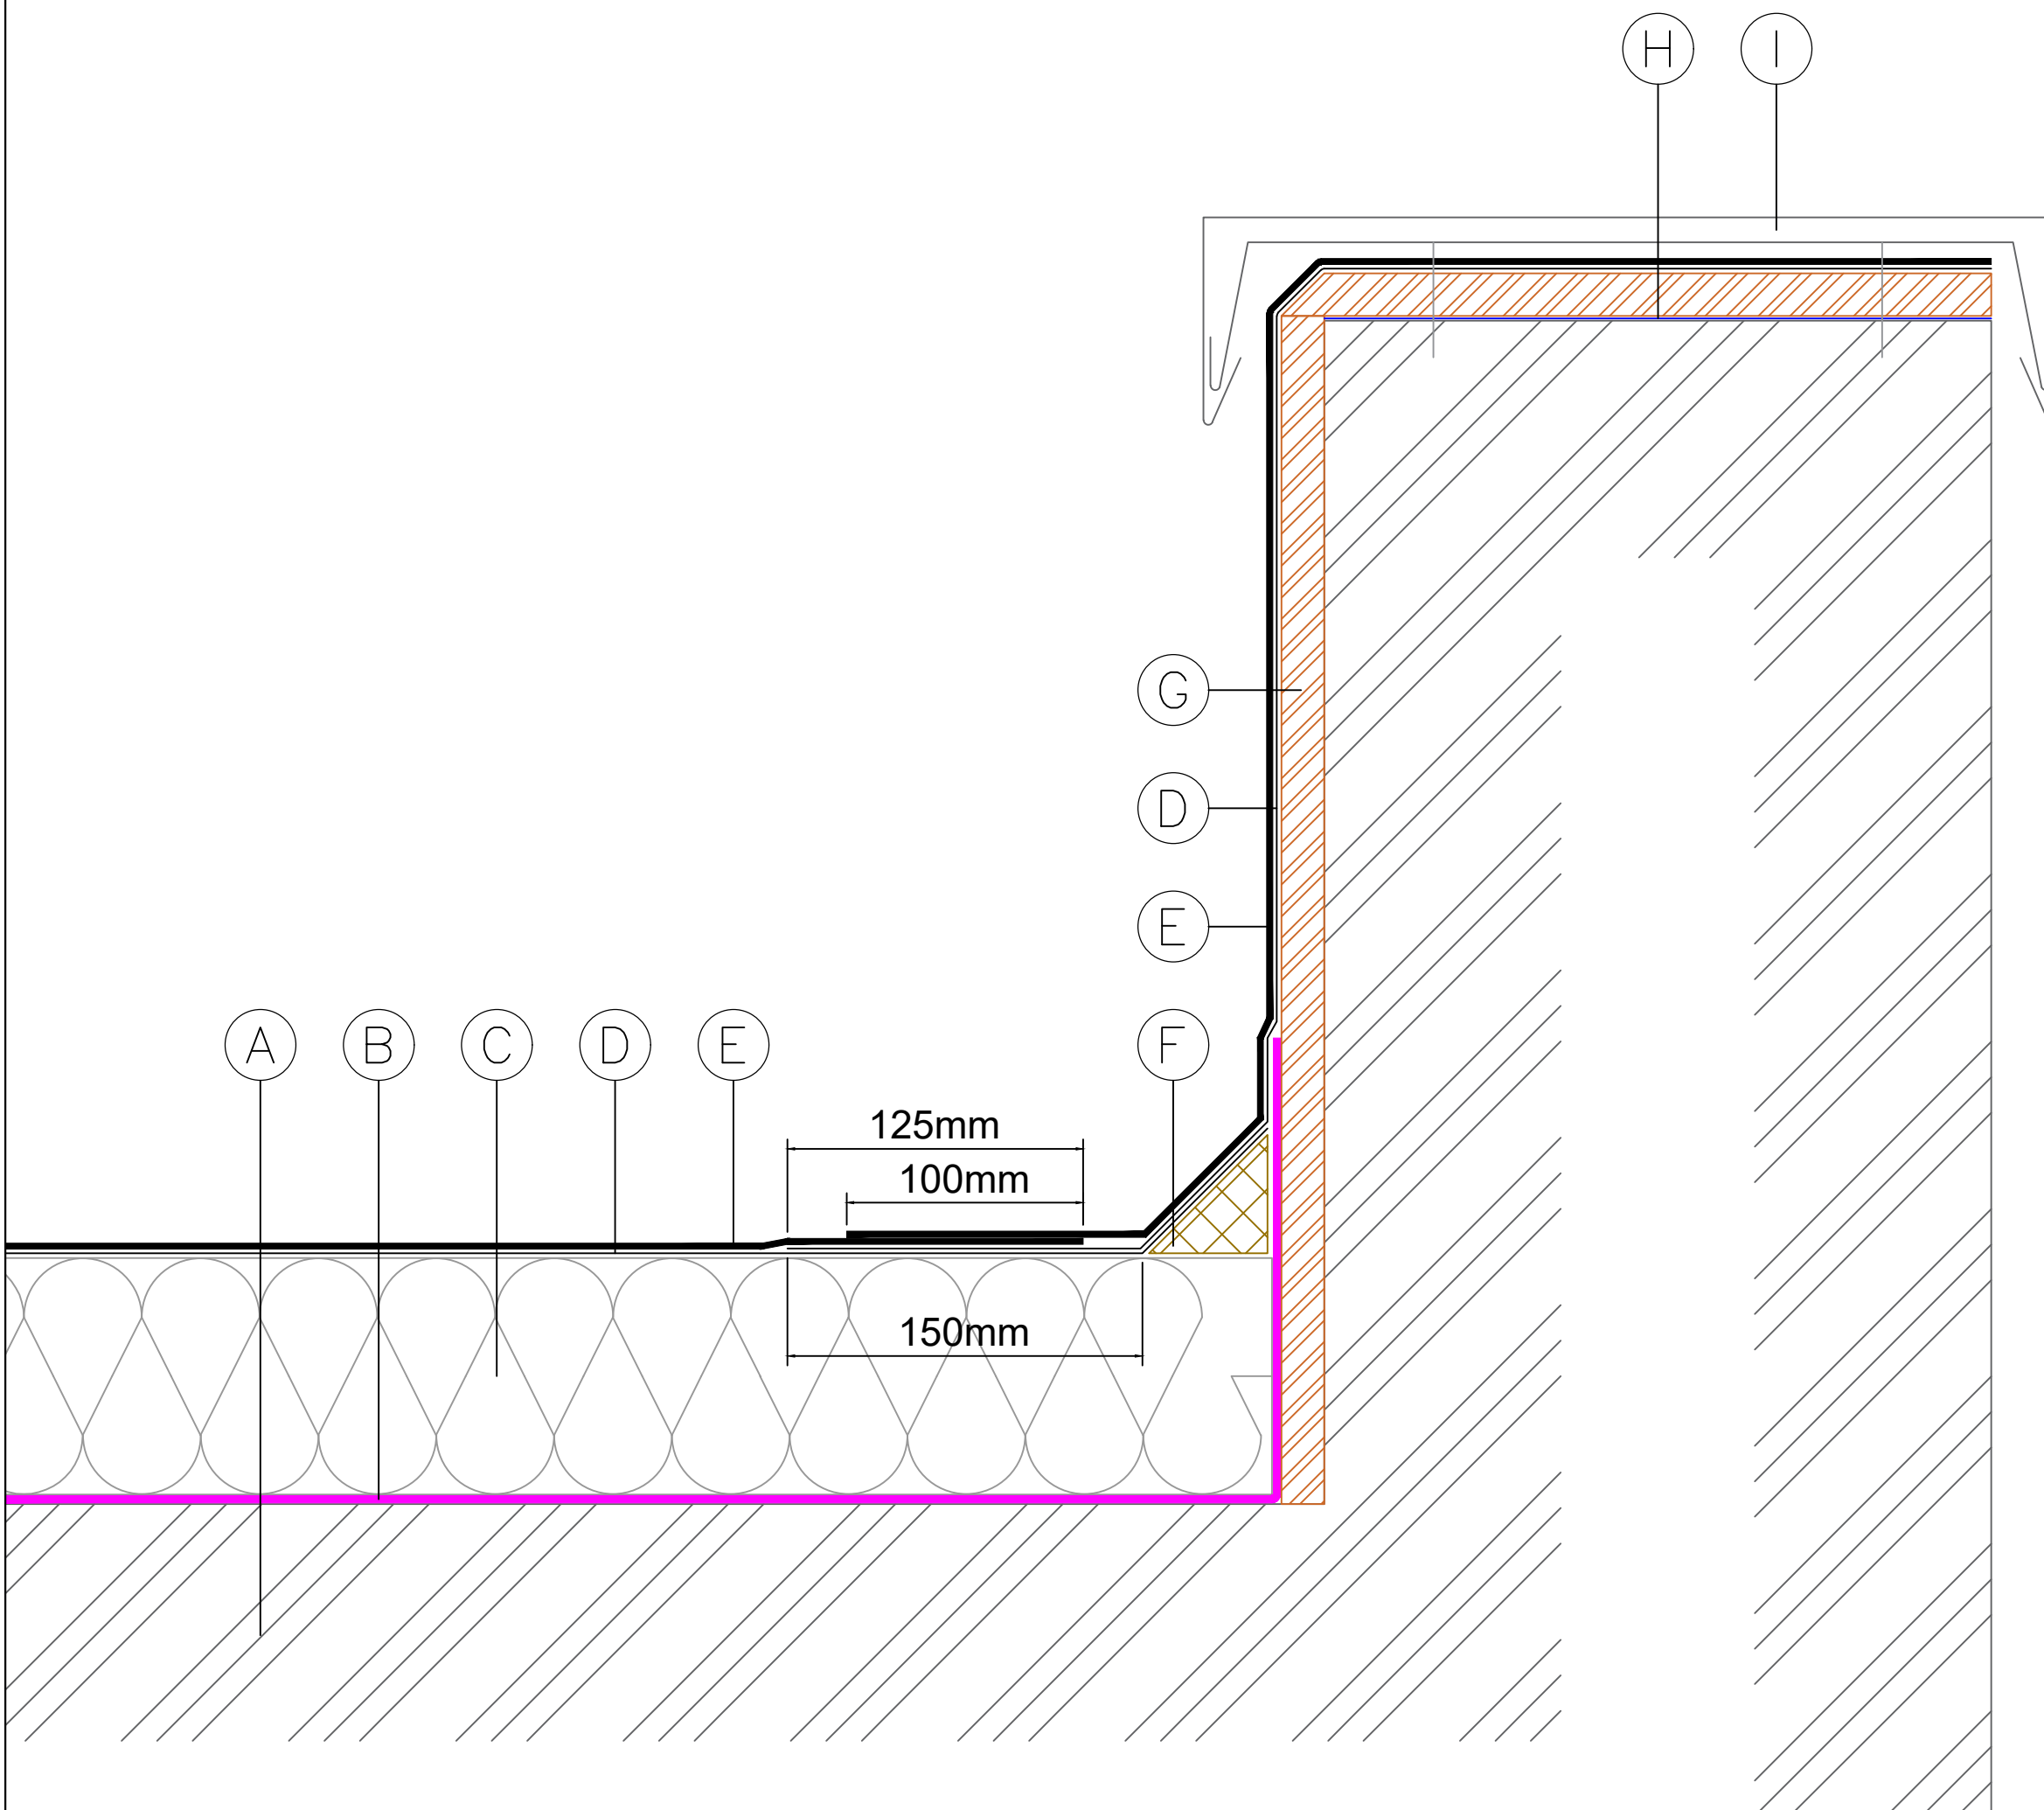

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
F) 50 x 50mm treated timber angle fillet
G) 18mm Class 3 plywood mech fixed to upstand
H) Damp Proof Course loose laid under plywood
I) Proprietary Capping System

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE

fatra

T 029 2048 7954
F 029 2048 9226

E technical@fatra.co.uk
W www.fatra.co.uk

Parapet with Capping
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd


DATE:
2018

SCALE:
NTS

DRAWN:
MDJ

DRAWING NO:
FATRA F2F-07

REVISION:
-

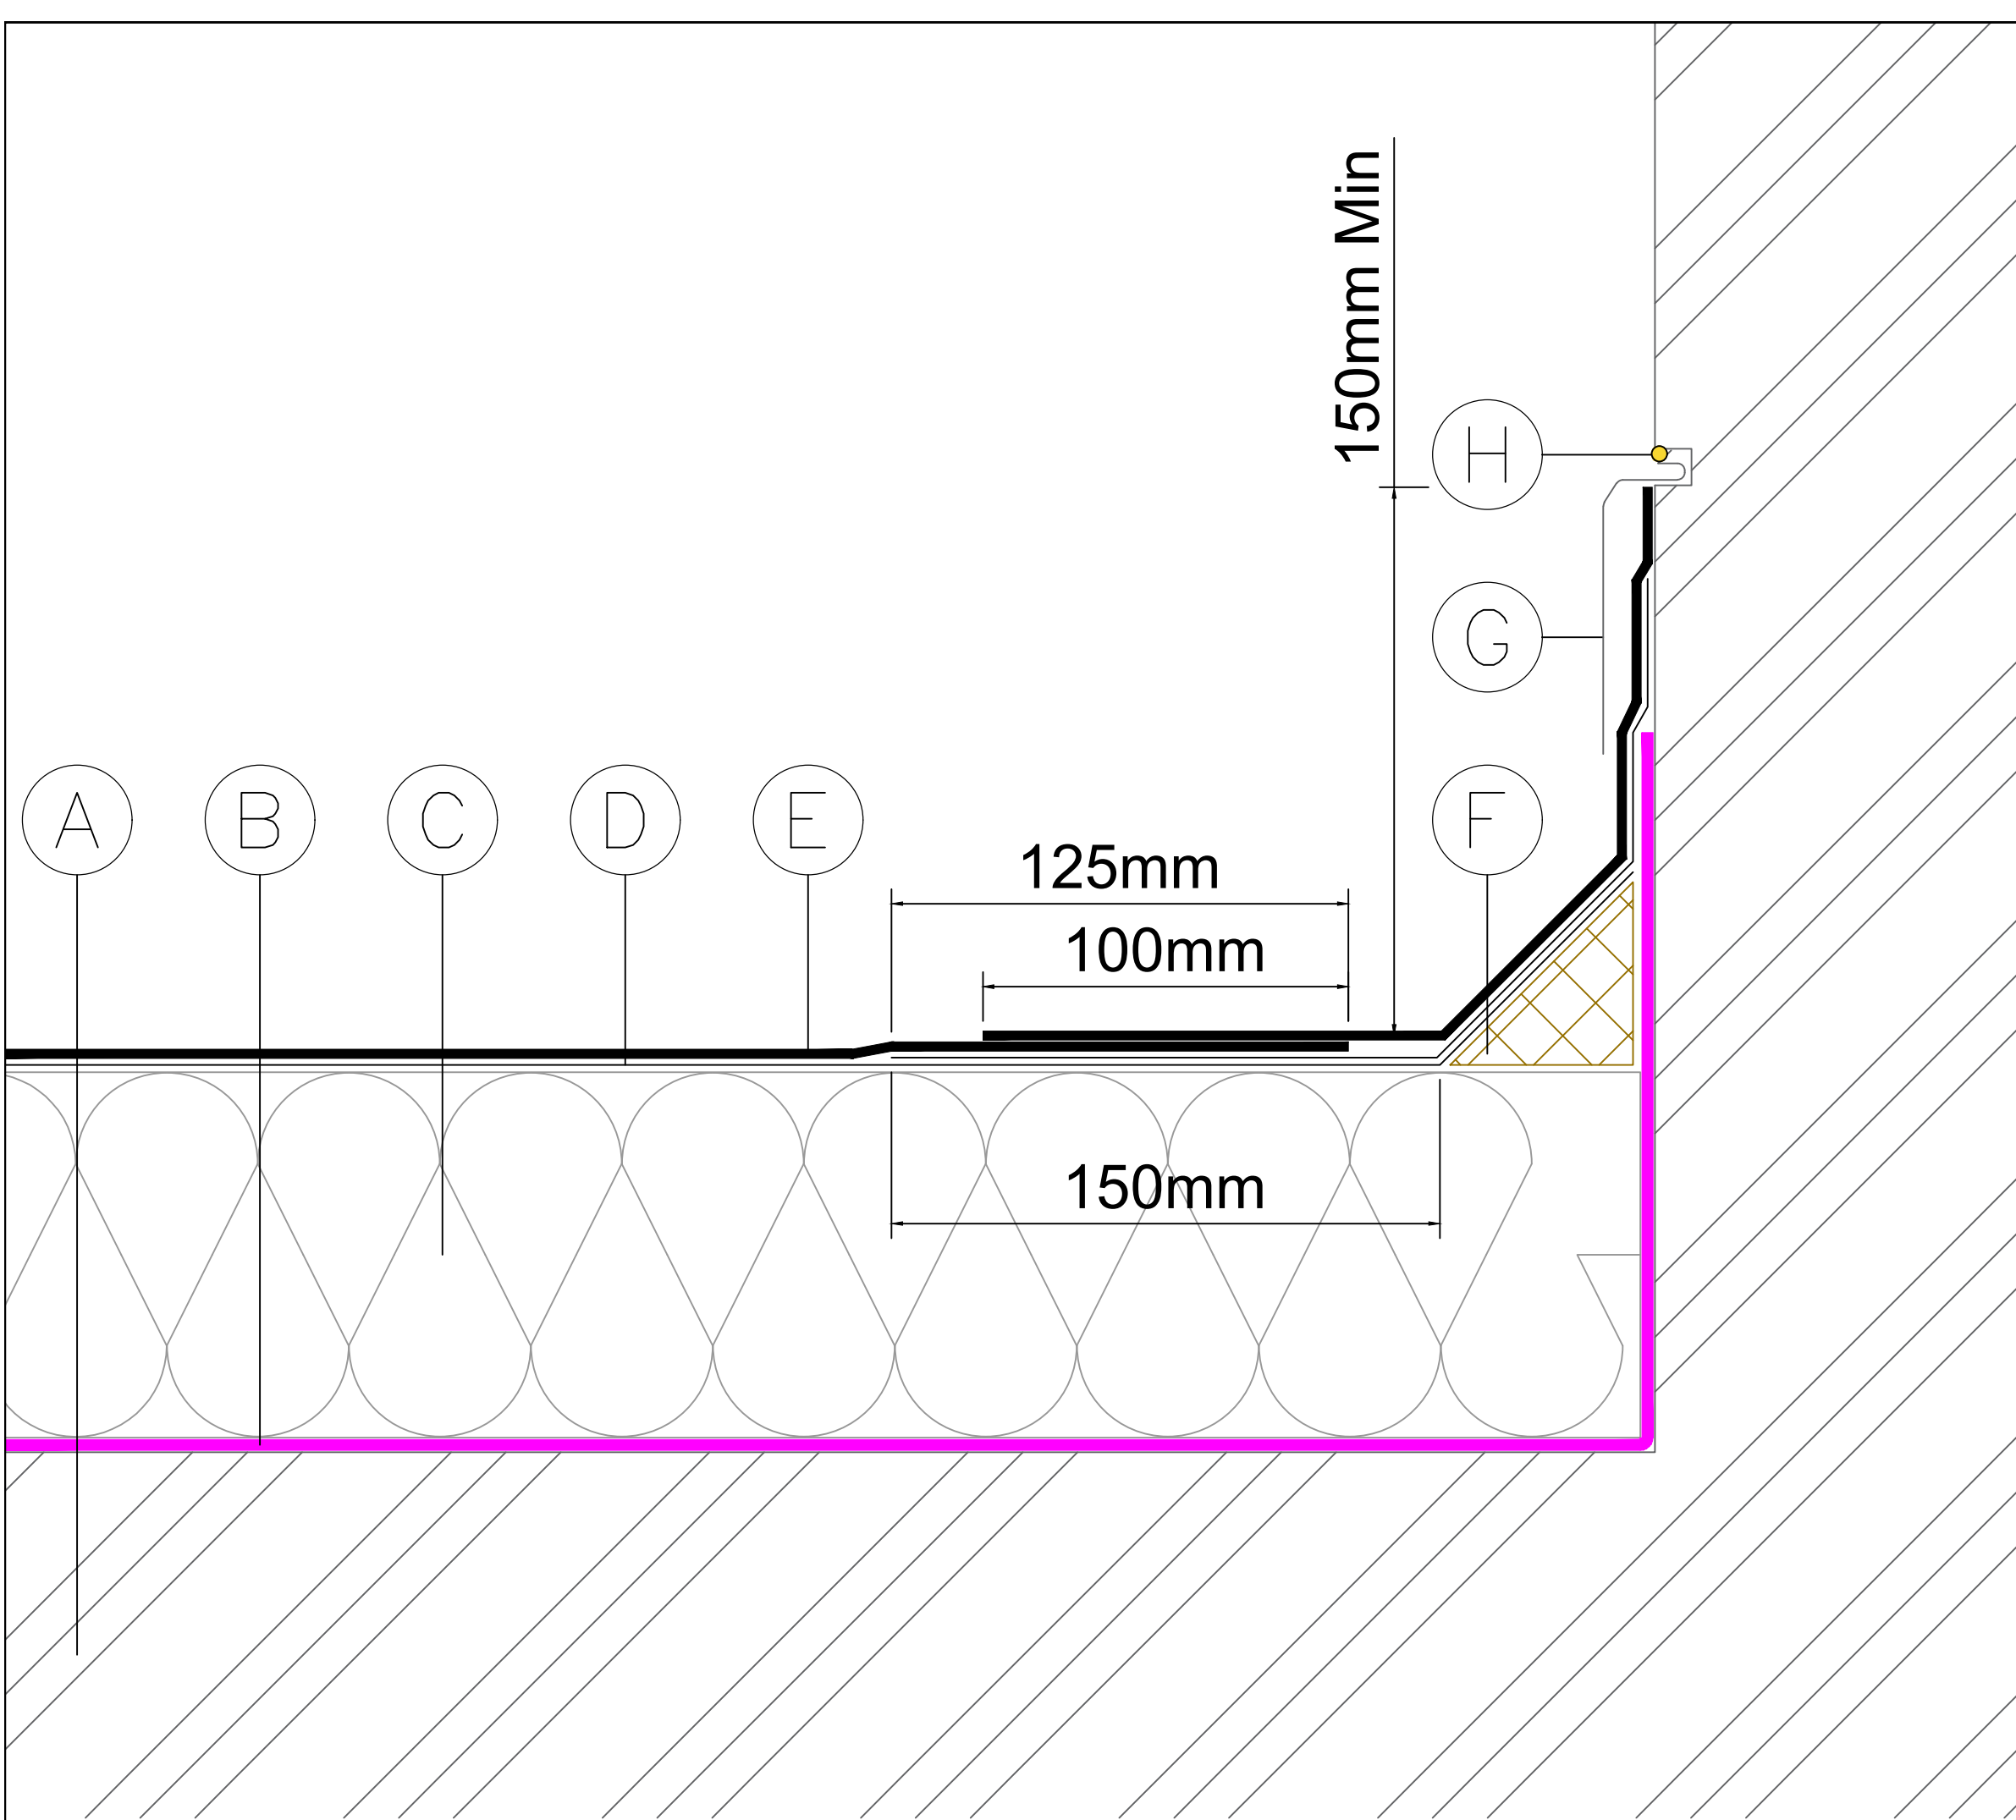

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) 50 x 50mm treated timber angle fillet
- G) Code 3 lead flashing with minimum 75mm coverage
- H) Fatra FF857 Silicone Sealant

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE



T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Upstand with Cover Flashing
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd


DATE:
2018

SCALE:
NTS

DRAWN:
MDJ

DRAWING NO:
FATRA F2F-08

REVISION:
-

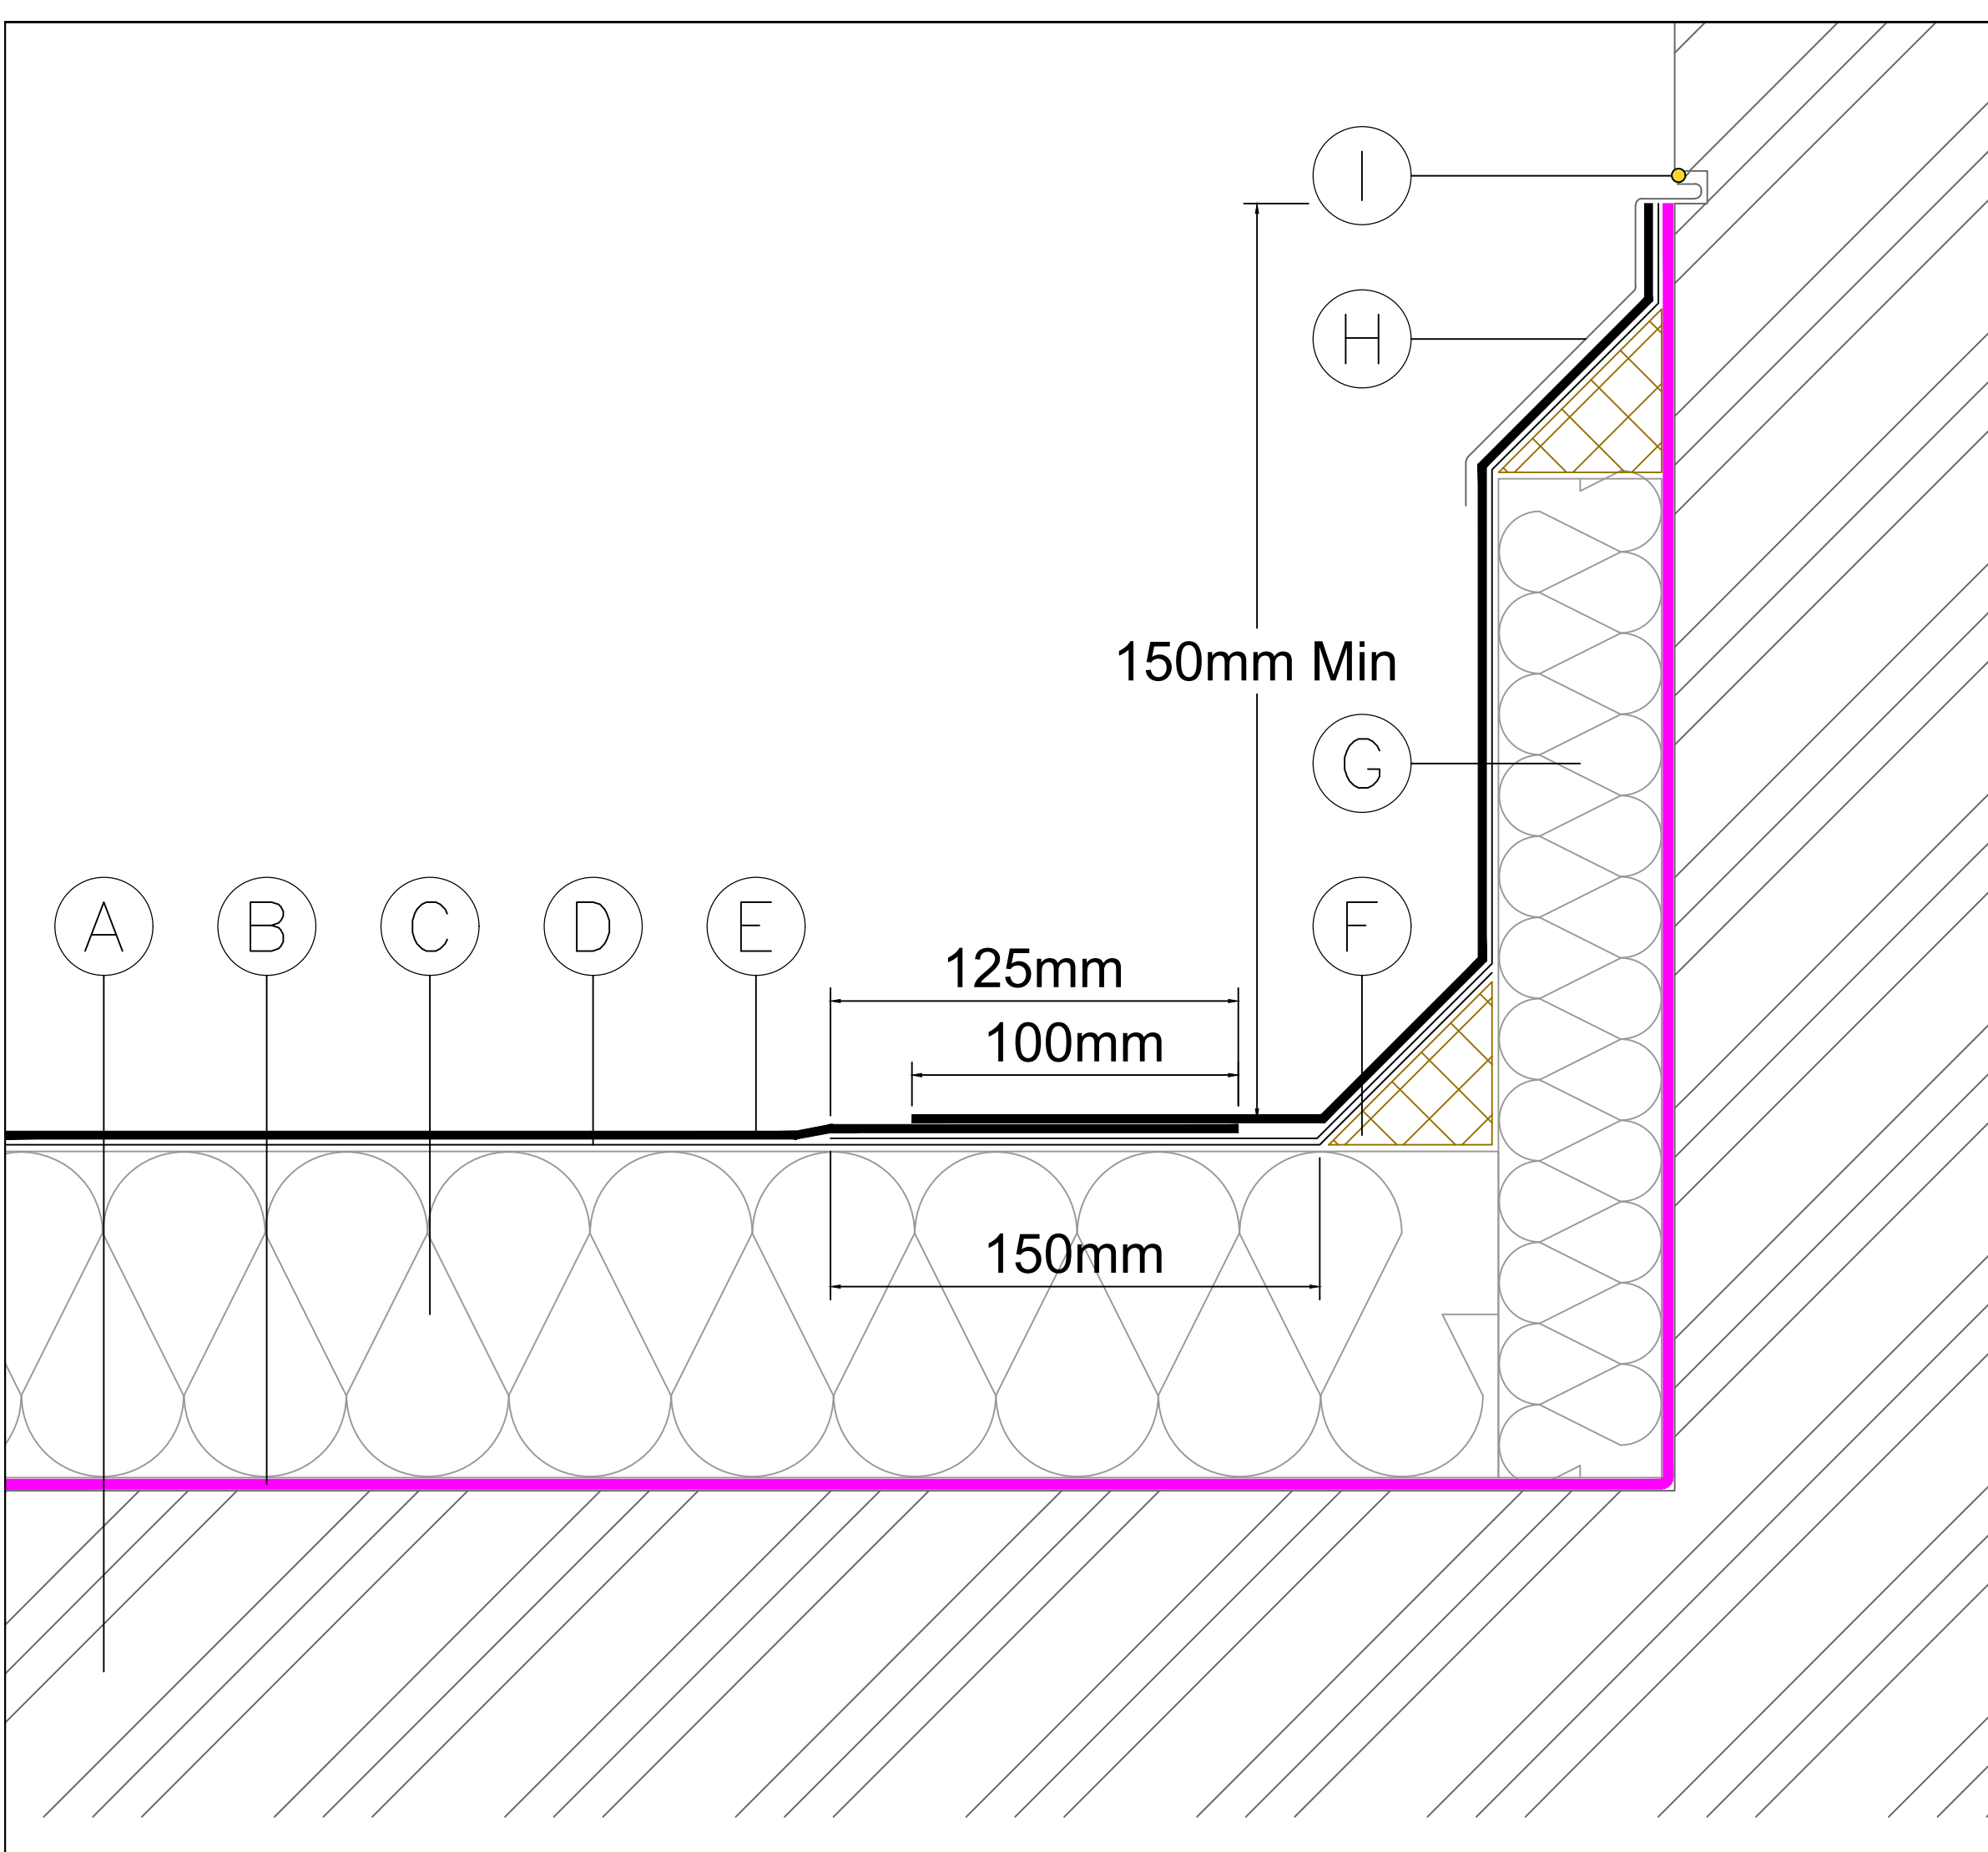

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) 50 x 50mm treated timber angle fillet
- G) Xtratherm FR/BGM rigid PIR insulation (or equal approved), bonded with Fatra FF867 Insulation Adhesive
- H) Code 3 lead flashing with minimum 75mm coverage
- I) Fatra FF857 Silicone Sealant

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE




T 029 2048 7954
F 029 2048 9226

E technical@fatra.co.uk
W www.fatra.co.uk

Insulated Upstand with Cover Flashing
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018	SCALE: NTS	DRAWN: MDJ
DRAWING NO: FATRA F2F-09		REVISION: -

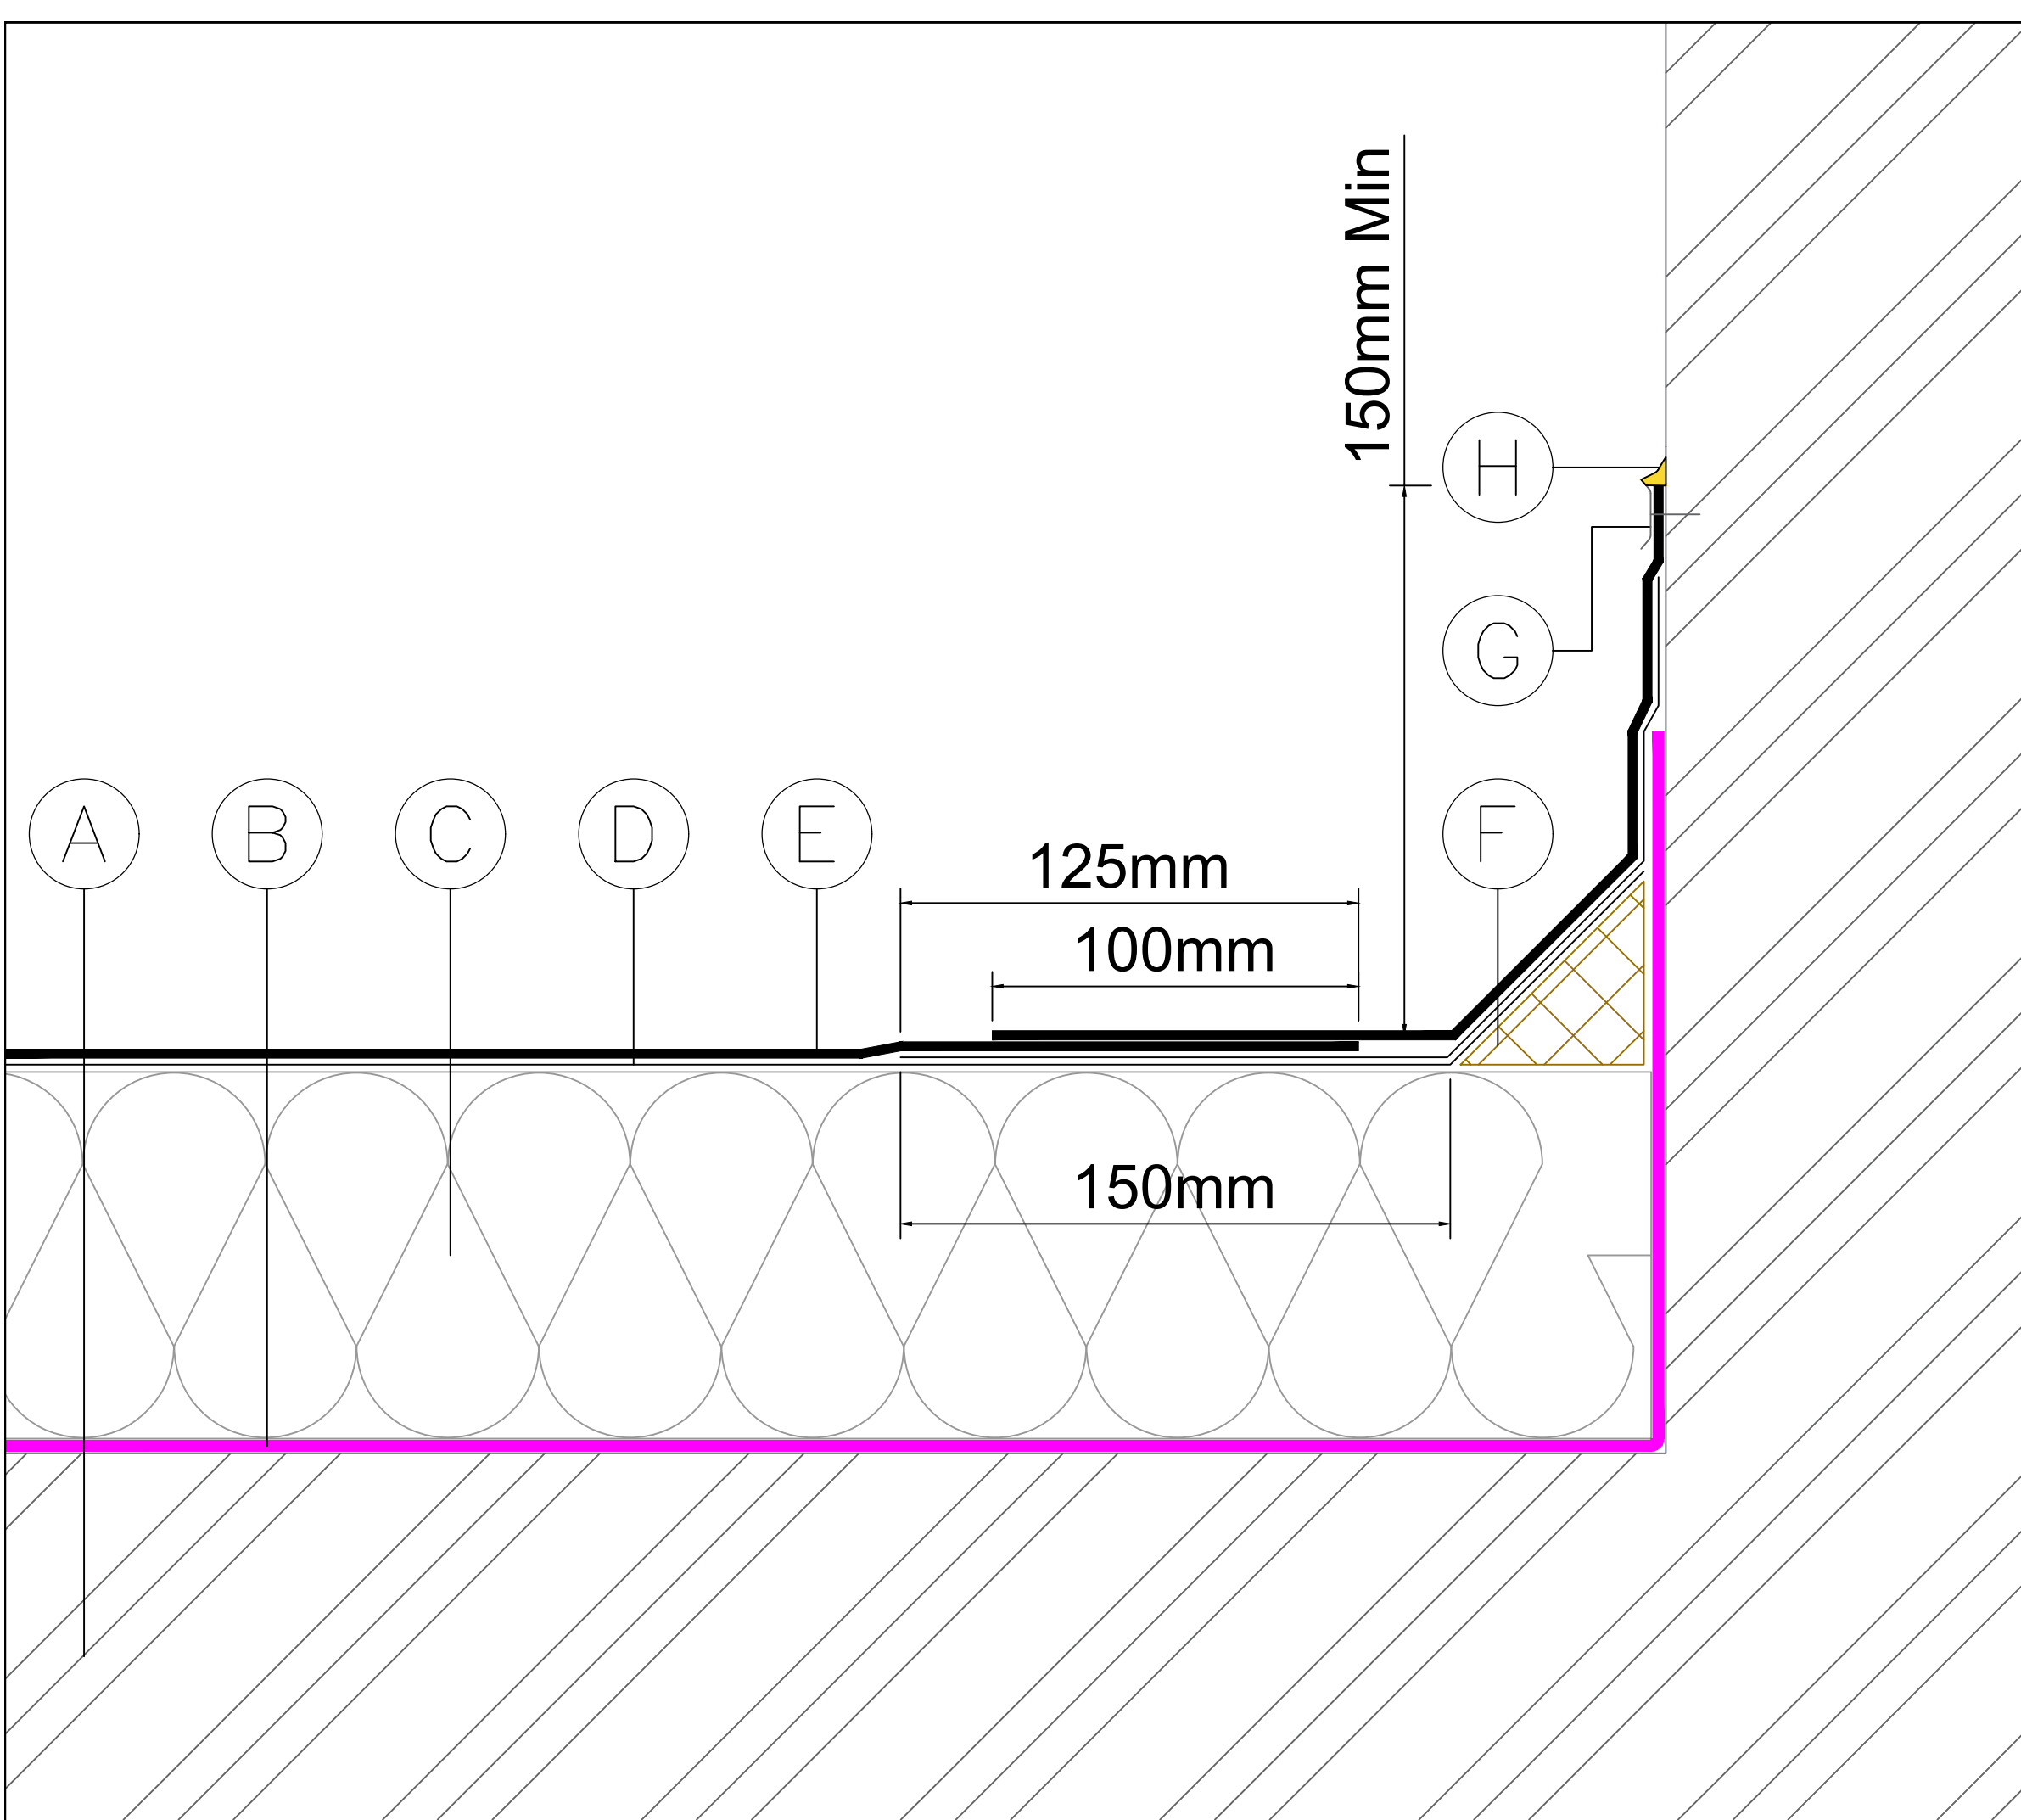

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) 50 x 50mm treated timber angle fillet
- G) GRP termination bar mech fixed at 250mm centres
- H) Fatra FF857 Silicone Sealant

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE




T 029 2048 7954
F 029 2048 9226

E technical@fatra.co.uk
W www.fatra.co.uk

Upstand with Termination Bar
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018	SCALE: NTS	DRAWN: MDJ
DRAWING NO: FATRA F2F-10		REVISION: -

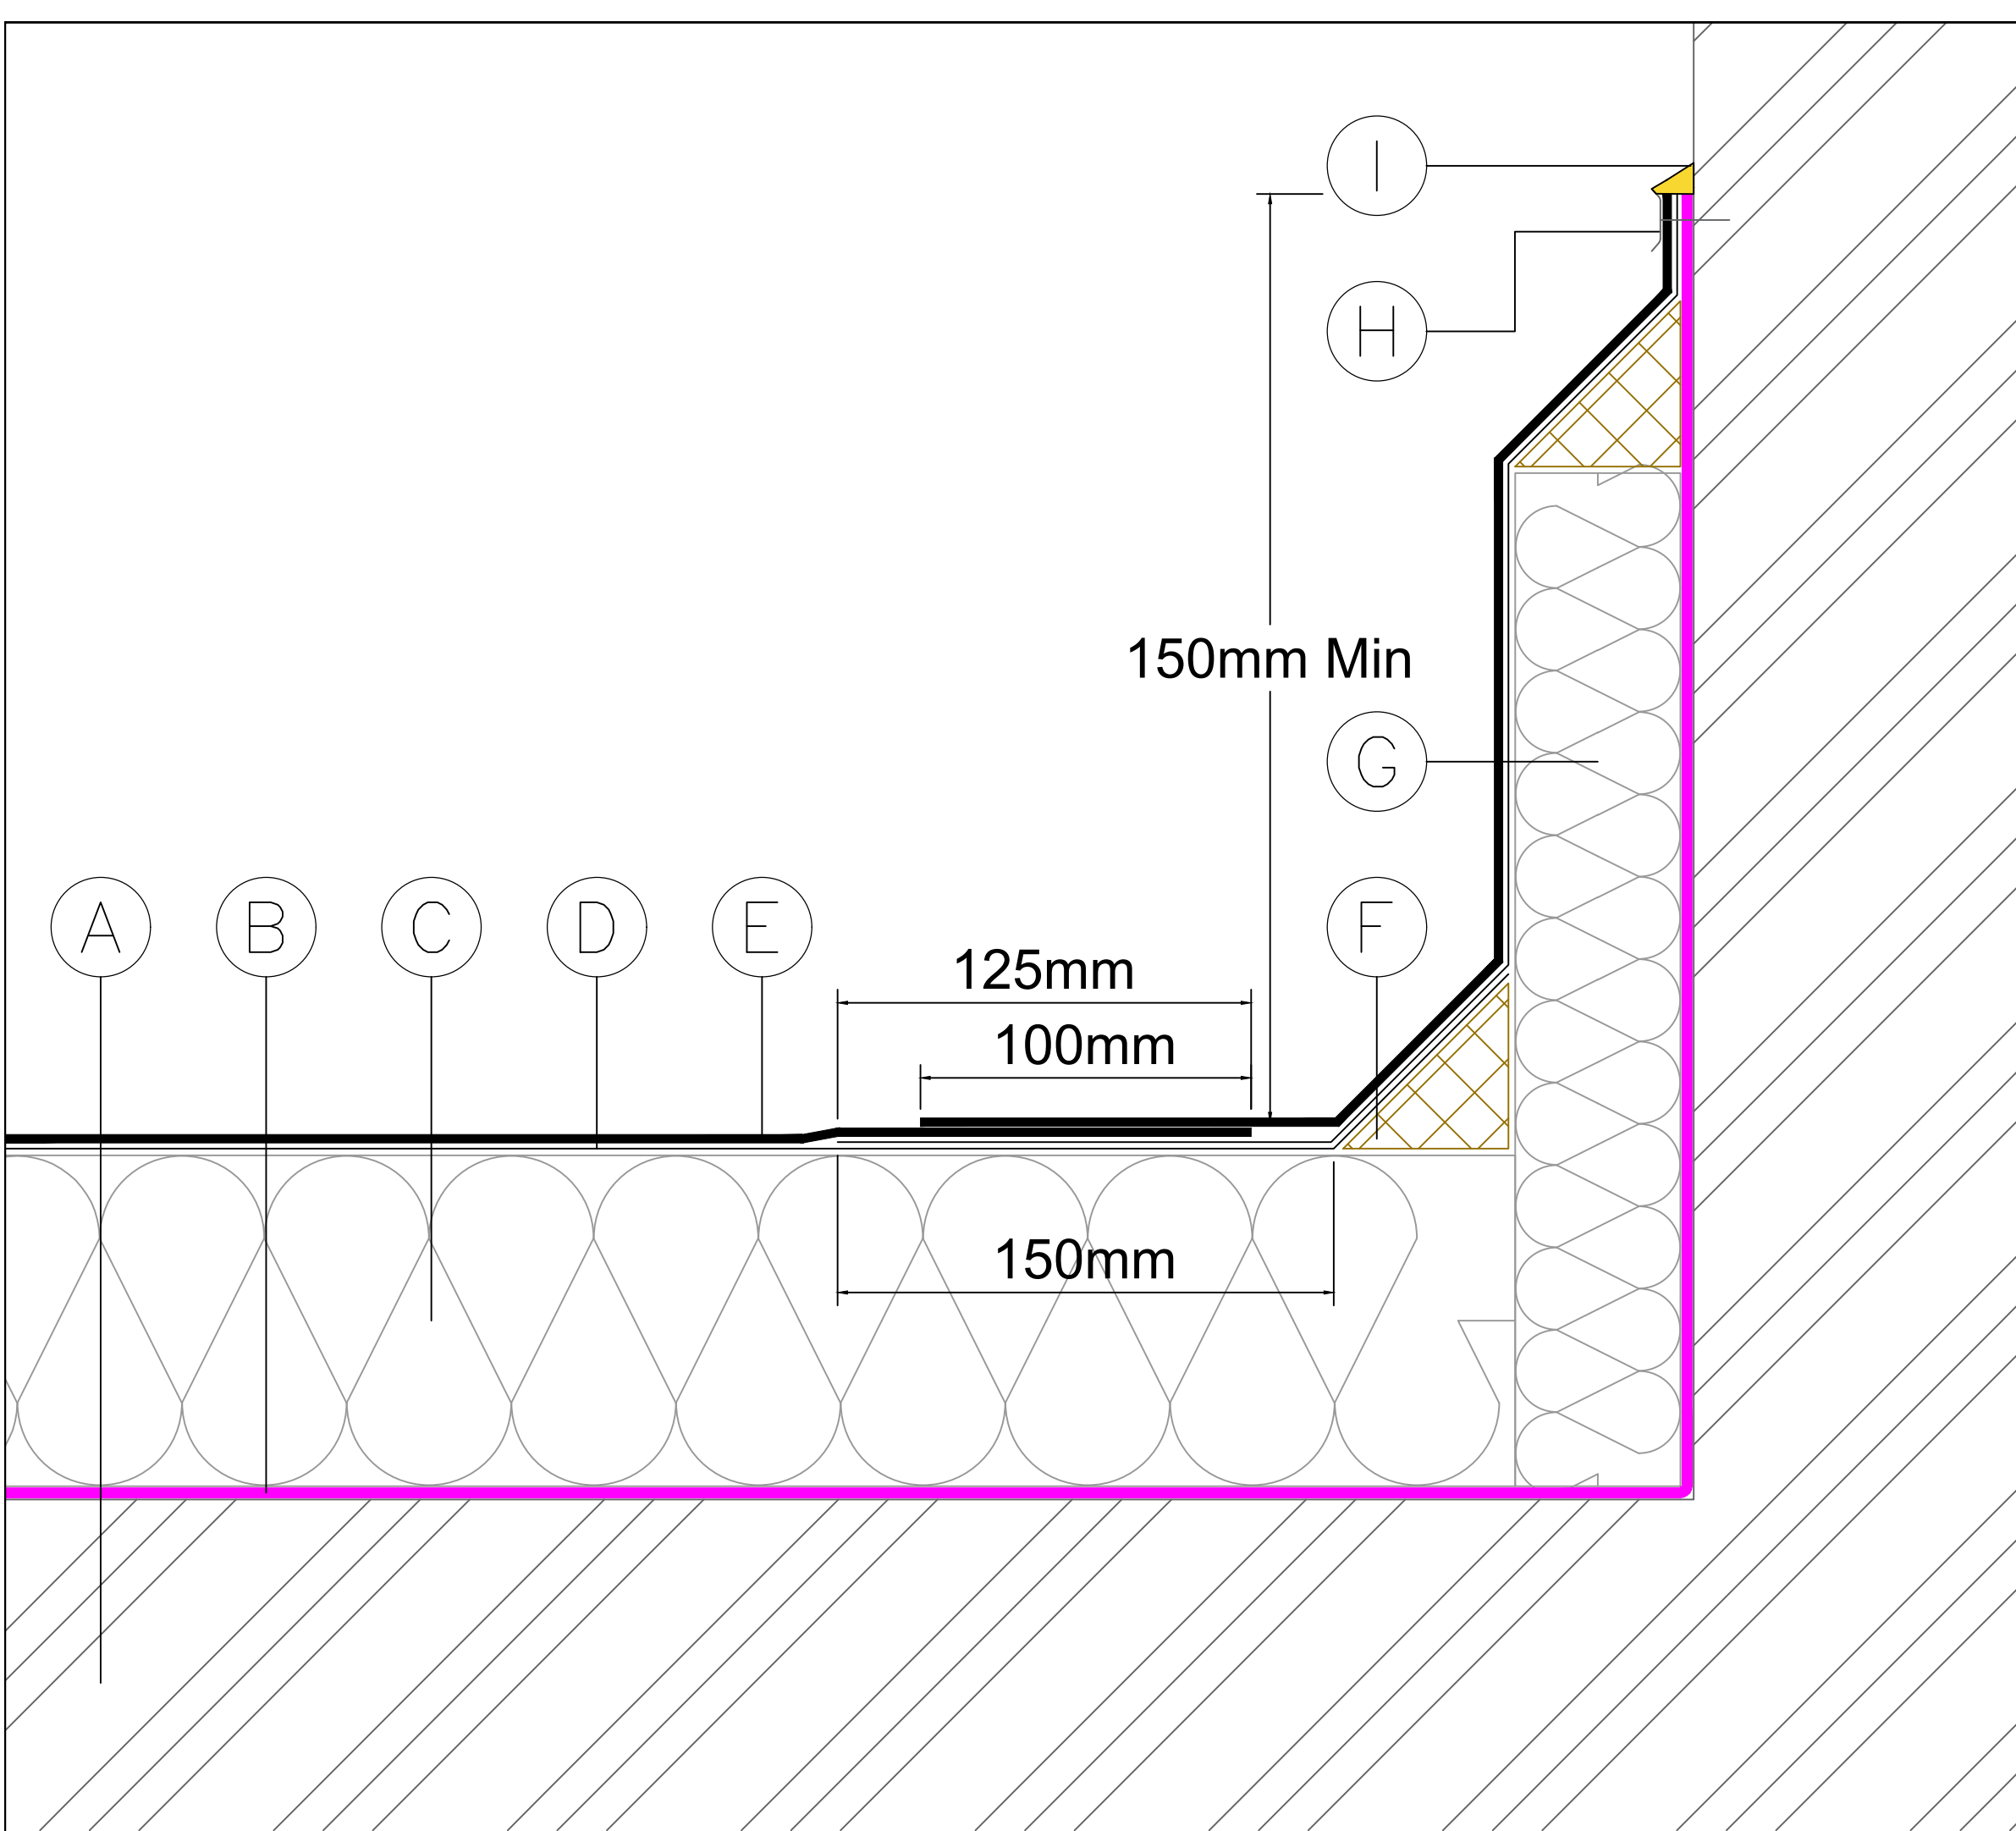

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) 50 x 50mm treated timber angle fillet
- G) Xtratherm FR/BGM rigid PIR insulation (or equal approved), bonded with Fatra FF867 Insulation Adhesive
- H) GRP termination bar mech fixed at 250mm centres
- I) Fatra FF857 Silicone Sealant

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE




T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Insulated Upstand with Termination Bar
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018	SCALE: NTS	DRAWN: MDJ
----------------------	----------------------	----------------------

DRAWING NO: FATRA F2F-11	REVISION: -
------------------------------------	-----------------------

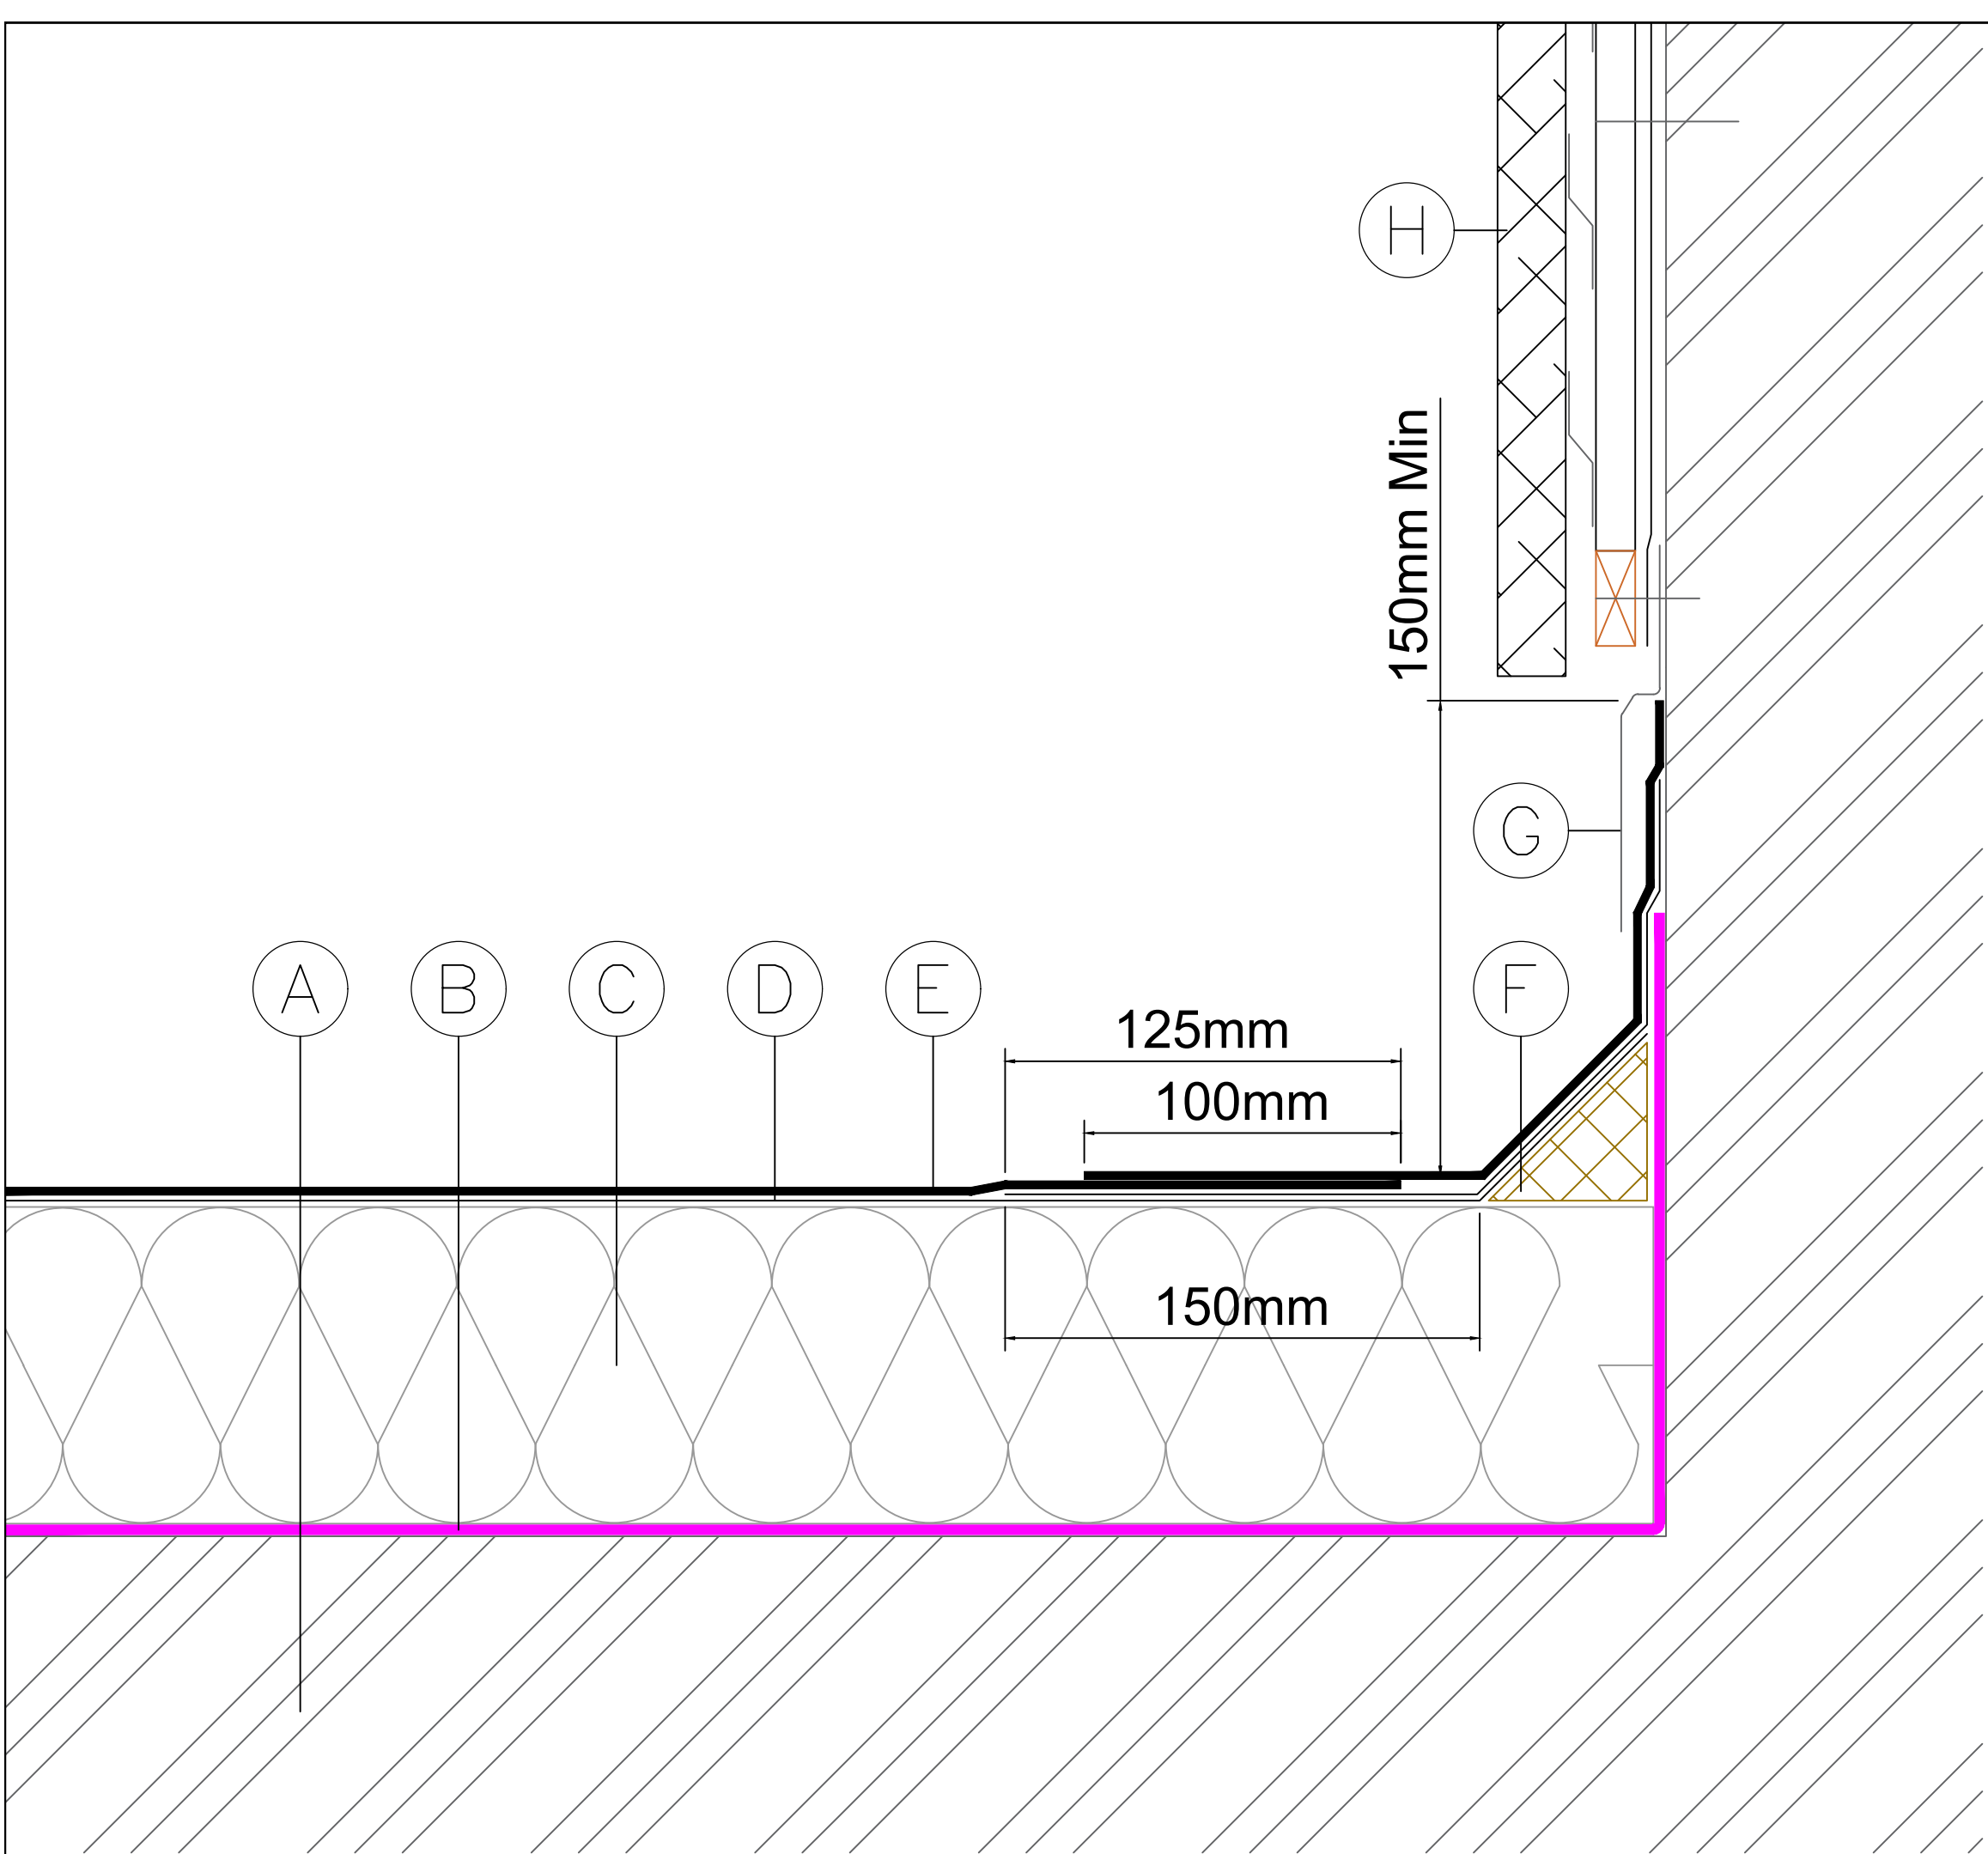

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) 50 x 50mm treated timber angle fillet
- G) Code 3 lead flashing with minimum 75mm coverage
- H) Cladding

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE




T 029 2048 7954
F 029 2048 9226

E technical@fatra.co.uk
W www.fatra.co.uk

Upstand to Cladding
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018	SCALE: NTS	DRAWN: MDJ
---------------	---------------	---------------

DRAWING NO: FATRA F2F-12	REVISION: -
-----------------------------	----------------

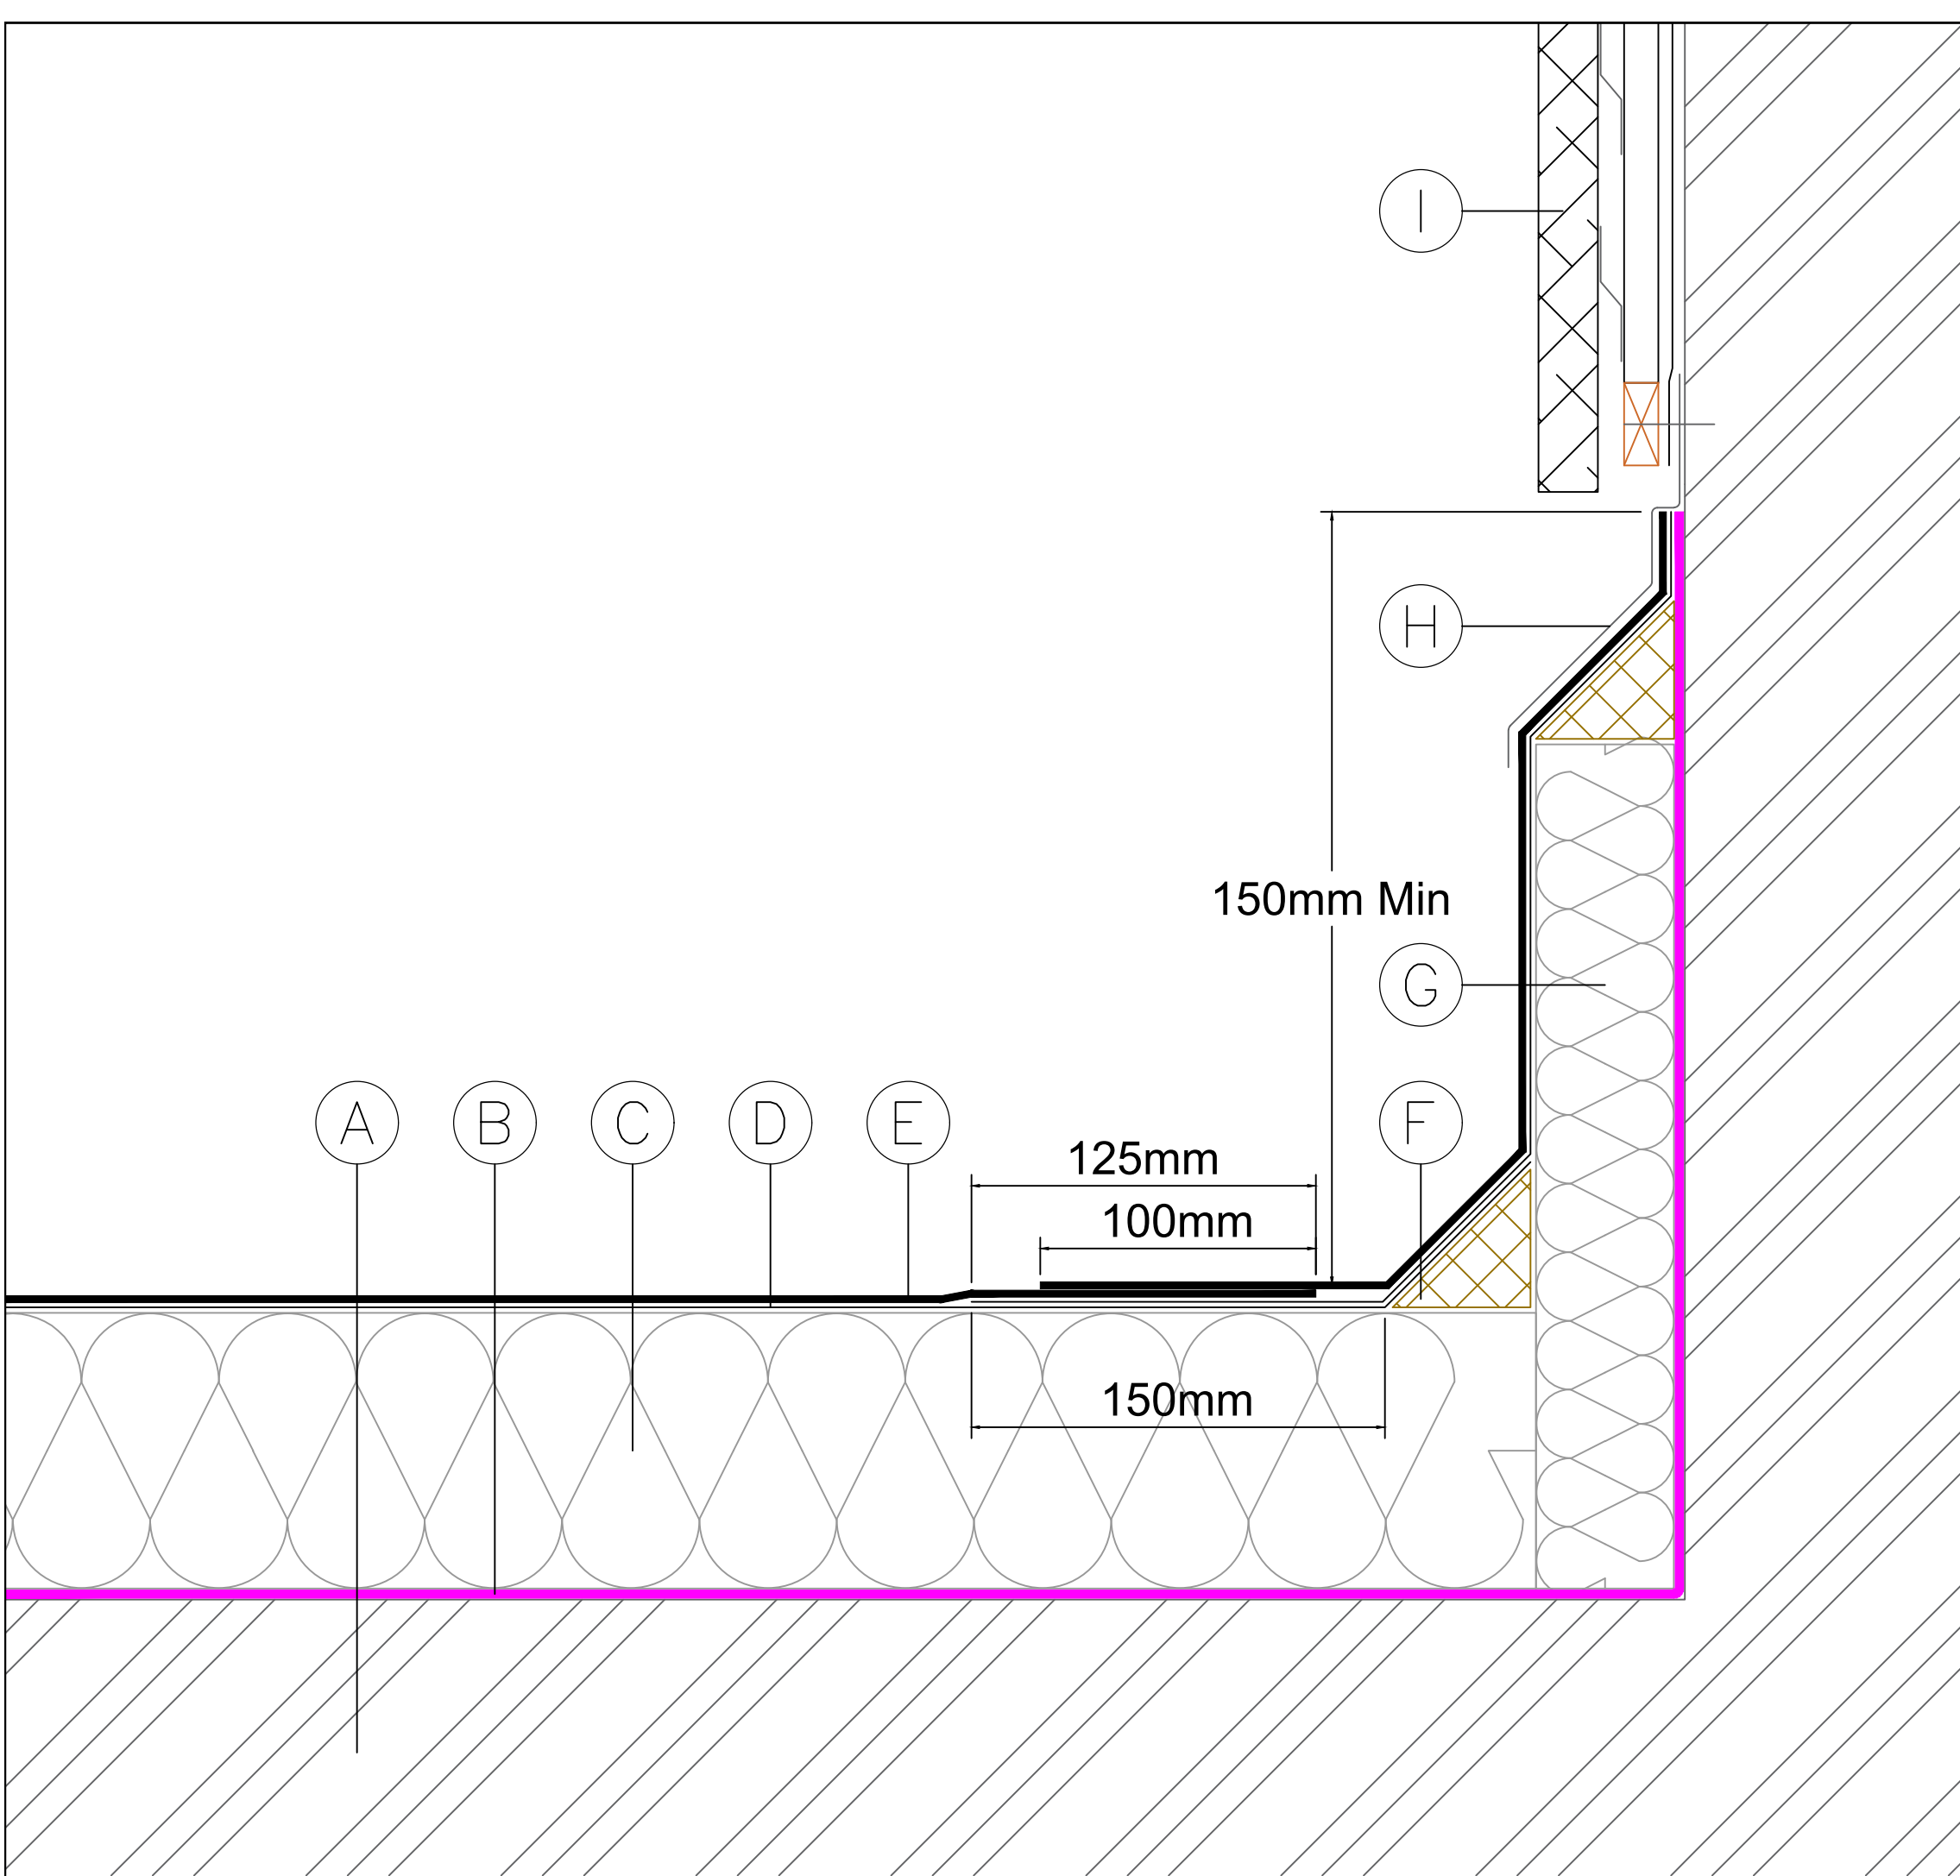

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) 50 x 50mm treated timber angle fillet
- G) Xtratherm FR/BGM rigid PIR insulation (or equal approved), bonded with Fatra FF867 Insulation Adhesive
- H) Code 3 lead flashing with minimum 75mm coverage
- I) Cladding

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE



T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Insulated Upstand to Cladding
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE:

2018

SCALE:

NTS

DRAWN:


MDJ

DRAWING NO:

FATRA F2F-13

REVISION:

-

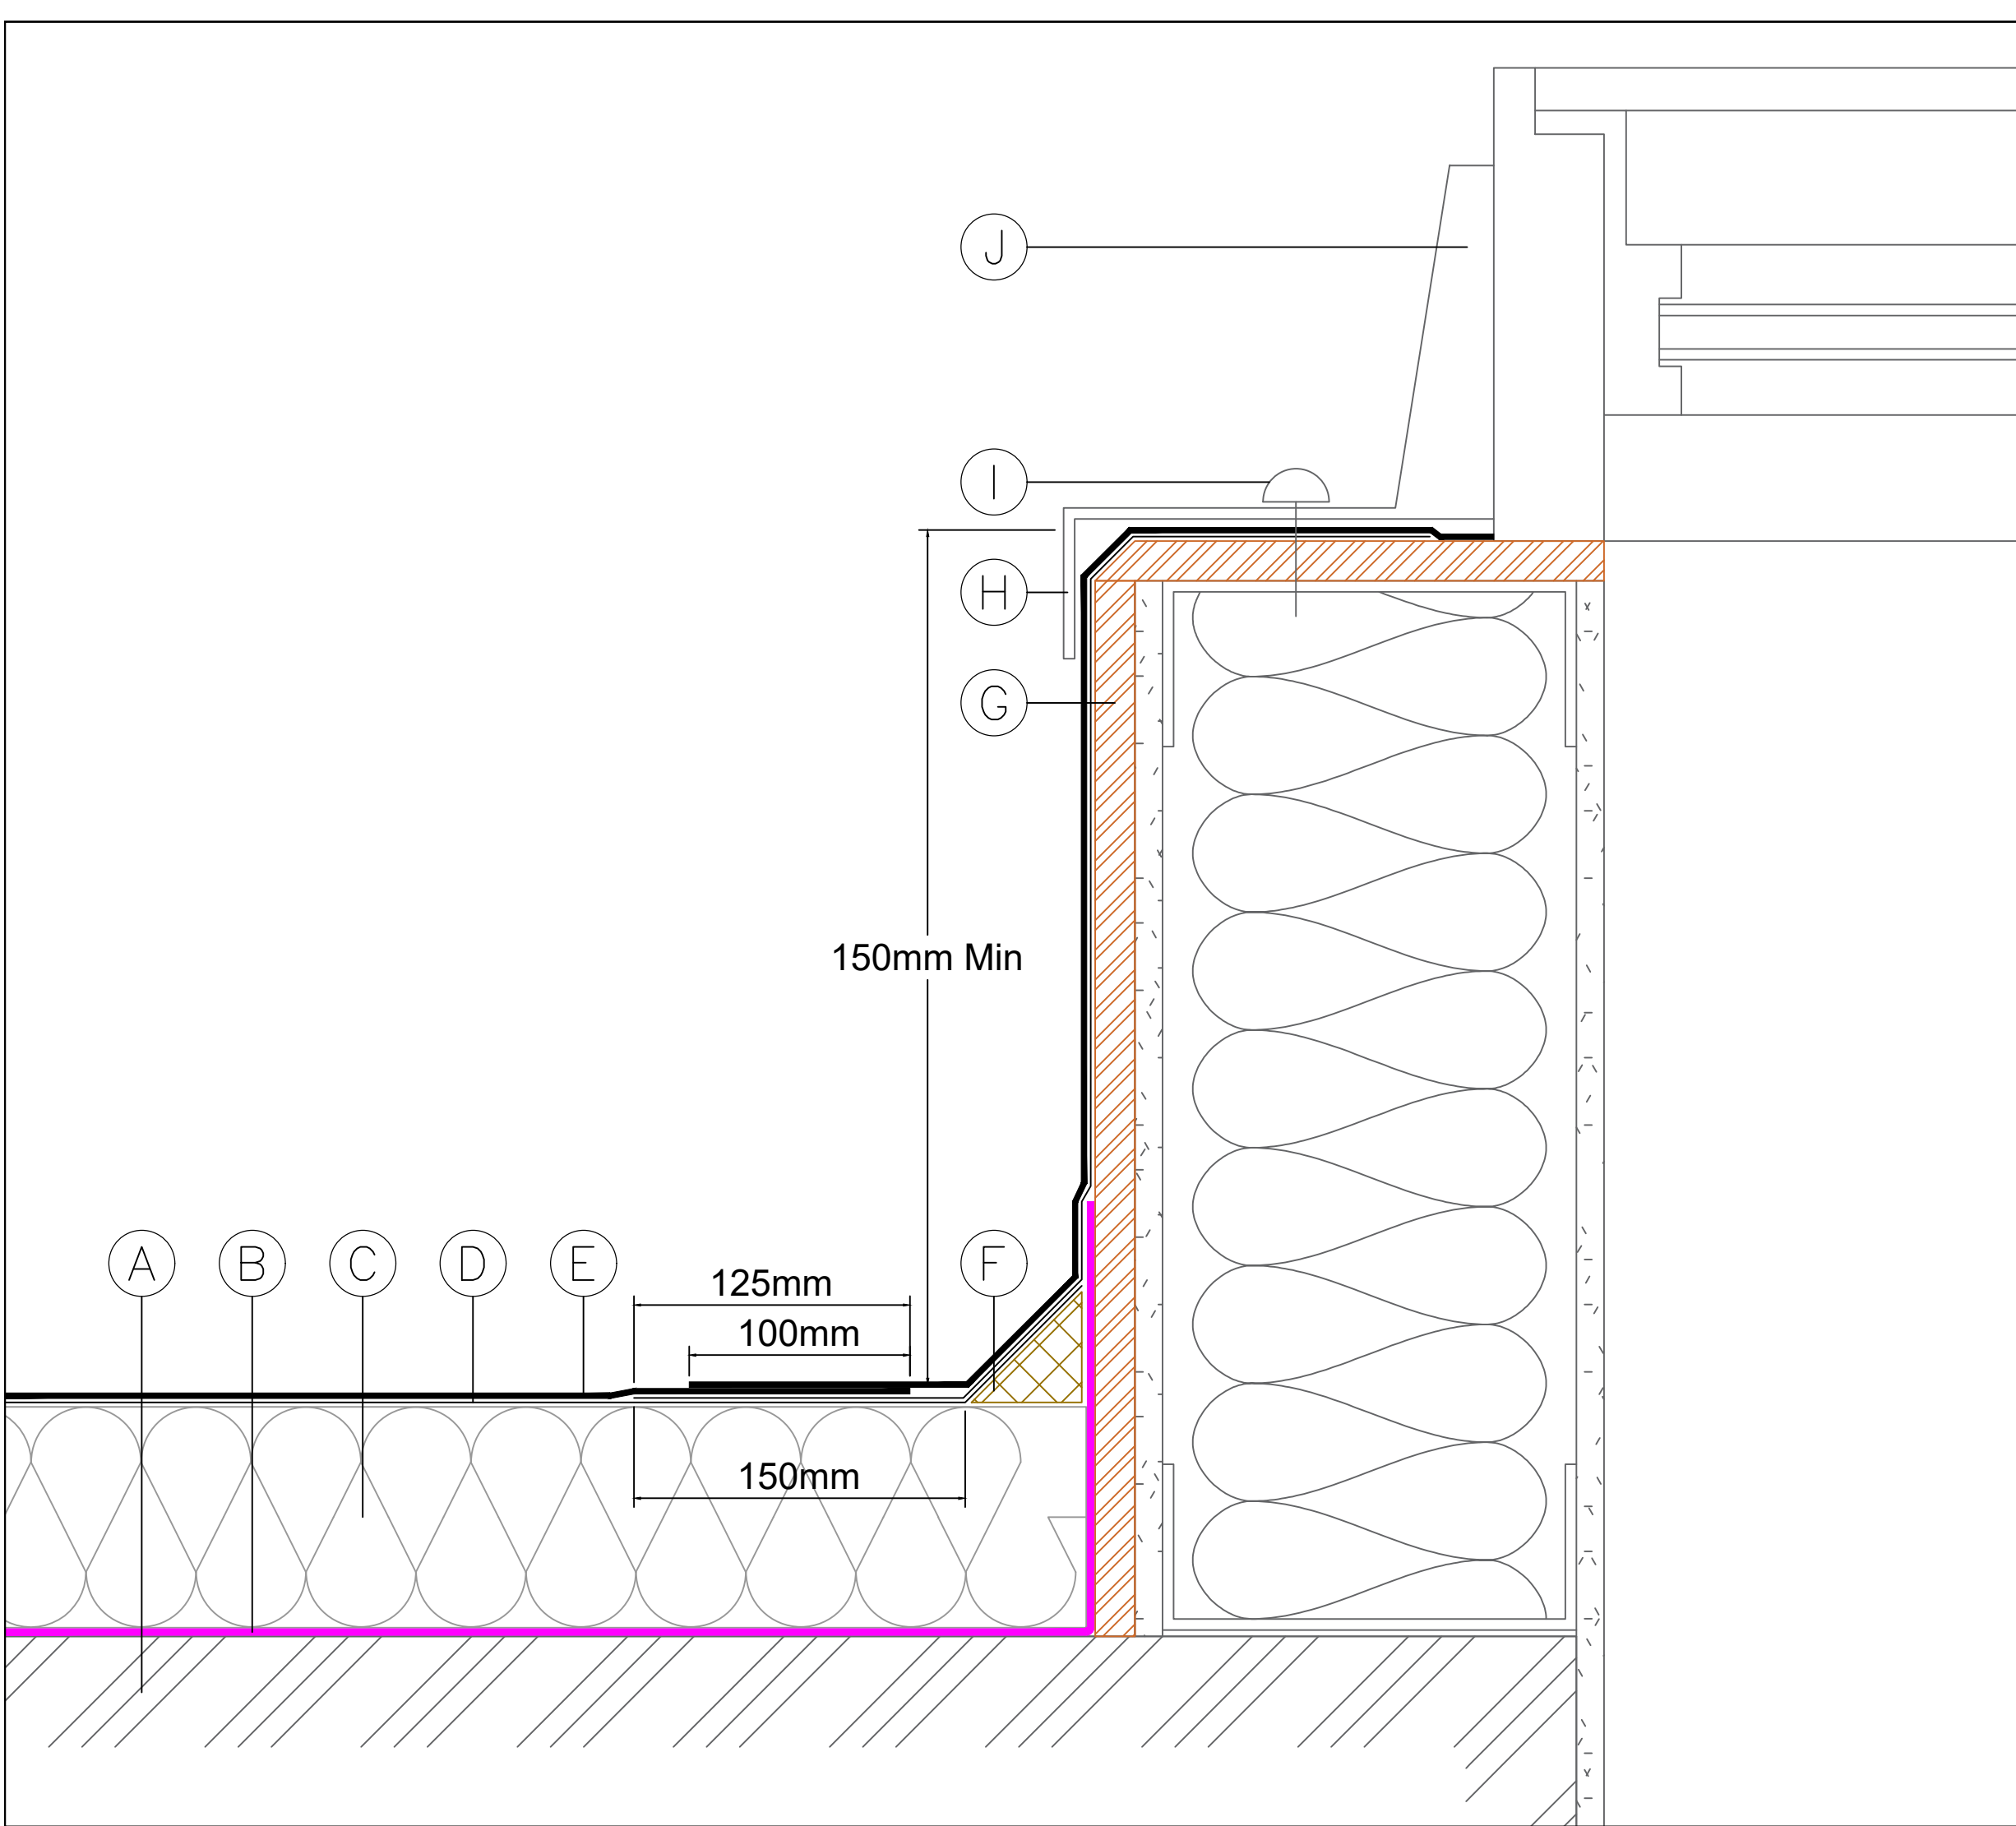

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) 50 x 50mm treated timber angle fillet
- G) 18mm Class 3 plywood mech fixed to upstand
- H) Flashing
- I) Sealed fixing as per roof light requirements
- J) Roof light

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE



T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Upstand to Roof Light
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd


DATE:
2018

SCALE:
NTS

DRAWN:
MDJ

DRAWING NO:
FATRA F2F-14

REVISION:
-

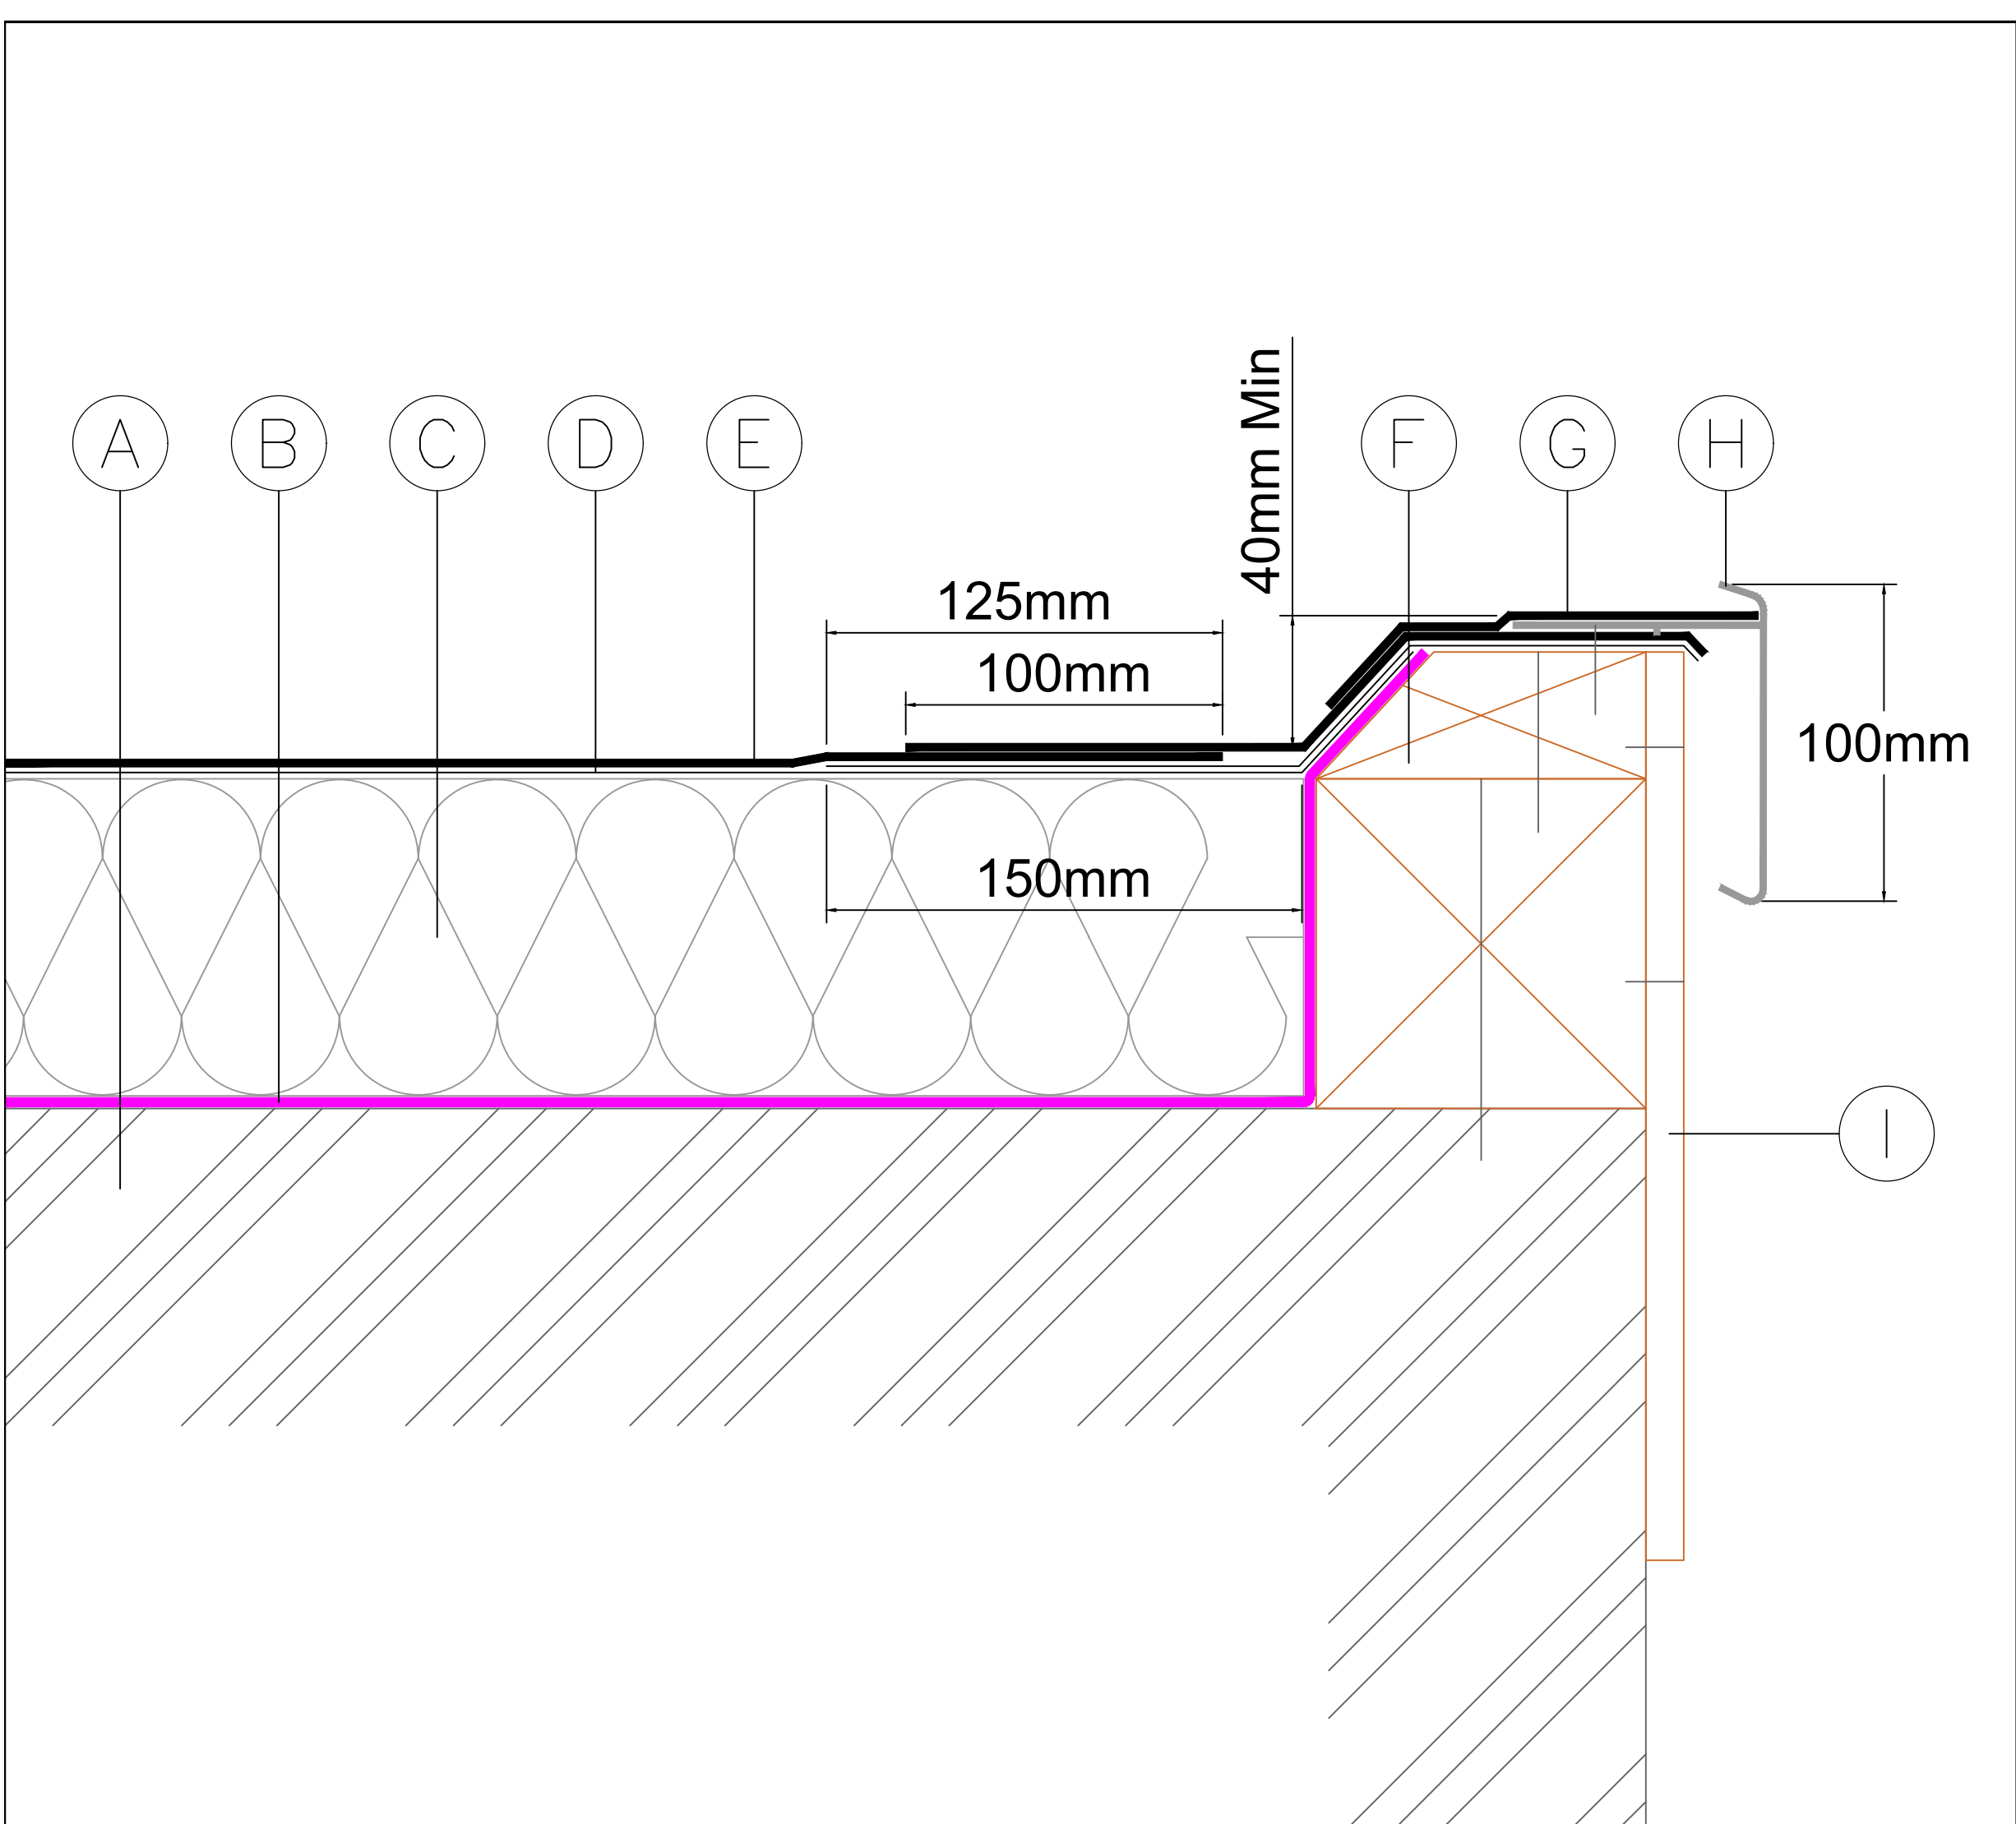

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) Profiled timber check fillet (min 40mm high) mech fixed to timber insulation stop
- G) 150mm wide felt torch on cover strap in Fatra FF825
- H) 100mm face GRP Paptrim mech fixed at 250mm centres
- I) Fascia board

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE




T 029 2048 7954
F 029 2048 9226

E technical@fatra.co.uk
W www.fatra.co.uk

Check Kerb with GRP Trim
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018	SCALE: NTS	DRAWN: MDJ
DRAWING NO: FATRA F2F-15		REVISION: -

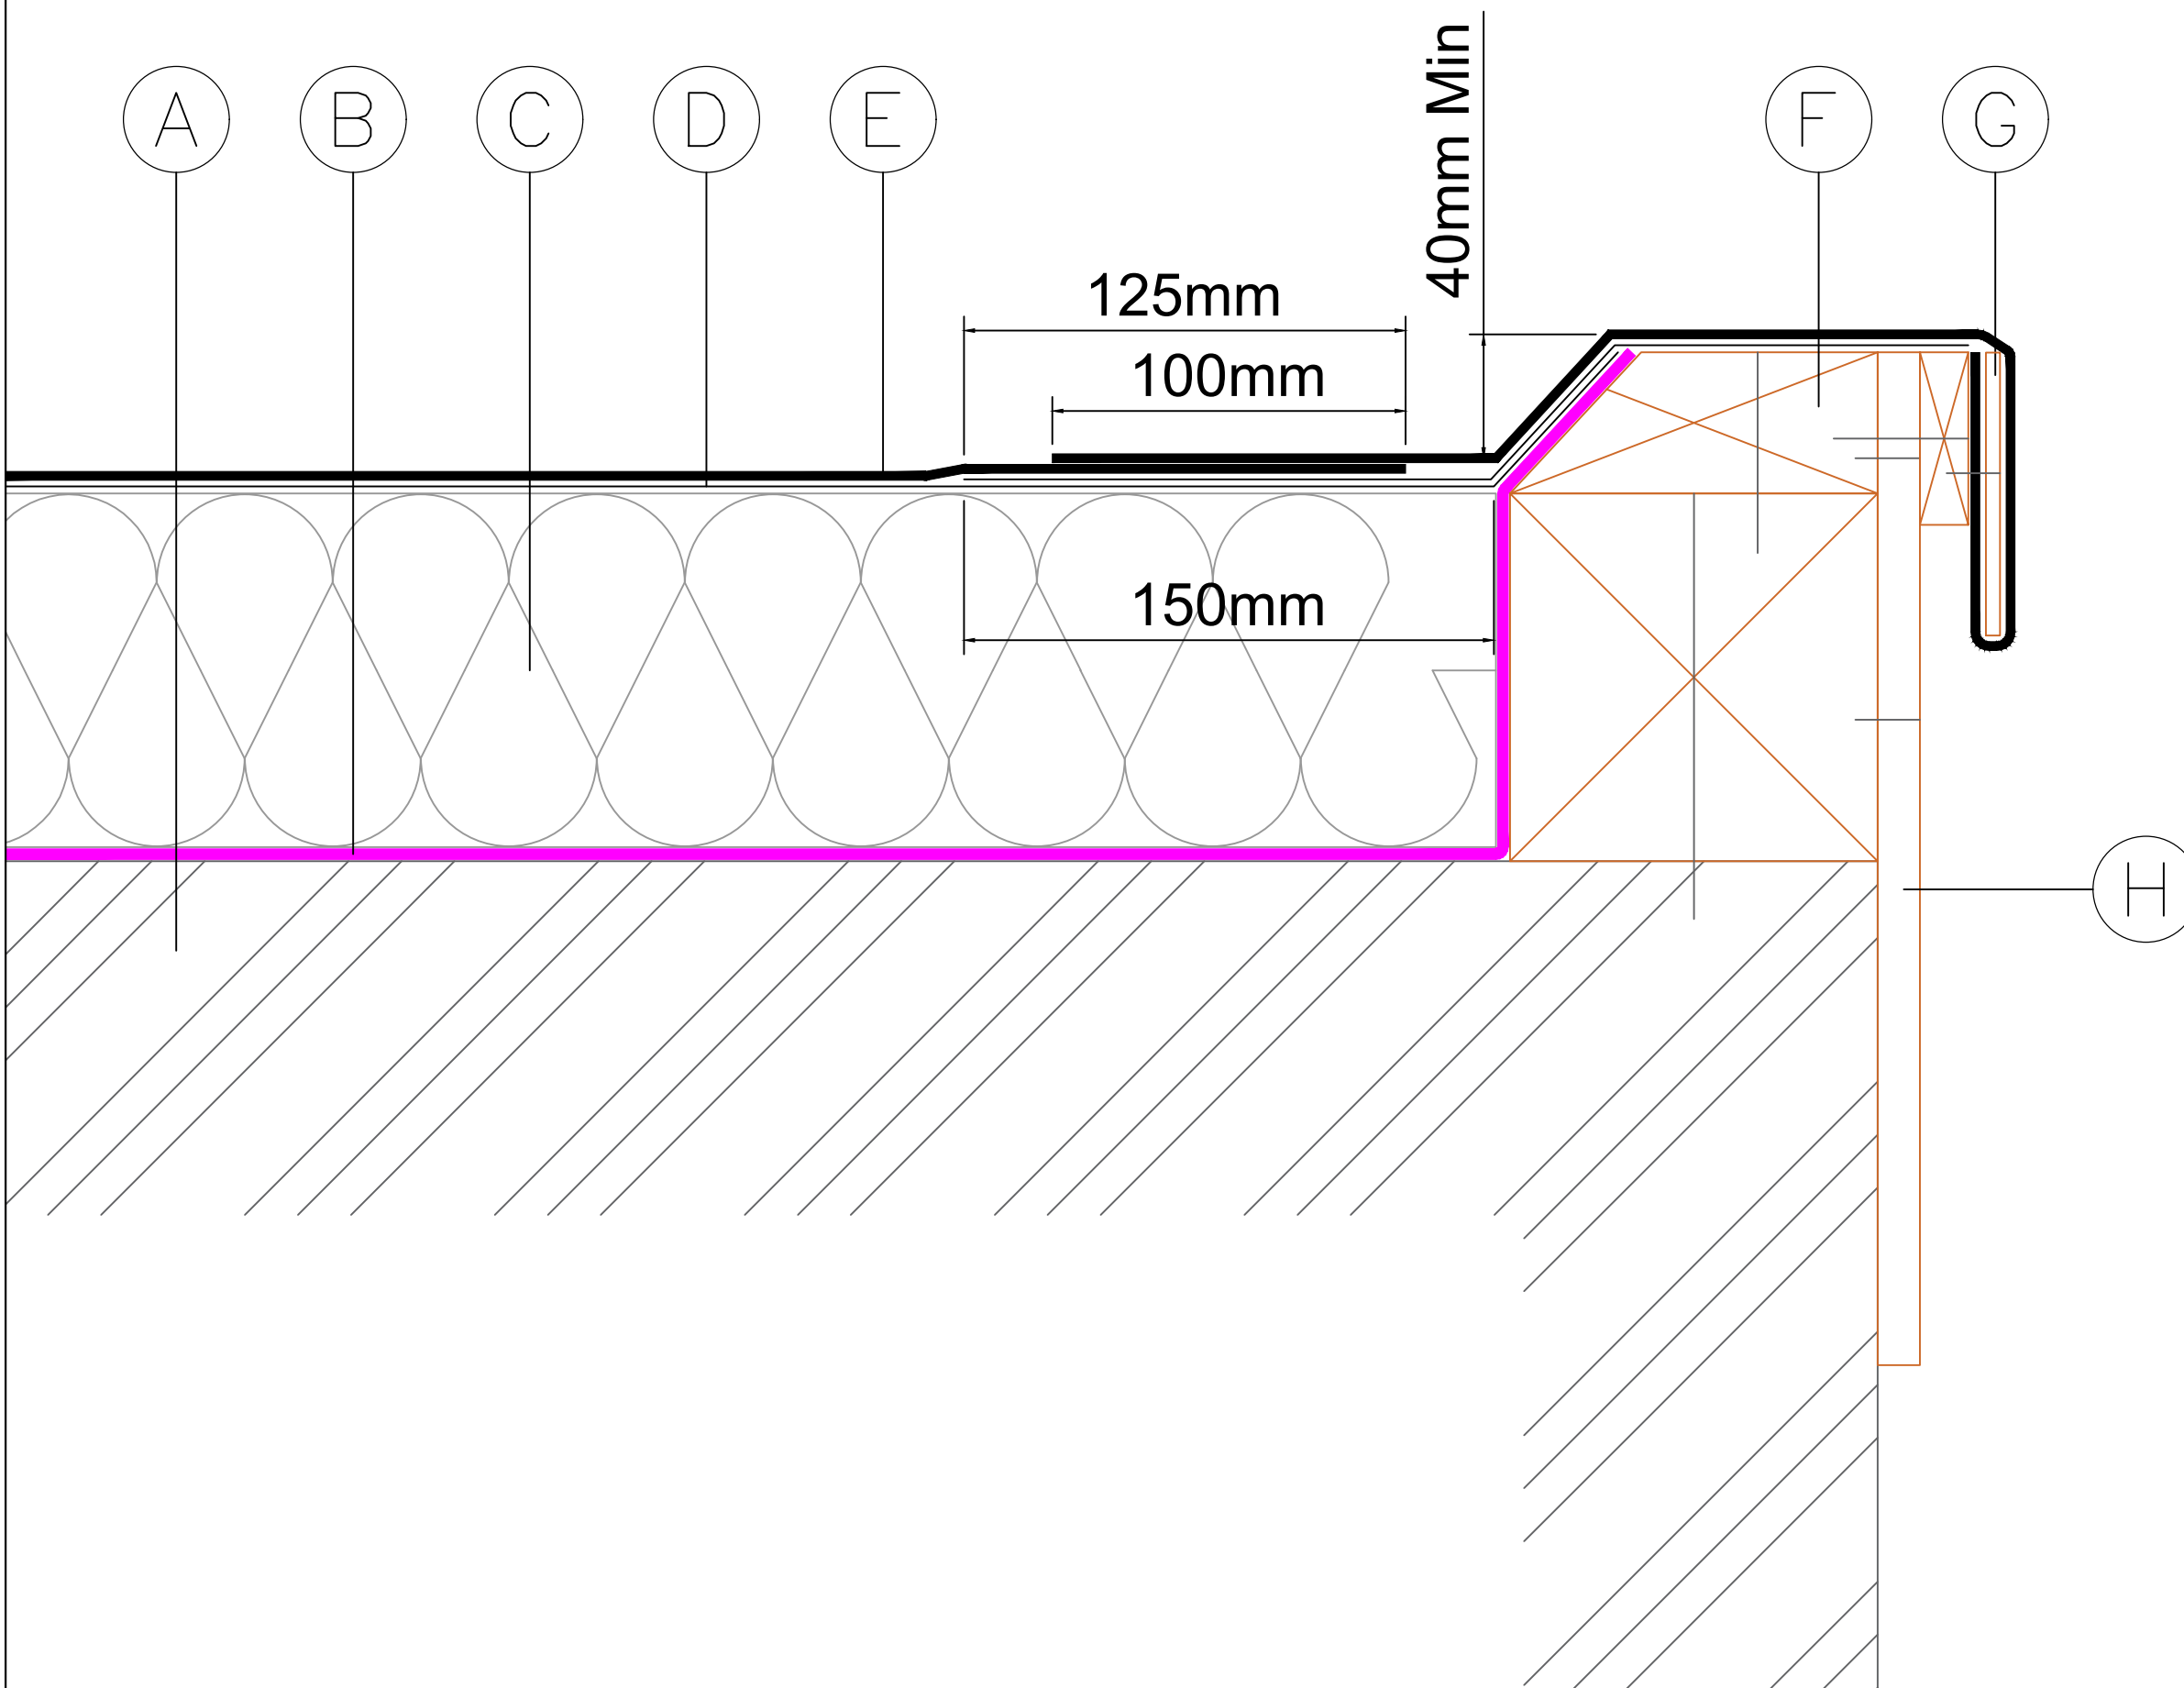

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) Profiled timber check fillet (min 40mm high) mech fixed to timber insulation stop
- G) Welted drip in Fatra FF825 formed with 80 x 4mm plywood mech fixed to batten at 150mm centres
- H) Fascia board

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE



T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Check Kerb with Welted Drip
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd


DATE:
2018

SCALE:
NTS

DRAWN:
MDJ

DRAWING NO:
FATRA F2F-16

REVISION:
-

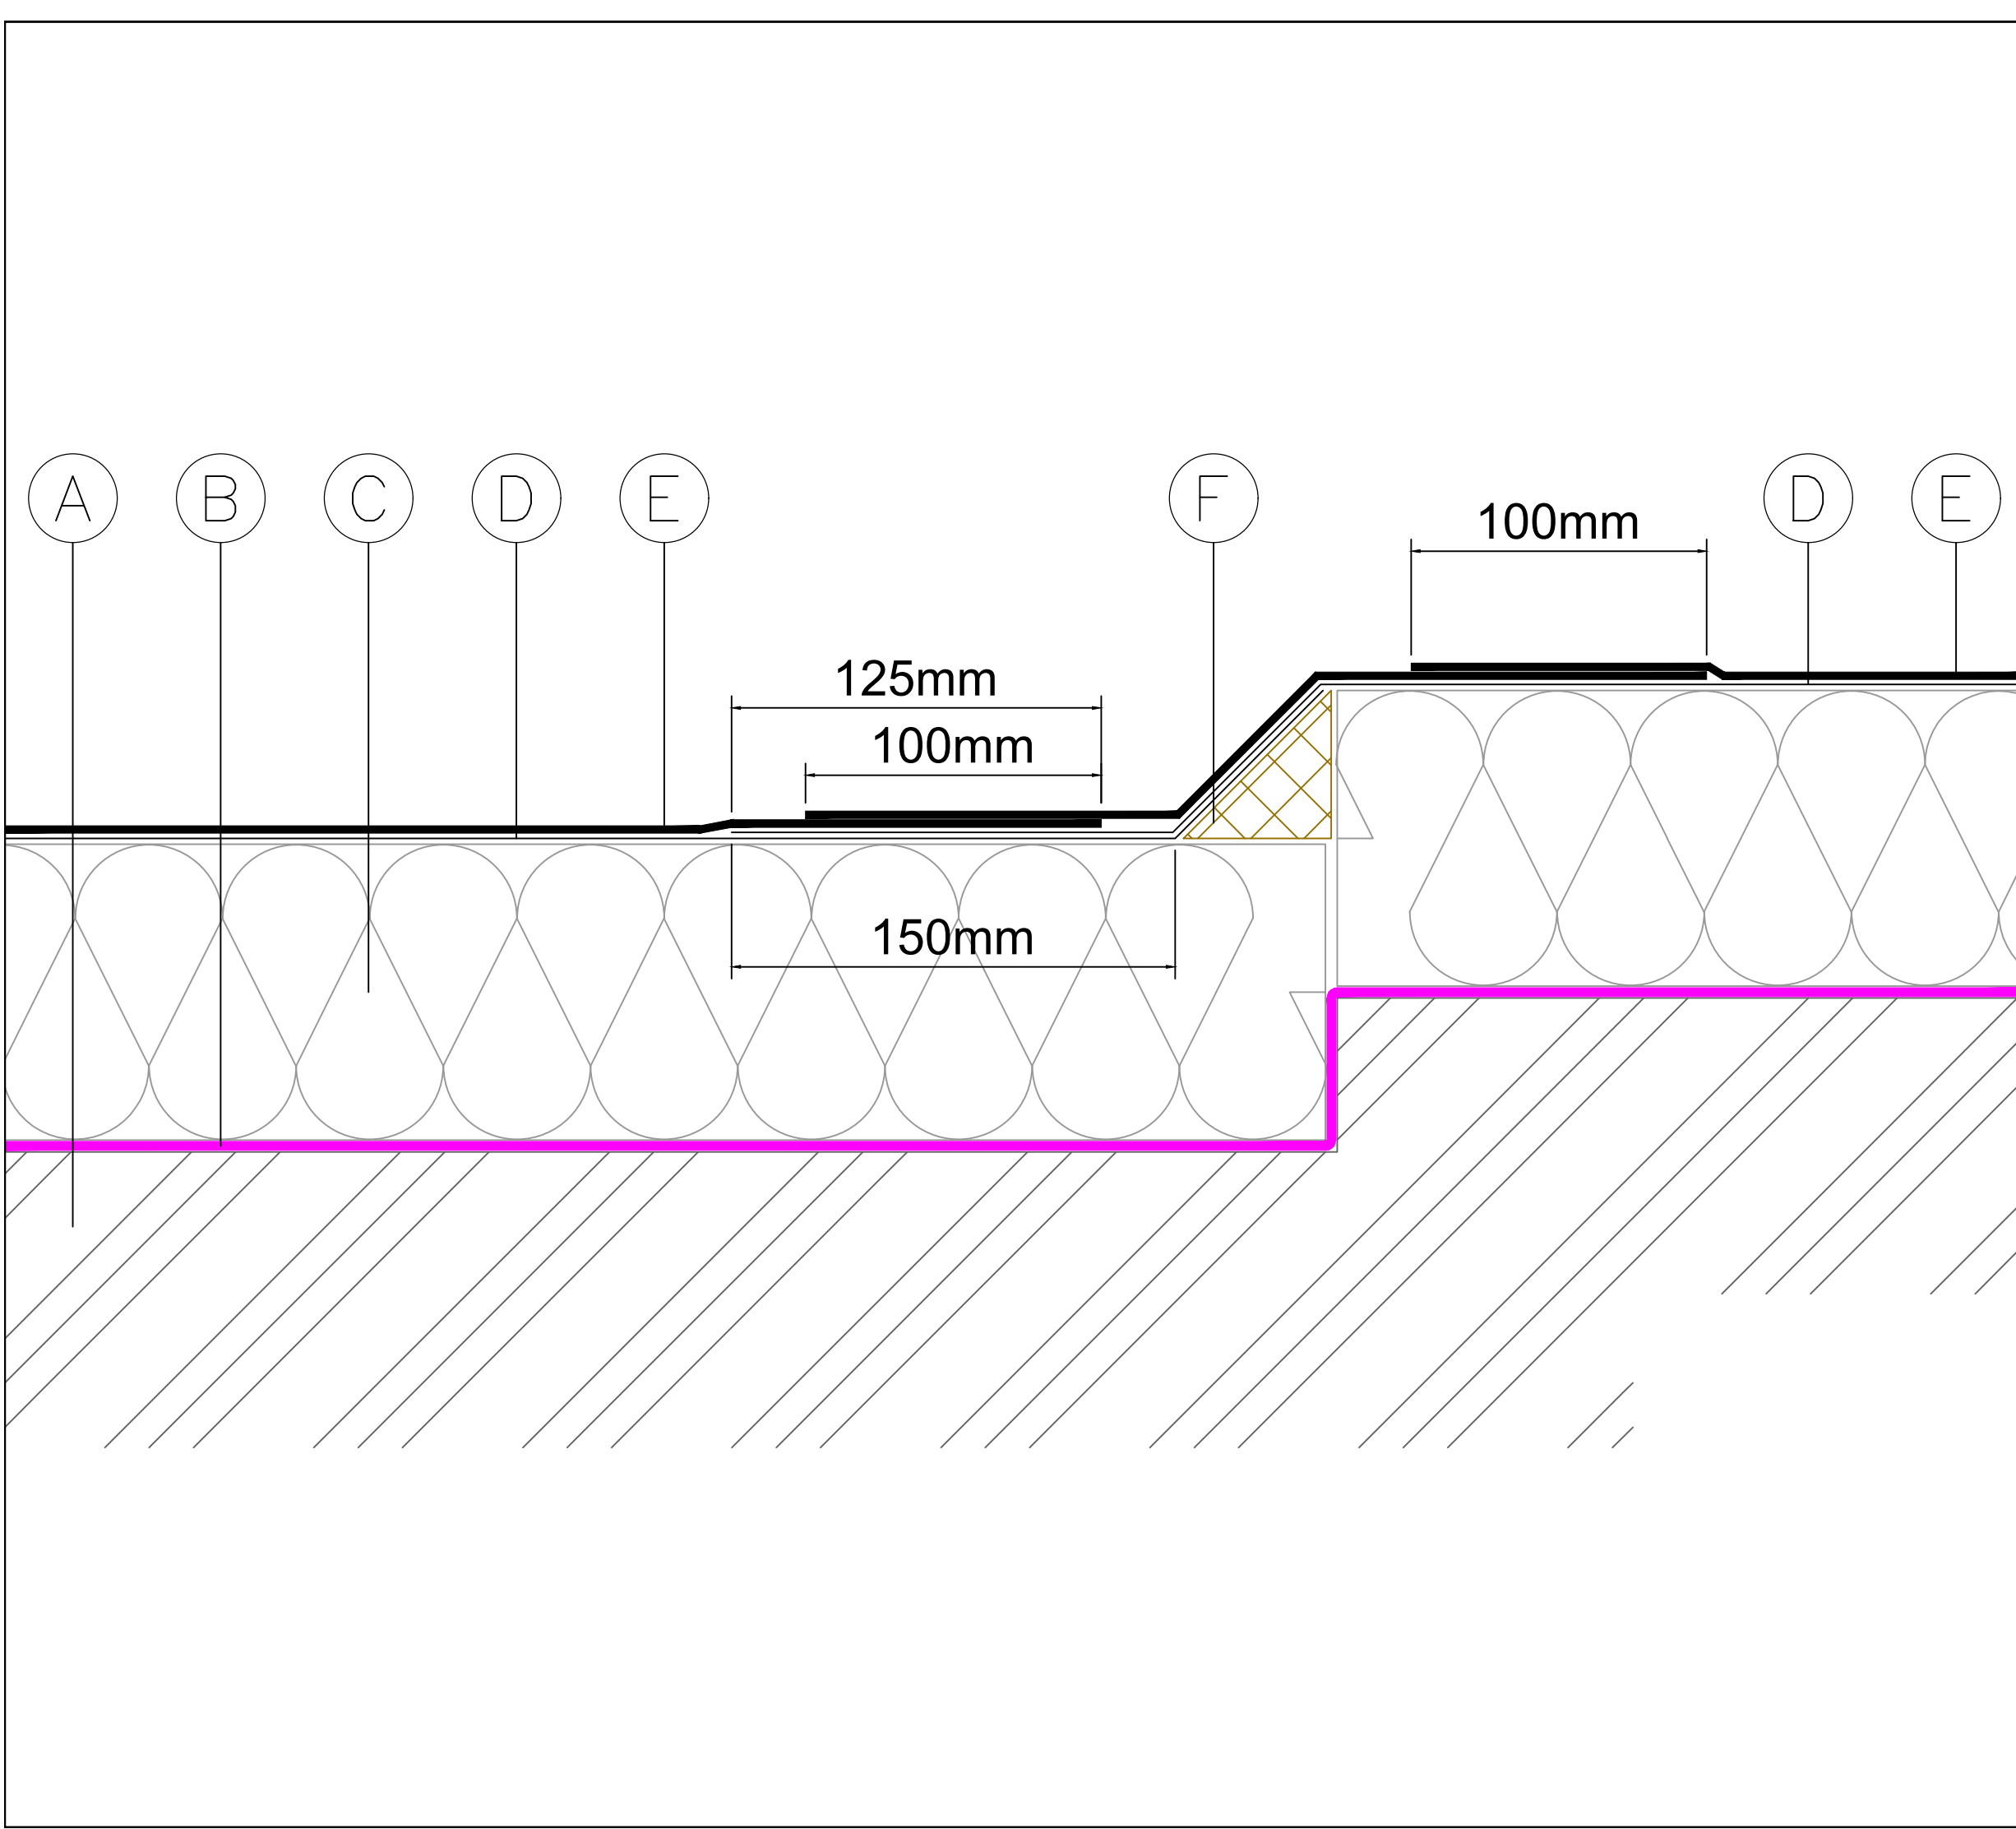

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) 50 x 50mm treated timber angle fillet

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE




T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Step Detail
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018 SCALE: NTS DRAWN: MDJ

DRAWING NO: FATRA F2F-17 REVISION: -

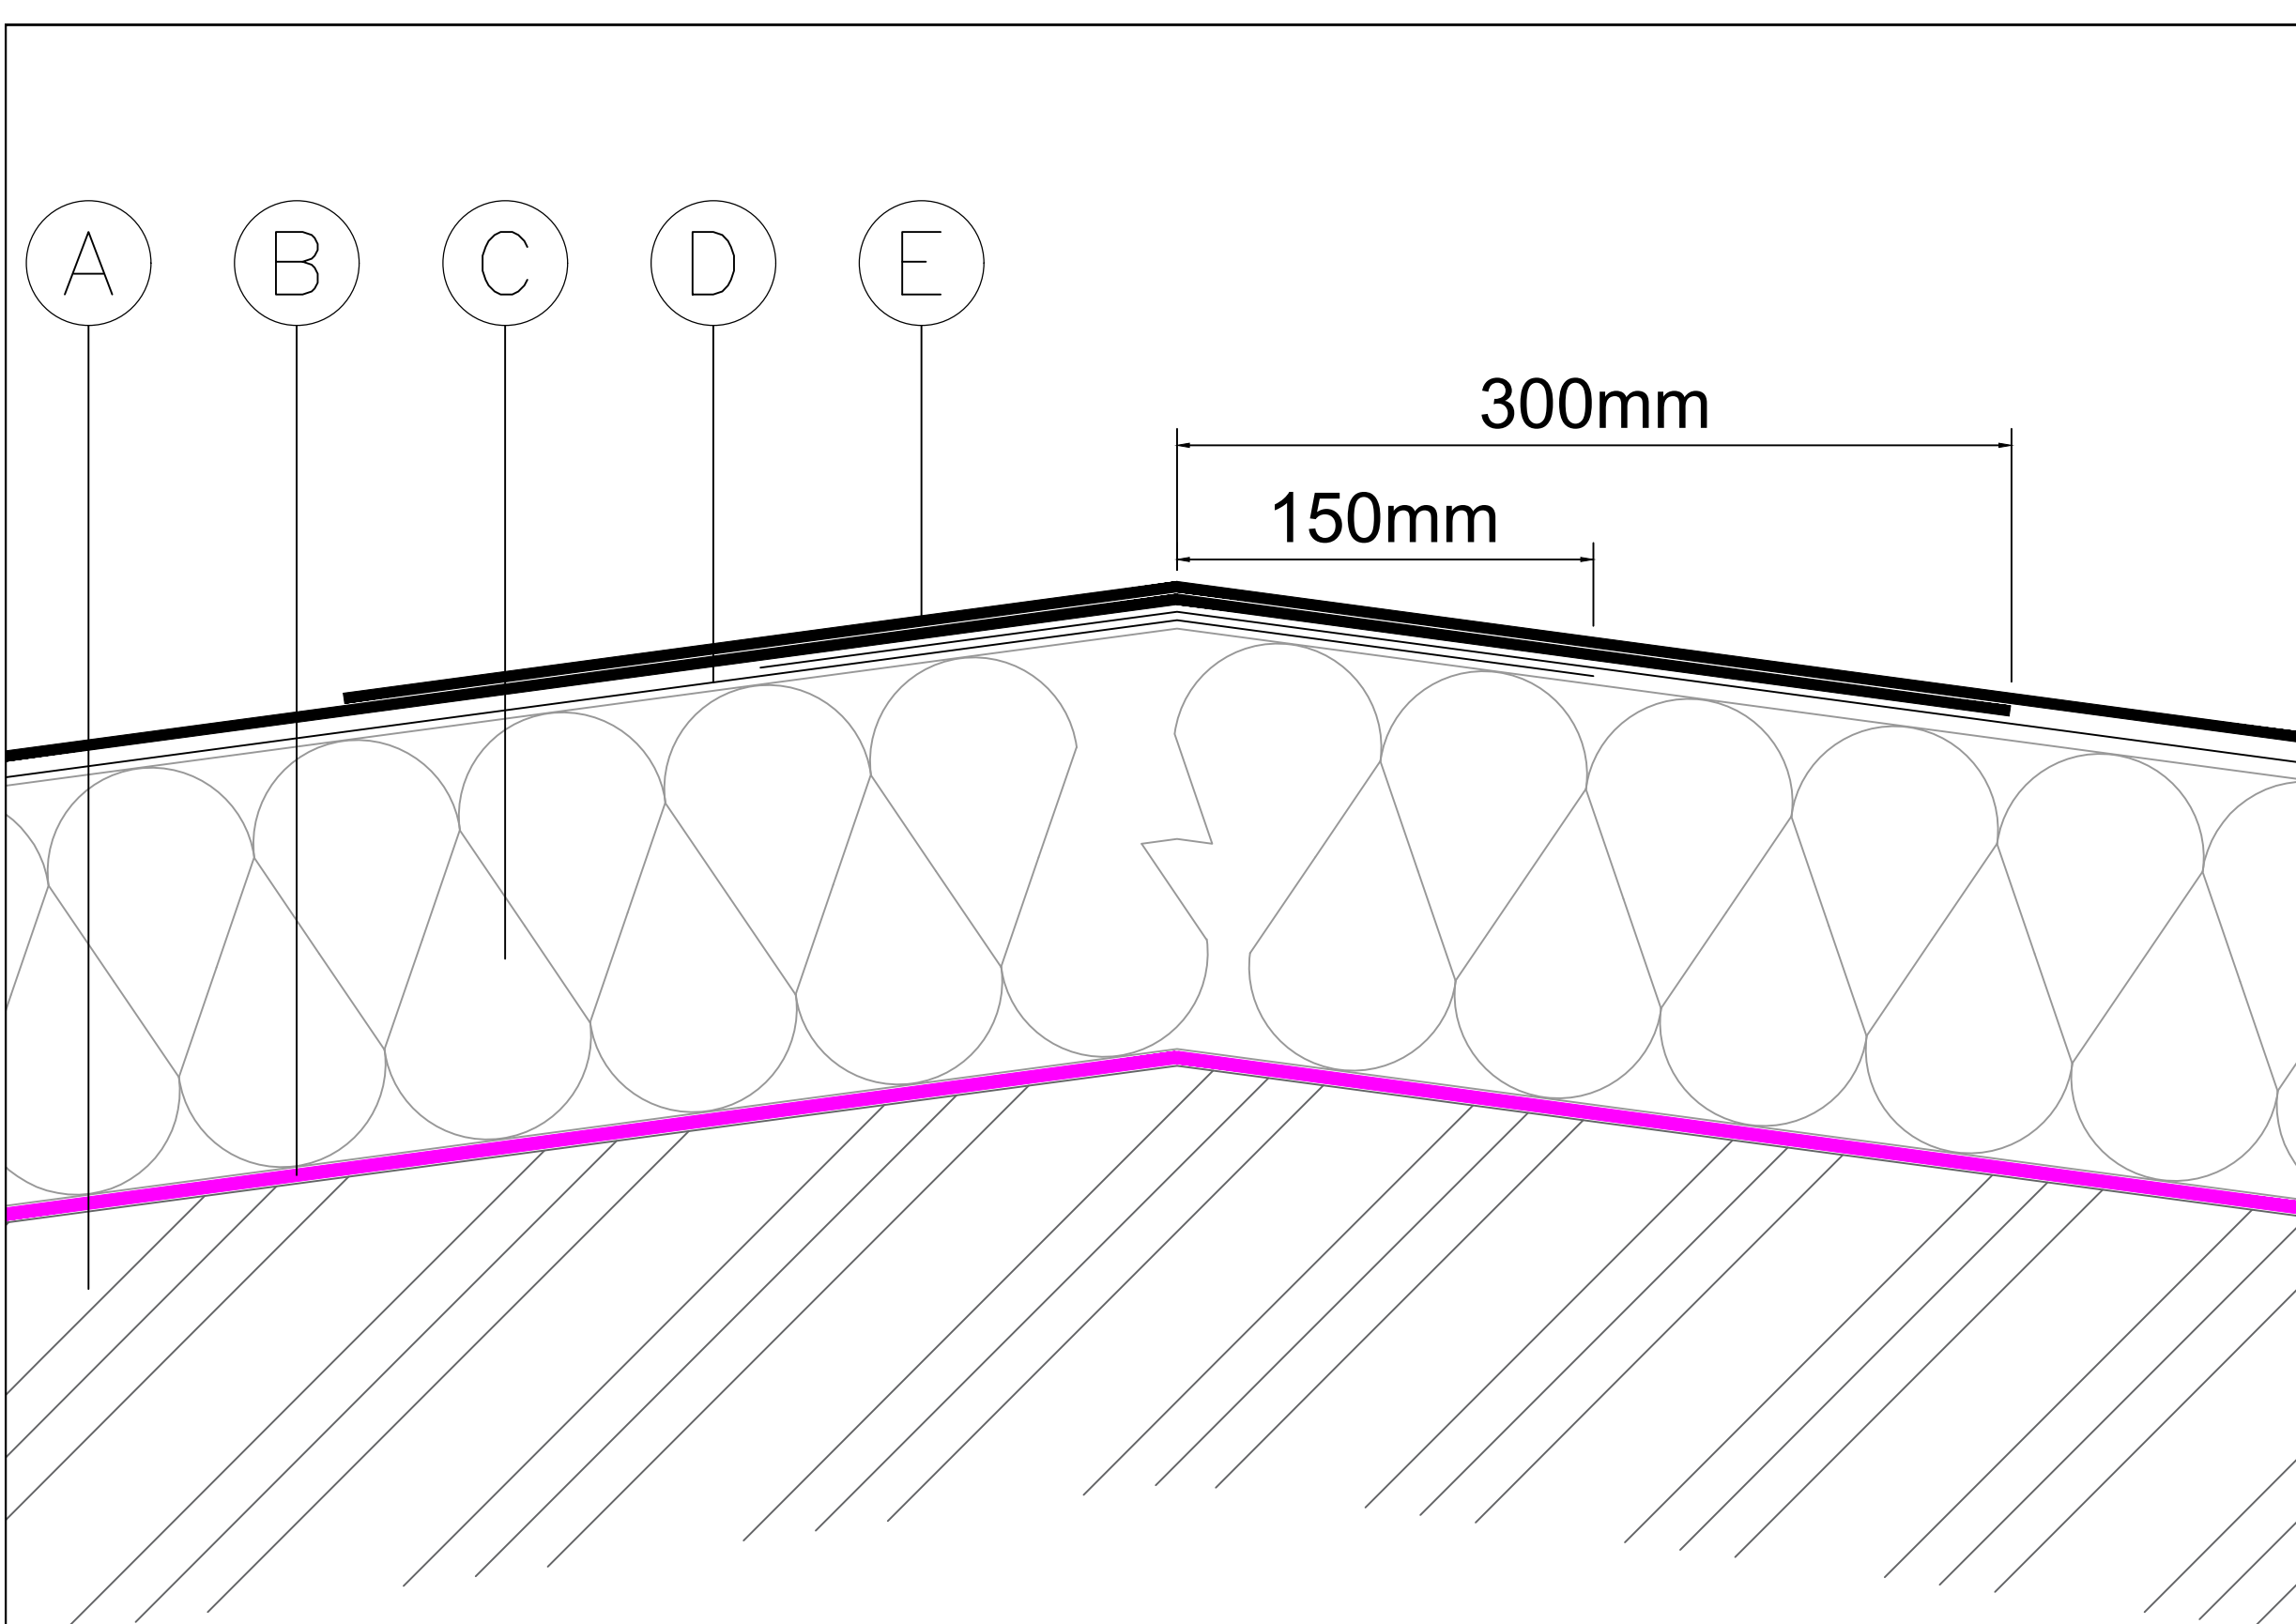

Roof Pitch <10 Degrees

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE




T 029 2048 7954
F 029 2048 9226

E technical@fatra.co.uk
W www.fatra.co.uk

Low Pitch Ridge Detail
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018	SCALE: NTS	DRAWN: MDJ
DRAWING NO: FATRA F2F-18		REVISION: -

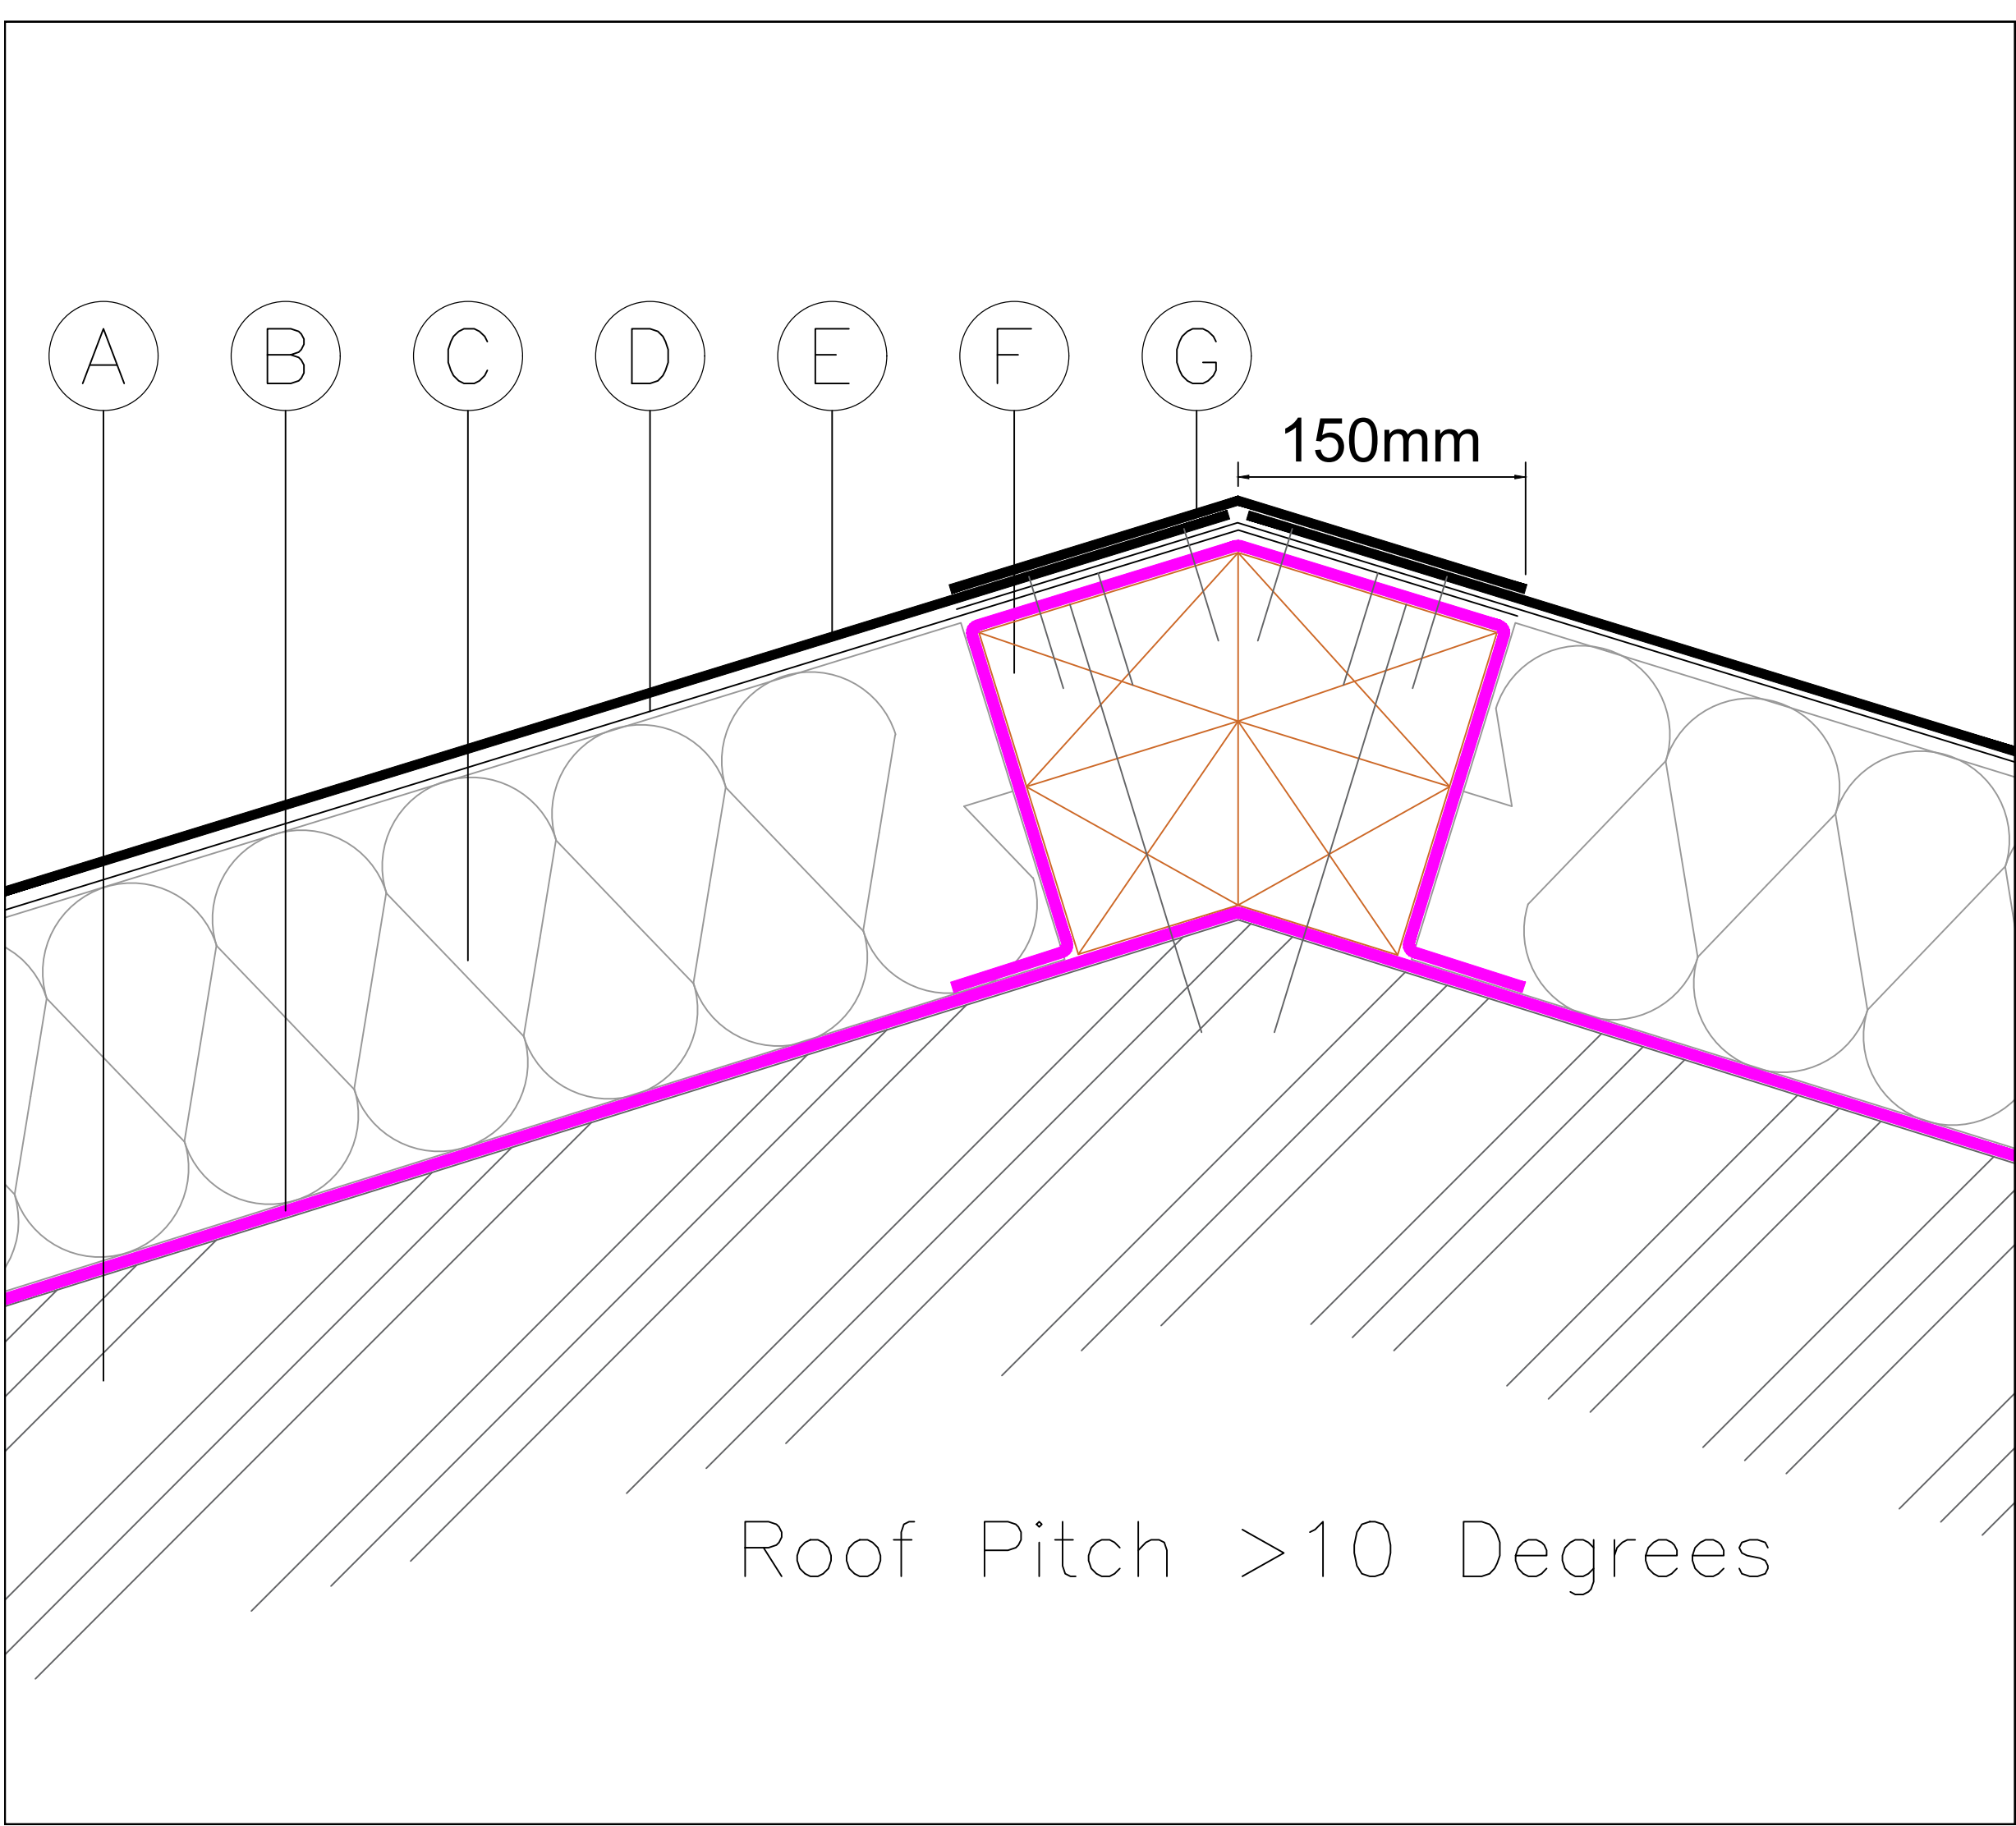

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) Treated timber insulation stop batten mech fixed to structural deck to allow lapping and mech fixing of felt membranes as detailed
- G) Torch on capsheet lapped min 150mm each side of roof ridge (FF825)

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE



T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

High Pitch Ridge Detail
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE:

2018

SCALE:

NTS

DRAWN:


MDJ

DRAWING NO:

FATRA F2F-19

REVISION:

-

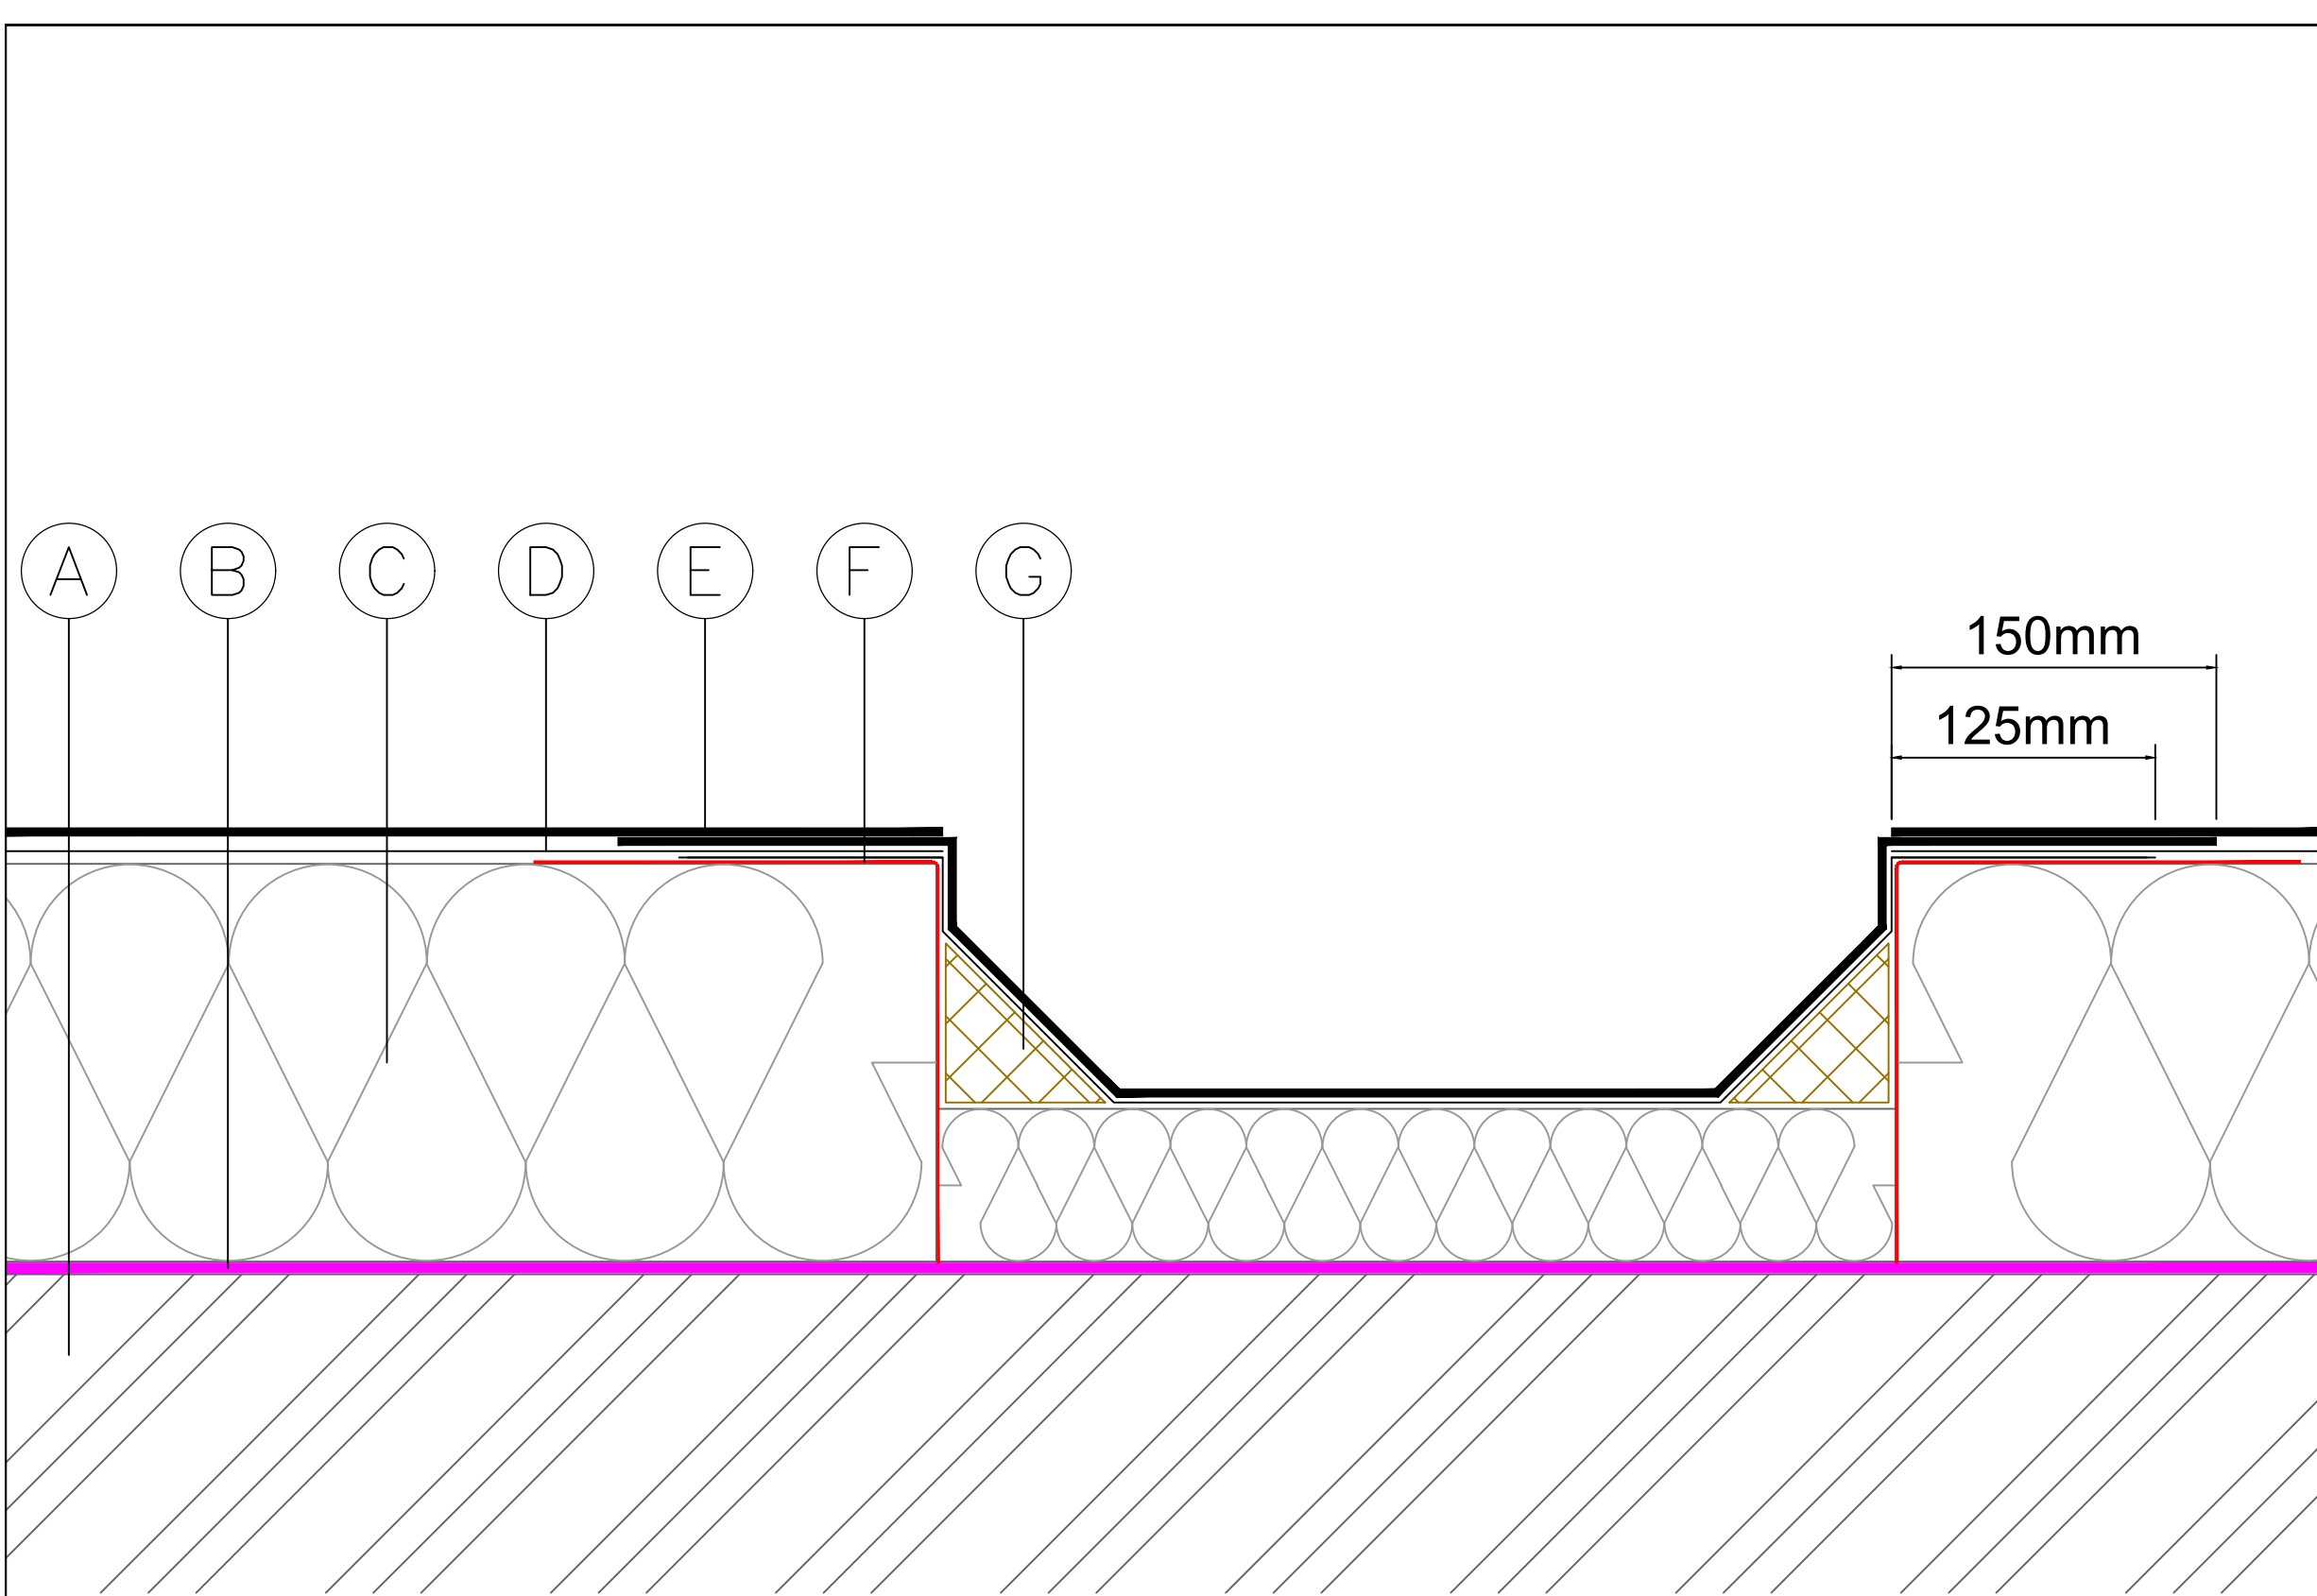

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) Galv metal hard edge bonded to insulation using a PU adhesive
- G) 50 x 50mm treated timber angle fillet

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE




T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Insulated Gutter
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018 SCALE: NTS DRAWN: MDJ

DRAWING NO: FATRA F2F-20 REVISION: -

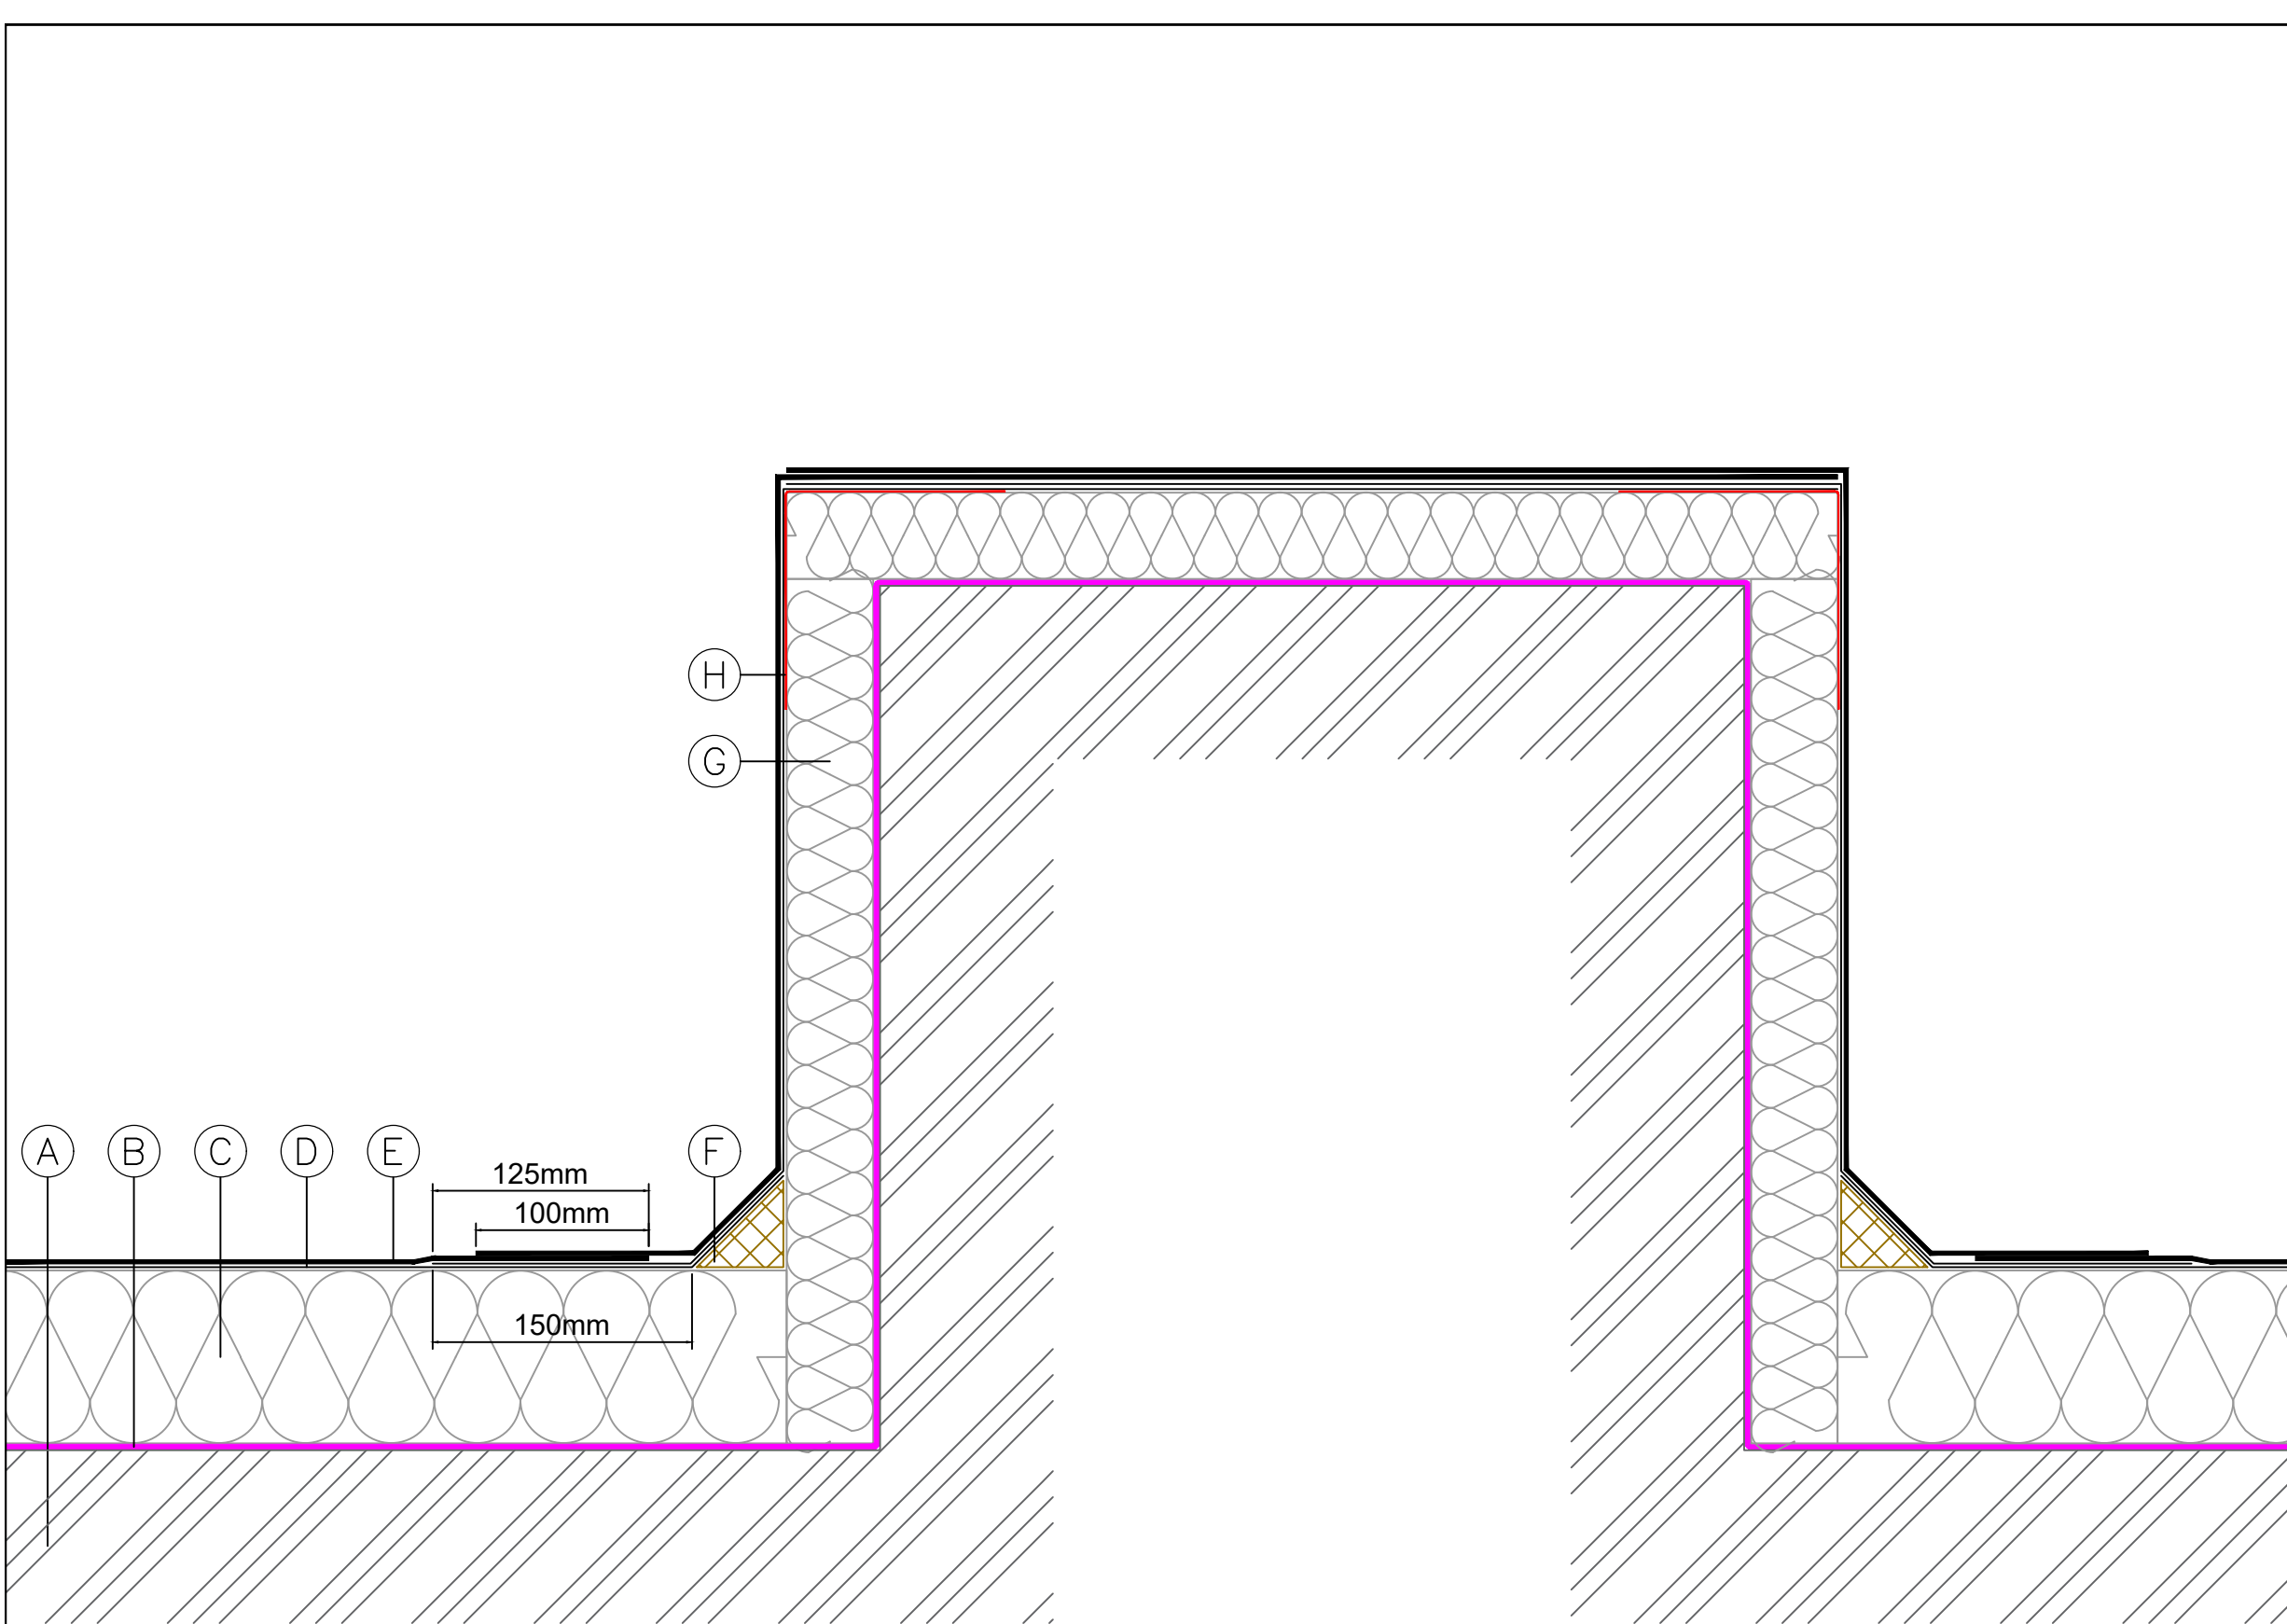

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) 50 x 50mm treated timber angle fillet
- G) Xtratherm FR/BGM rigid PIR insulation (or equal approved), bonded with Fatra FF867 Insulation Adhesive
- H) Galv metal hard edge bonded to insulation using a PU adhesive

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE




T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Insulated Plinth
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018 SCALE: NTS DRAWN: MDJ

DRAWING NO: FATRA F2F-21 REVISION: -

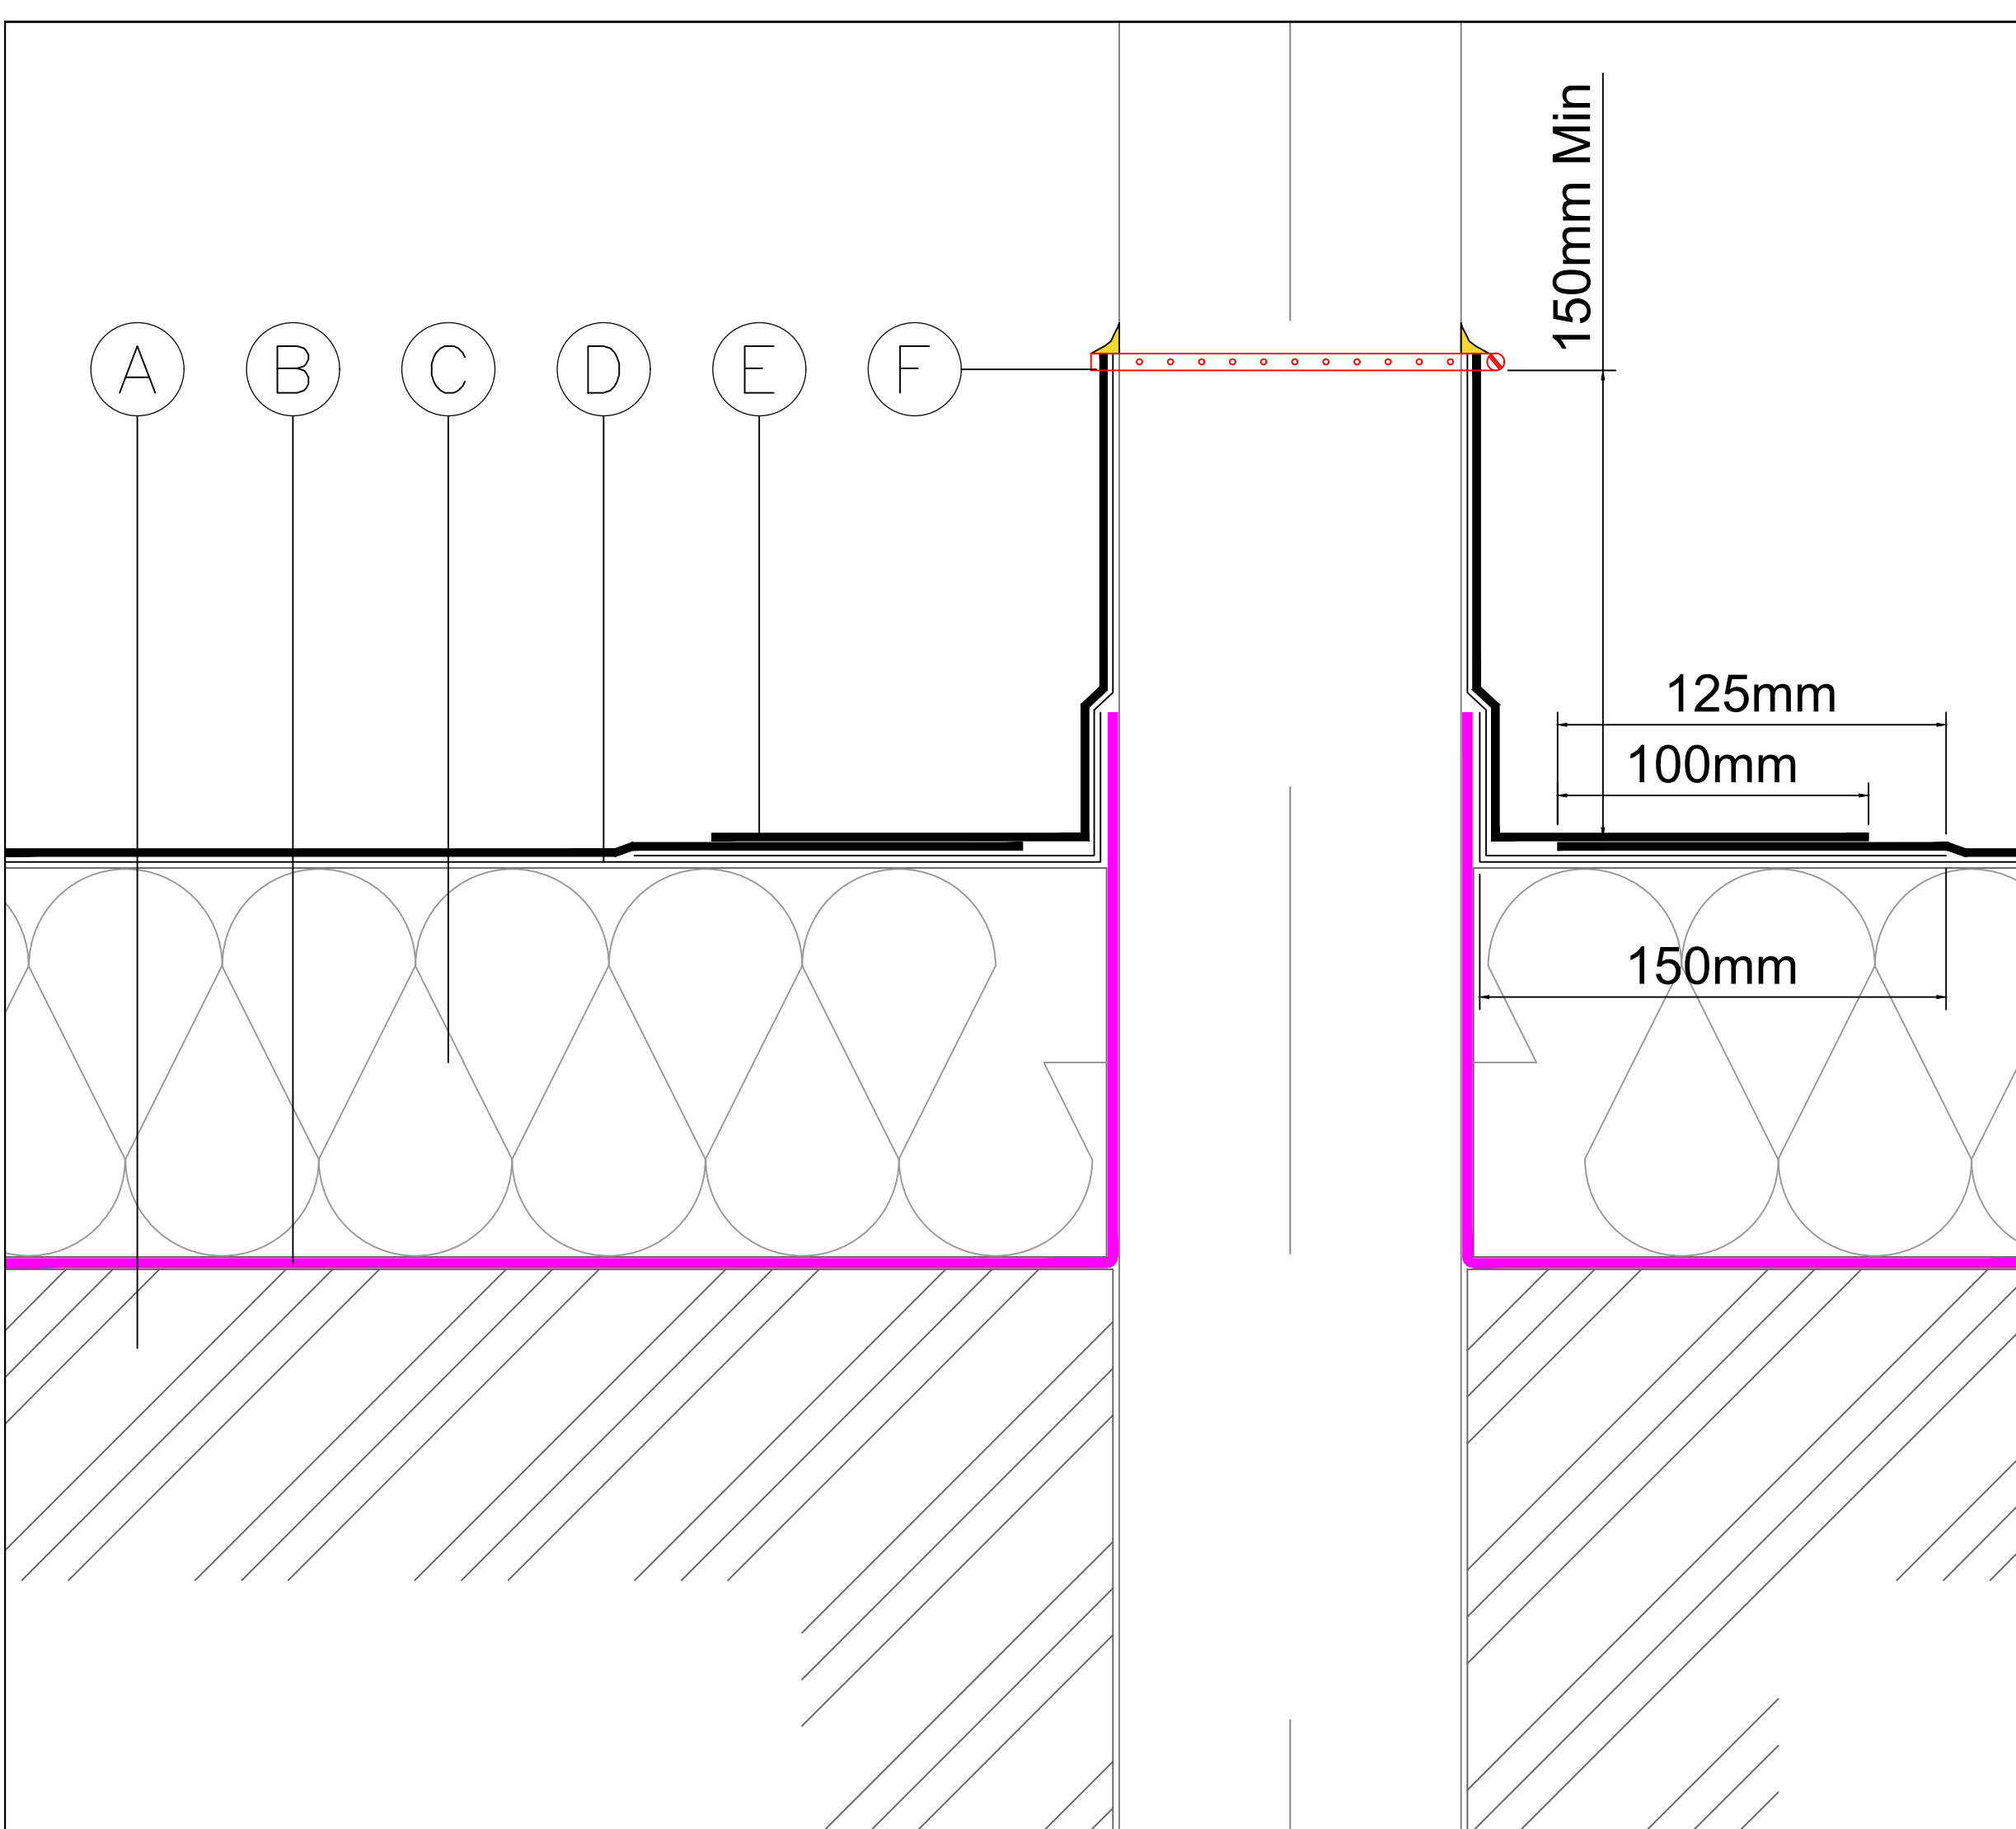

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) Jubilee clip sealed with Fatra FF857 Silicone Sealant

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.


FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE



T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Cold Pipe Penetration
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018	SCALE: NTS	DRAWN: MDJ
DRAWING NO: FATRA F2F-22		REVISION: -

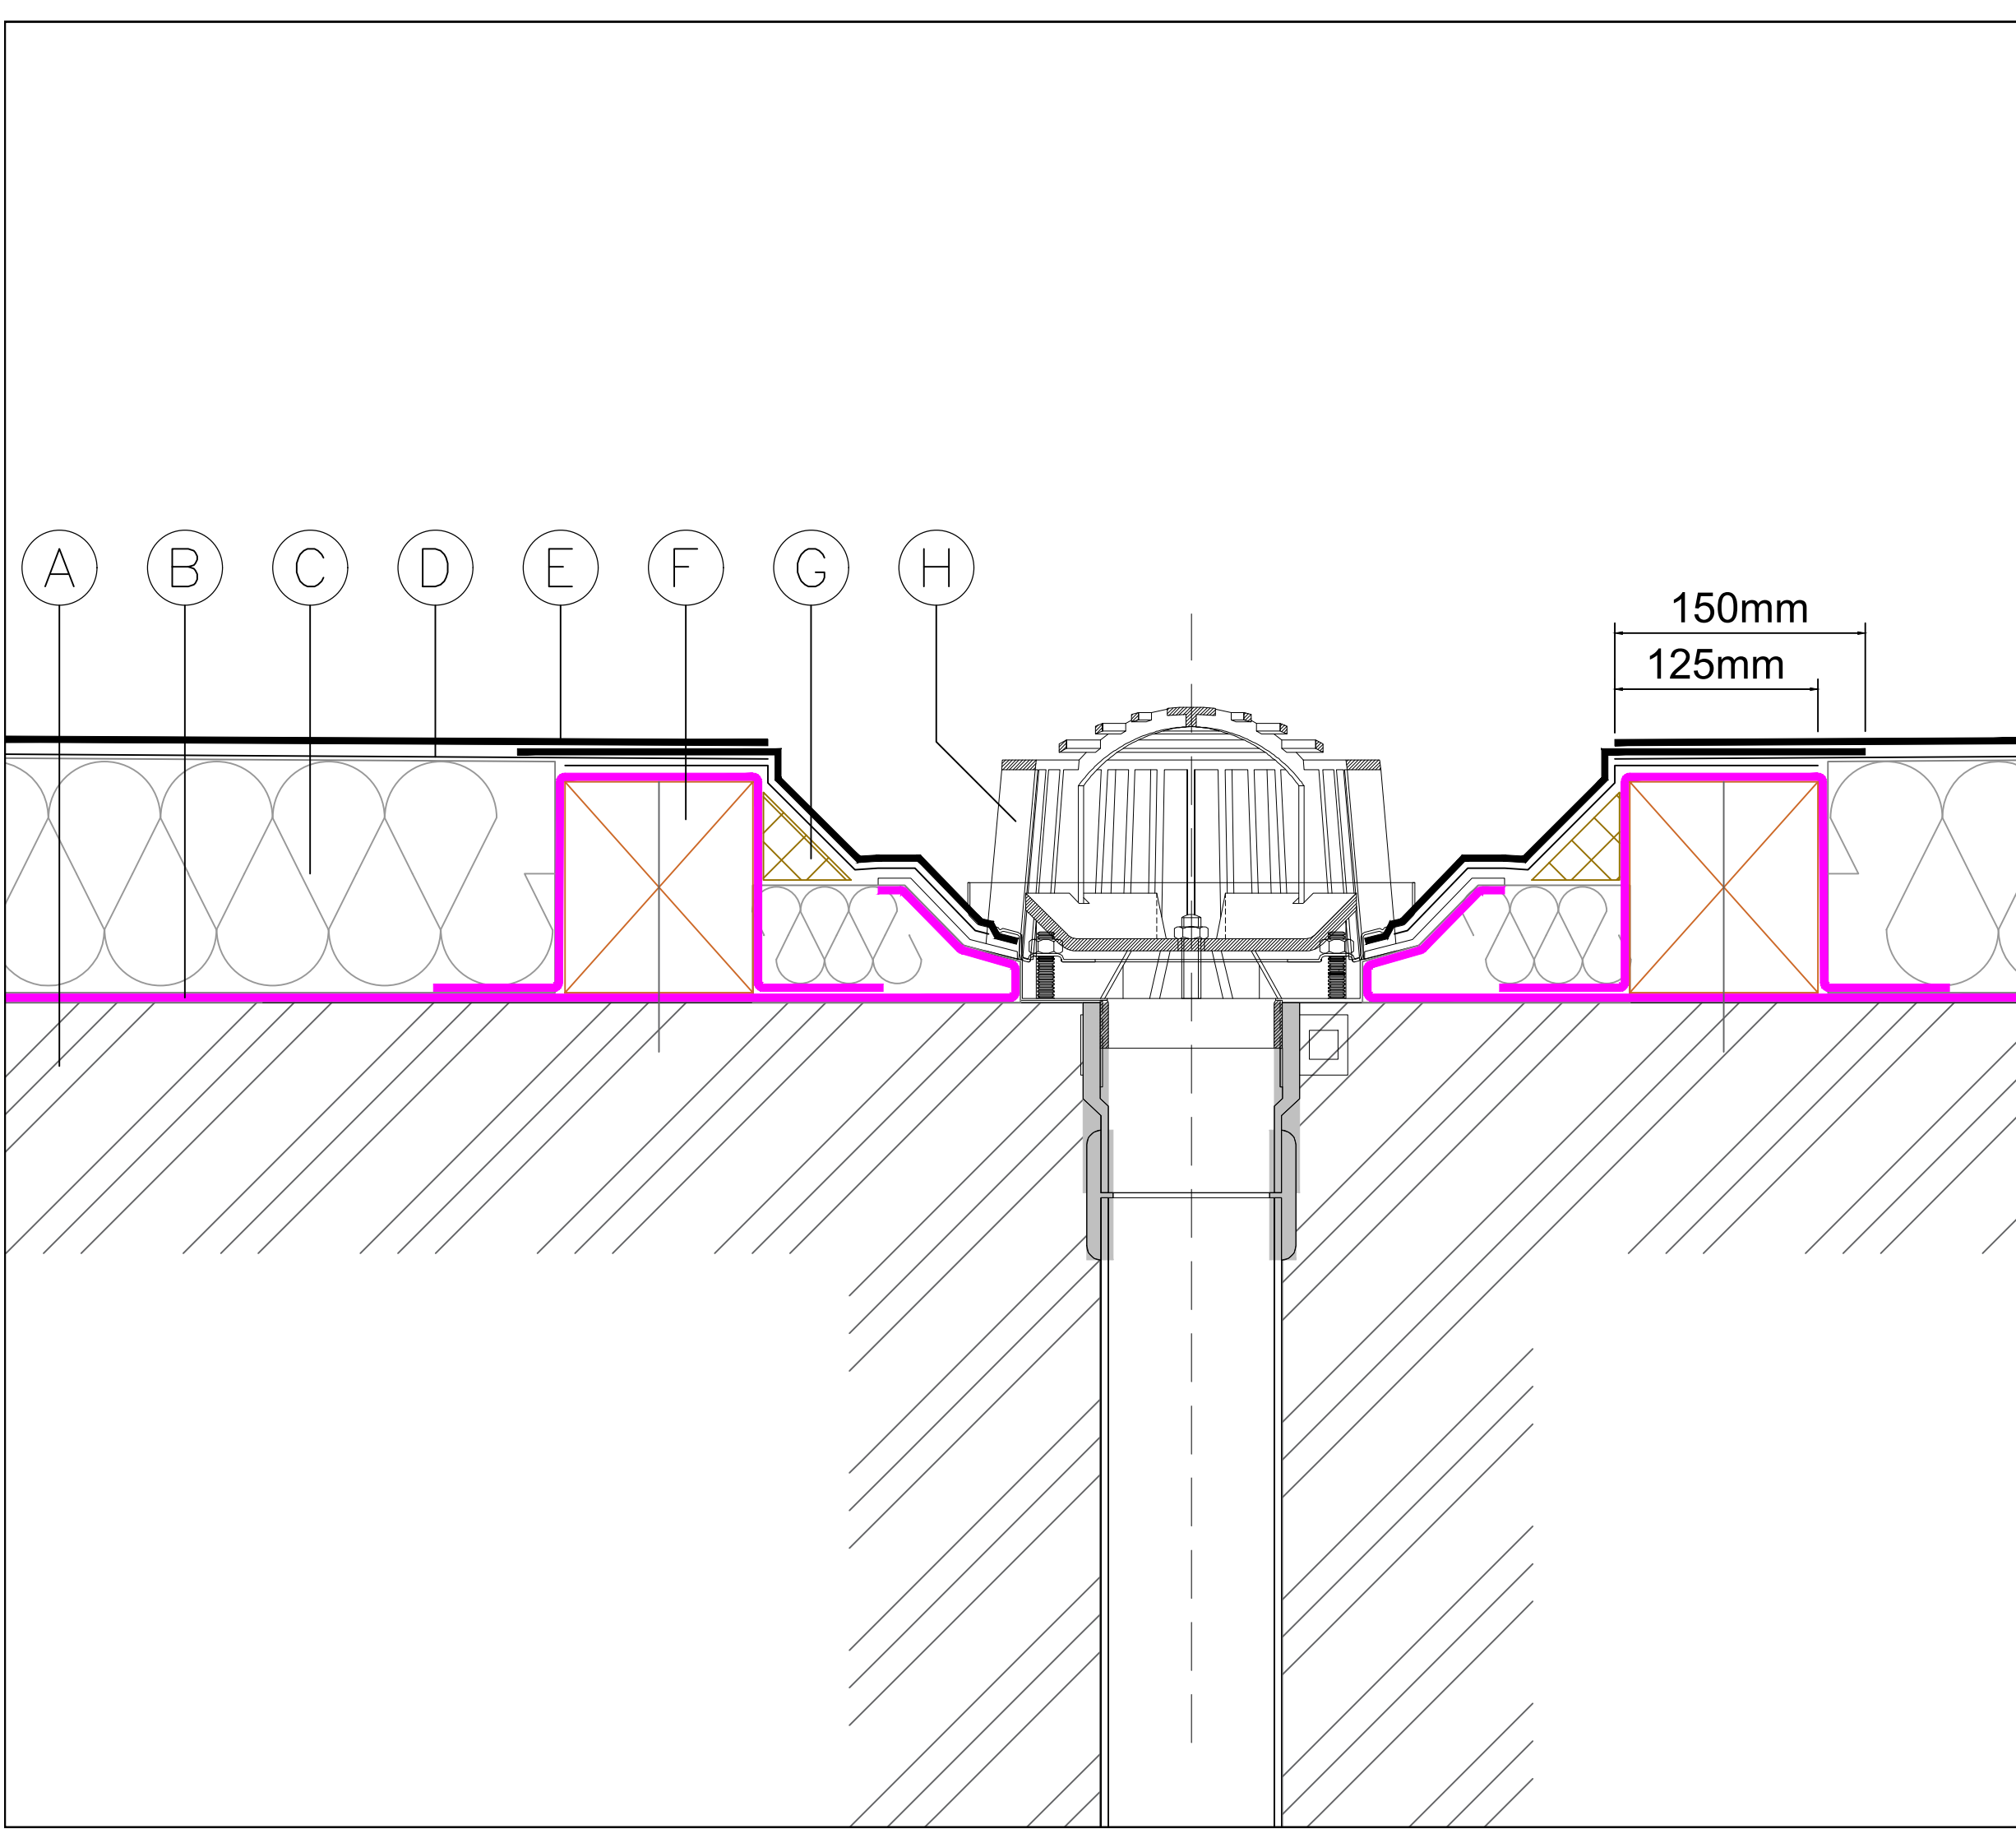

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) Timber hard edge mech fixed to structural deck
- G) 50 x 50mm treated timber angle fillet
- H) Metal rain water outlet with clamping ring and leaf grate

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.


FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE



T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Vertical Rainwater Outlet
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018	SCALE: NTS	DRAWN: MDJ
DRAWING NO: FATRA F2F-23		REVISION: -

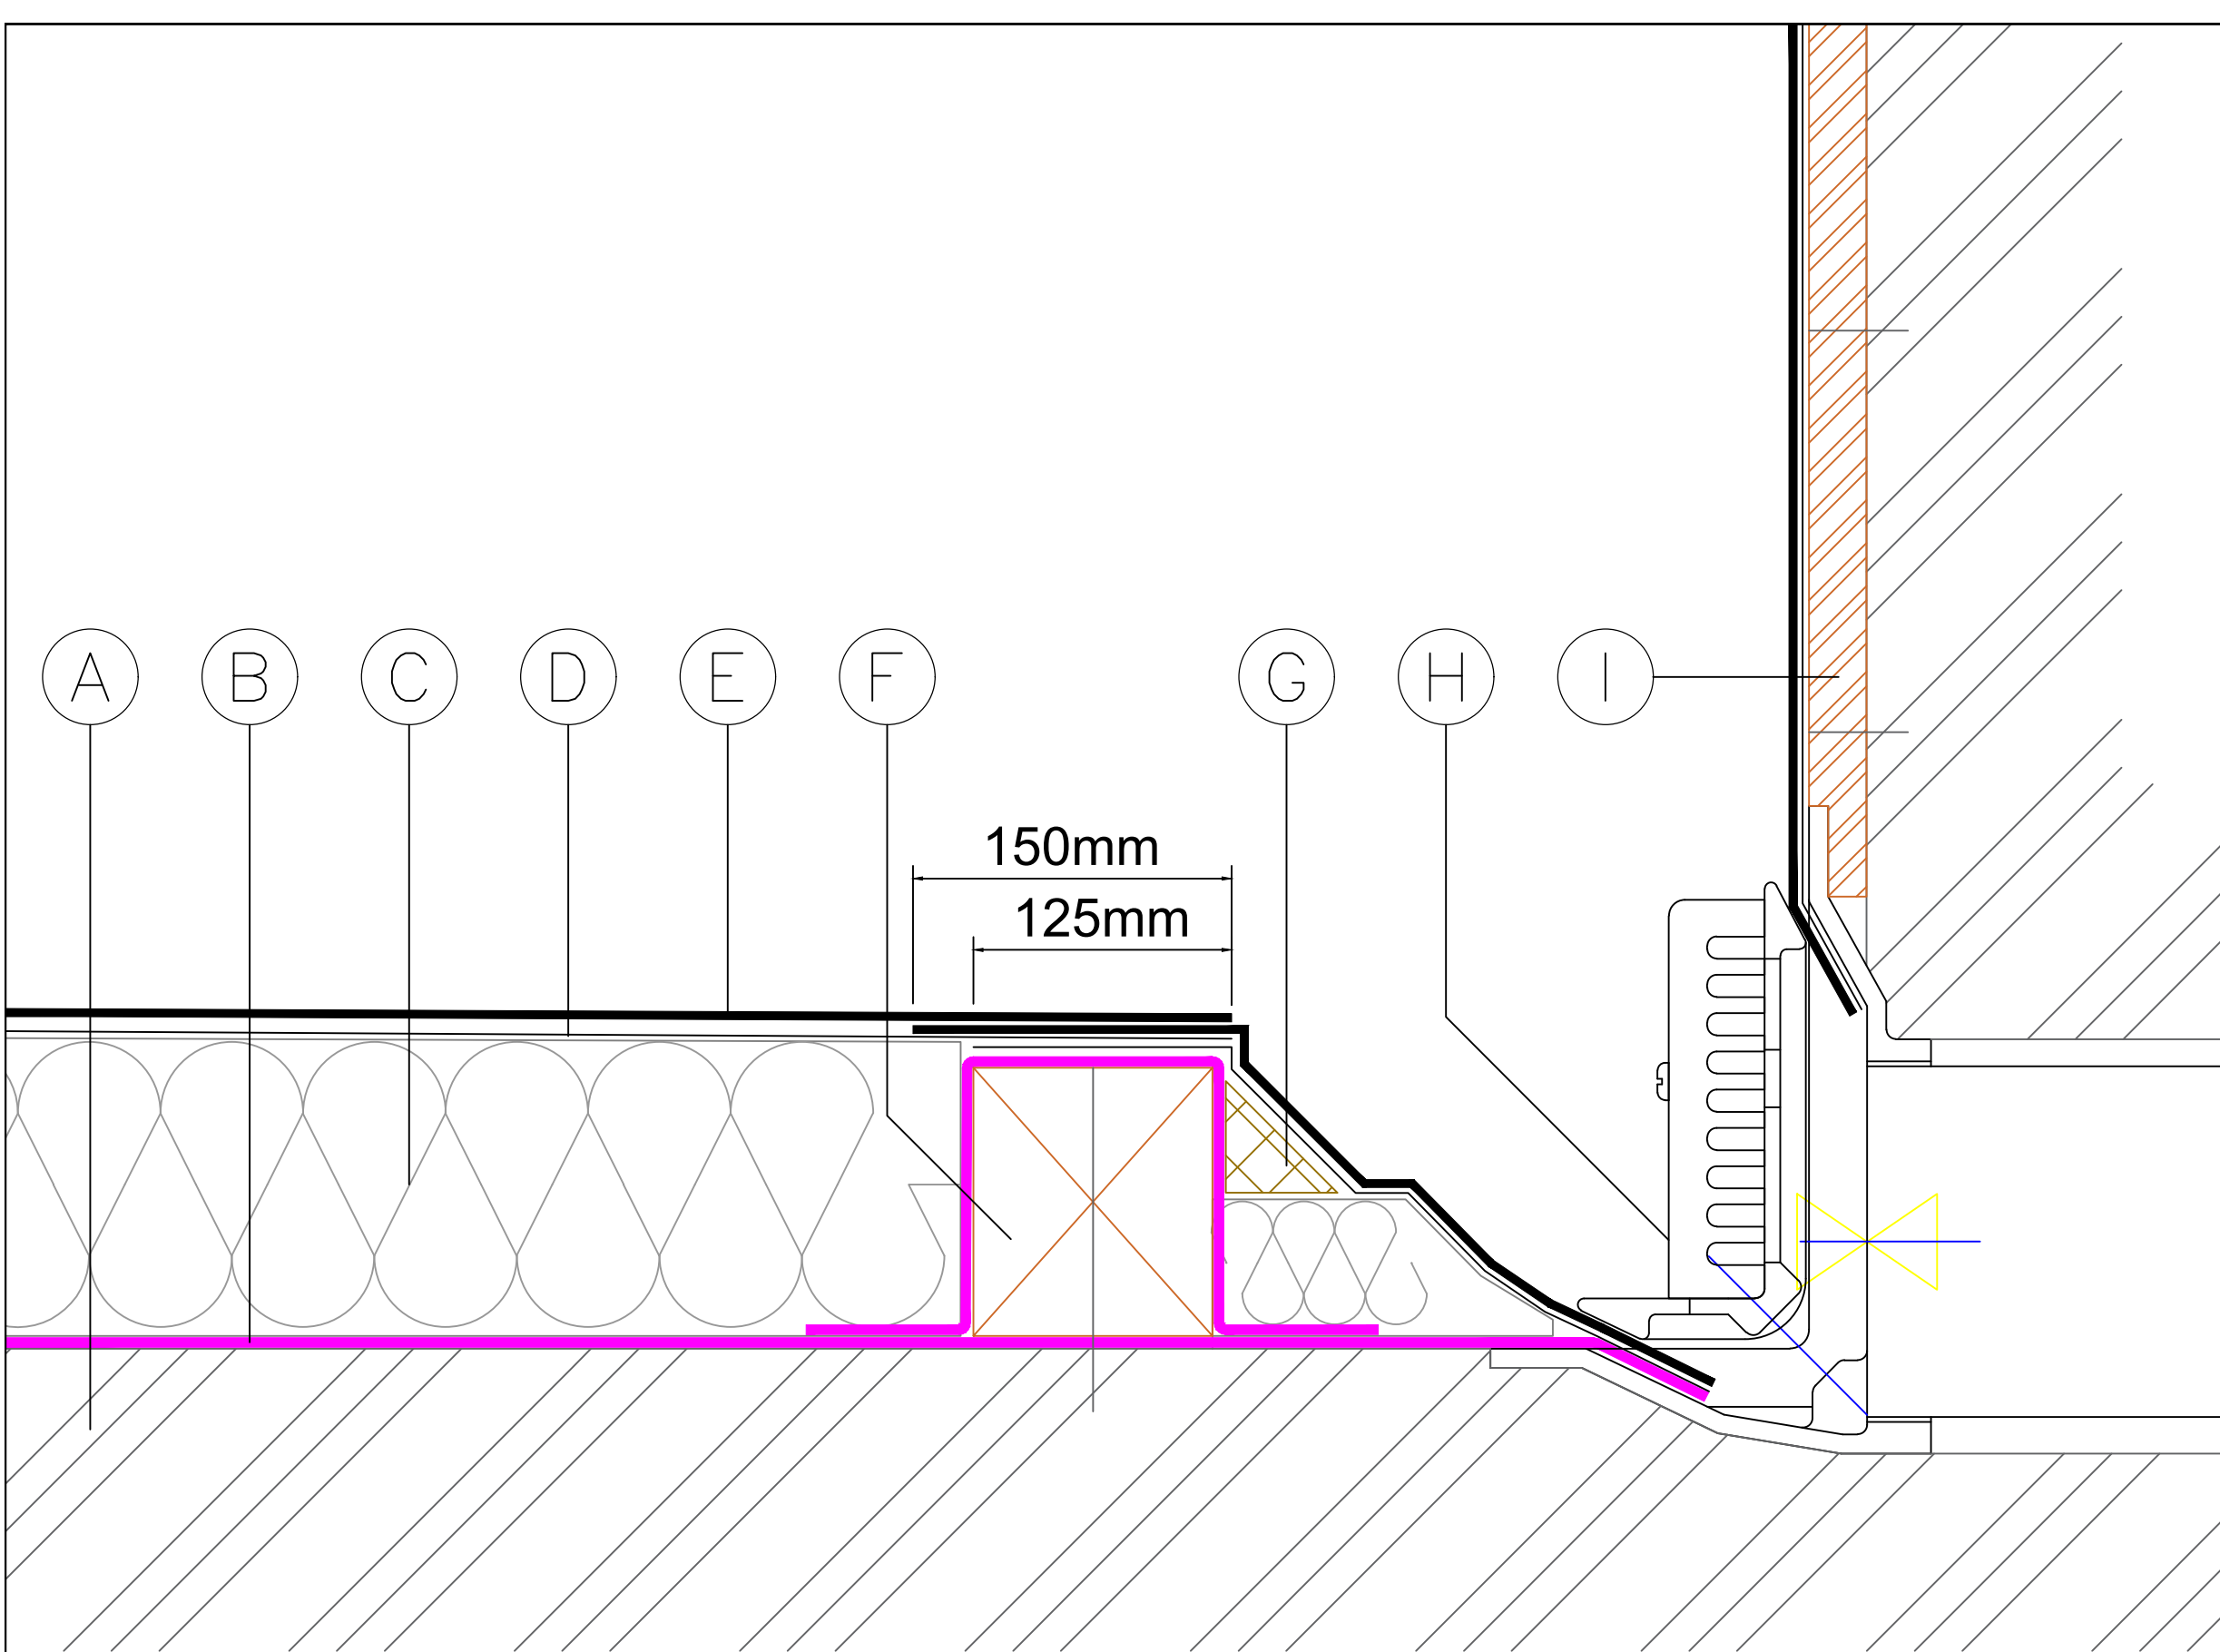

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) Timber hard edge mech fixed to structural deck
- G) 50 x 50mm treated timber angle fillet
- H) Metal rain water outlet with clamping ring and leaf grate
- I) 18mm Class 3 plywood mech fixed to upstand

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE




T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Horizontal Rainwater Outlet
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018	SCALE: NTS	DRAWN: MDJ
----------------------	----------------------	----------------------

DRAWING NO: FATRA F2F-24	REVISION: -
------------------------------------	-----------------------

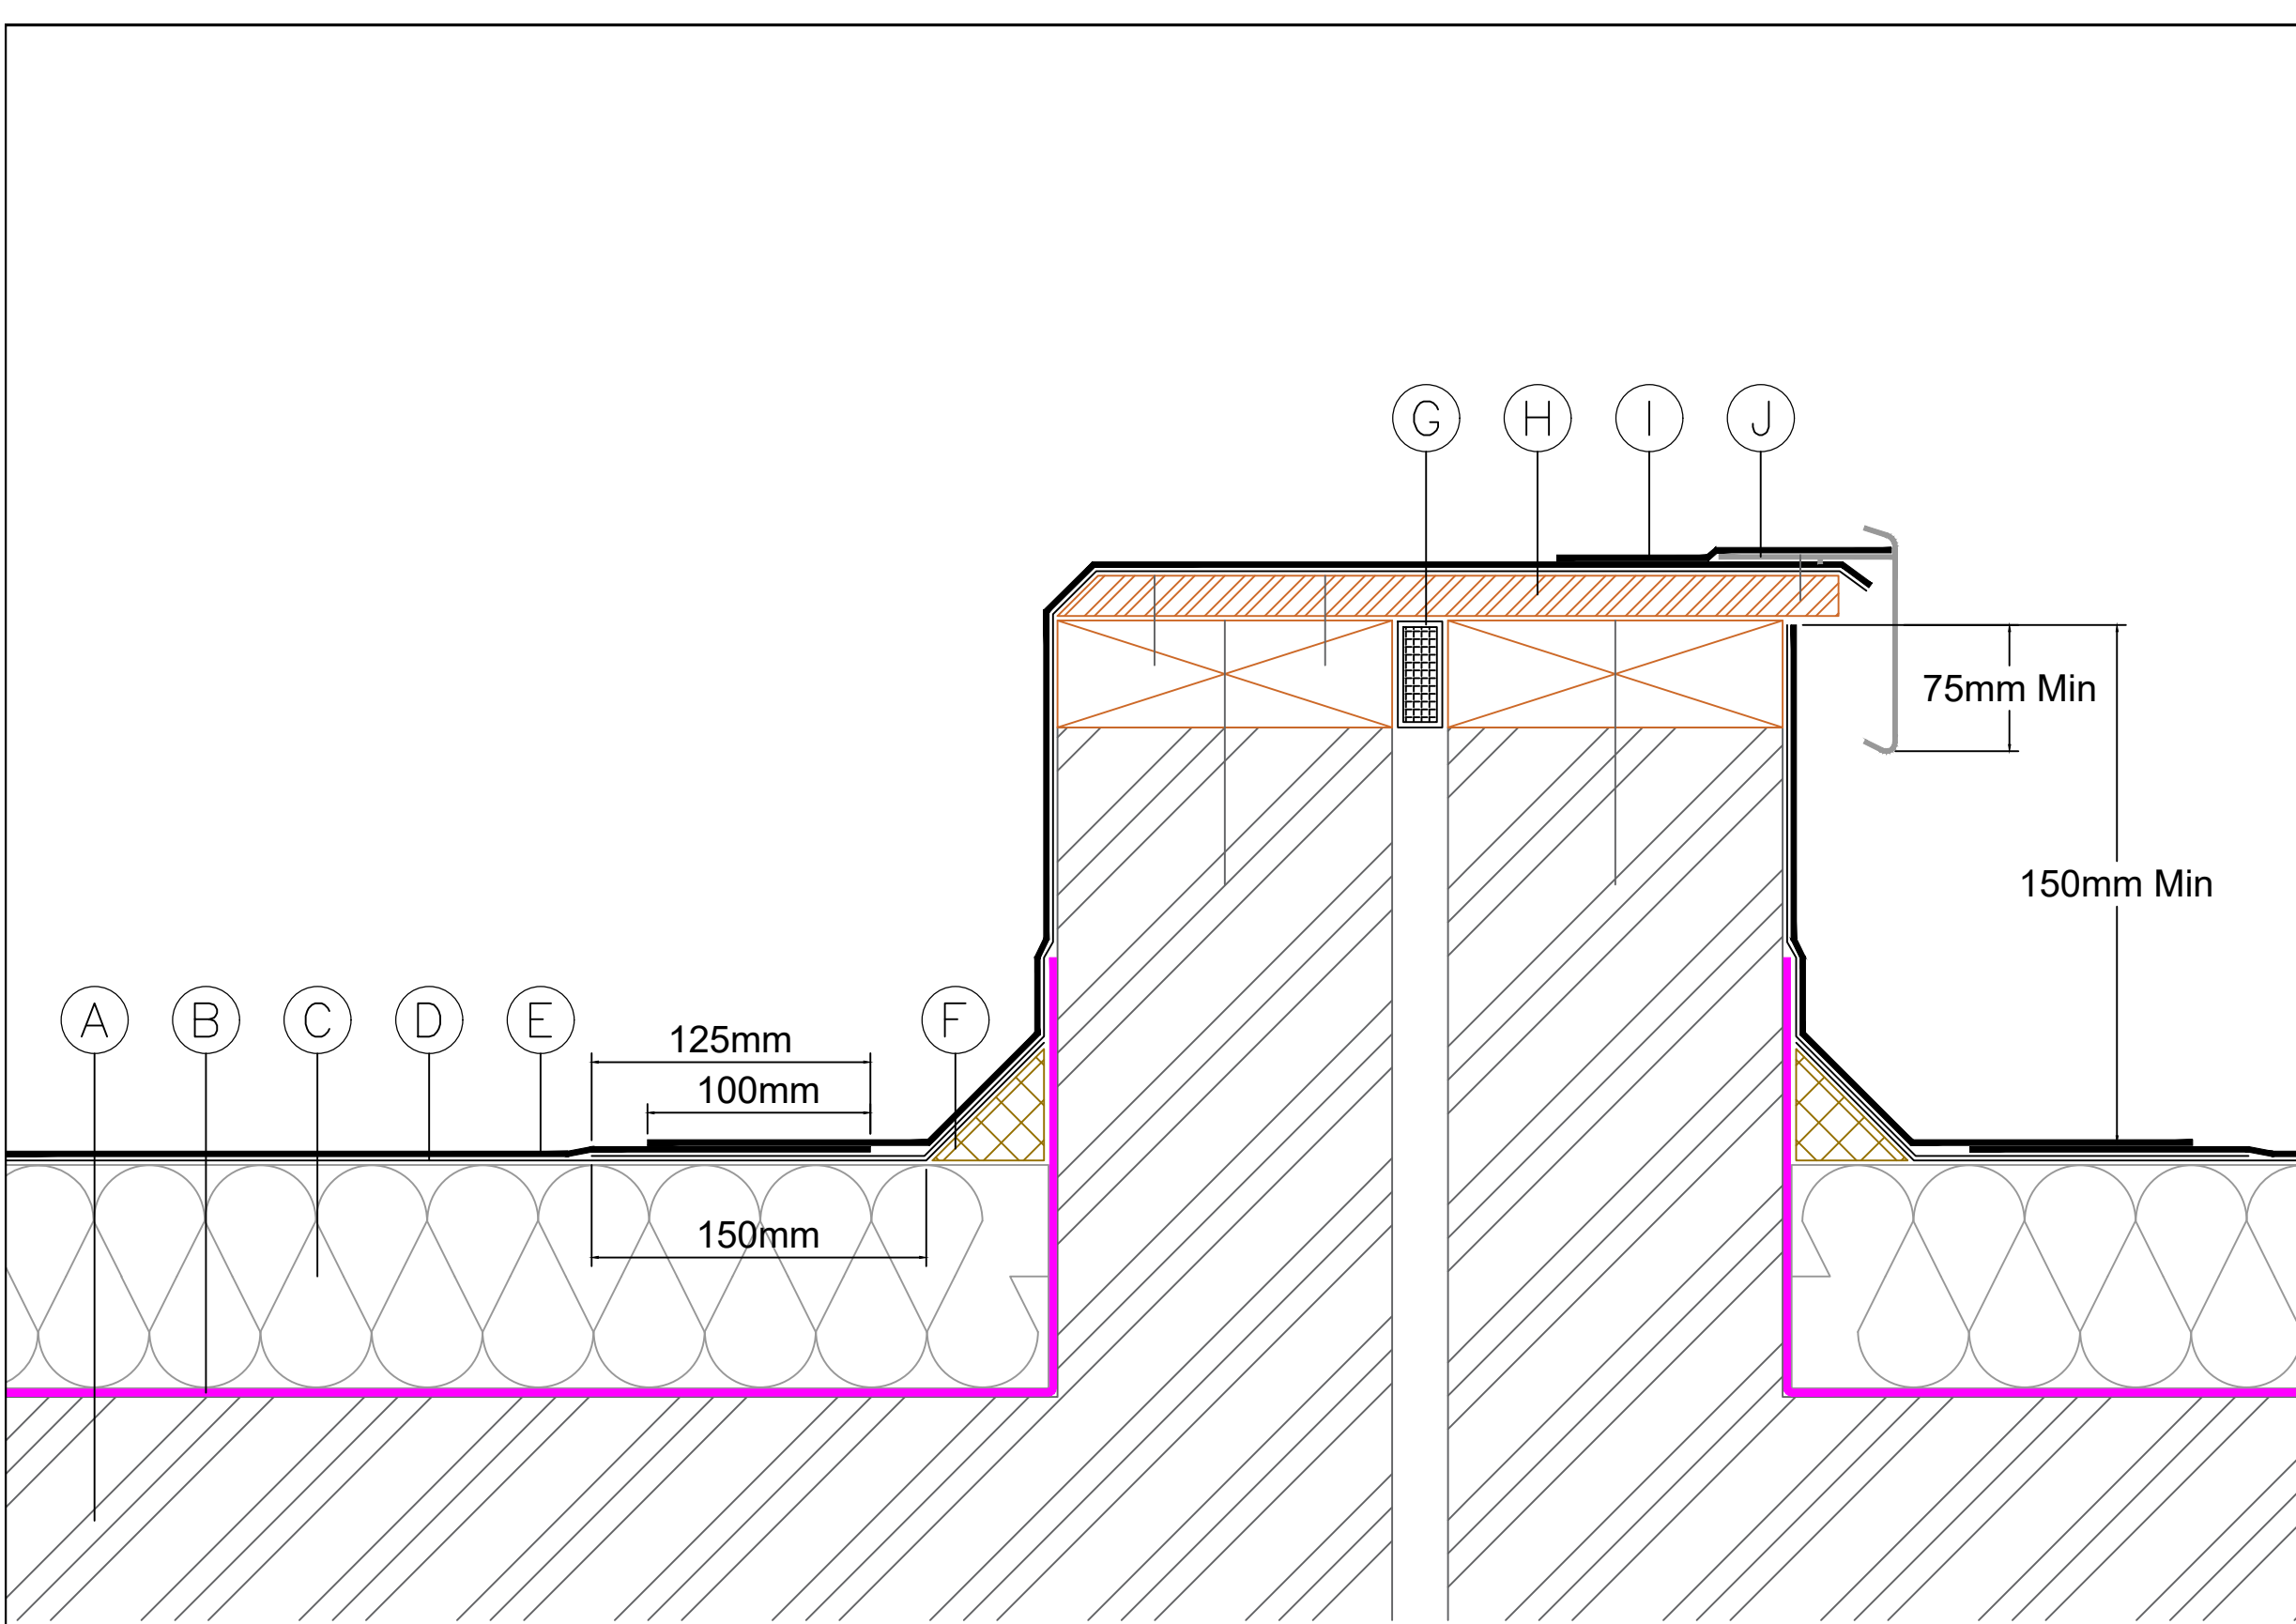

- A) Structural deck laid to a 1:80 fall, surface primed with Fatra FF817 Primer as required
- B) Fatra FF820 Torch On Felt Vapour Control Layer 2mm 2.5kg (roll size 1x16m)
- C) Xtratherm FR/BGM rigid PIR insulation (or equal approved), thickness to achieve required U-Value, bonded with Fatra FF867 Insulation Adhesive
- D) Fatra FF819 Torch On Felt Underlayer 2.5mm 3kg (roll size 1x8m)
- E) Fatra FF825 Torch On Felt Capsheet 4mm 5kg (roll size 1x8m)
- F) Profiled timber check fillet (min 40mm high) mech fixed to timber insulation stop
- G) Compressible foam sealant strip
- H) 18mm Class 3 plywood mech fixed to the correct side of the expansion kerb as detailed
- I) 150mm wide felt torch on cover strap in Fatra FF825
- J) GRP Paptrim mech fixed at 250mm centres, face size to suit onsite requirements; minimum 75mm coverage as detailed

STANDARD DETAIL

All details must be installed in accordance with BS8217, BS6229 and Fatra recommendations.

FATRA UK LTD.
UNIT 12
THE TIMBER YARD
EAST MOORS ROAD
OCEAN PARK
CARDIFF, CF24 5EE



T 029 2048 7954 E technical@fatra.co.uk
F 029 2048 9226 W www.fatra.co.uk

Expansion Kerb with GRP Trim
Fatra Two Layer Felt Standard Detail
Fatra UK Ltd

DATE: 2018 SCALE: NTS DRAWN: MDJ

DRAWING NO: FATRA F2F-25 REVISION: -